


*Red walls are 2 layers  
of 5/8" dry wall  
use 1/4" average*

- PLAN NOTES**
- 1 CIRCUIT CONTROLLED VIA TIMELOCK.
  - 2 FIRE ALARM ANNUNCIATOR PANEL.
  - 3 CONNECT TO 120 VOLT NORMAL POWER CIRCUIT(S) IN RESIDENT ROOM (REFER TO 1/4" SCALE UNIT PART PLANS ON DRAWING E3.2).
  - 4 CONNECT TO 120 VOLT GENERATOR POWER CIRCUIT IN RESIDENT ROOM (REFER TO 1/4" SCALE UNIT PART PLANS ON DRAWING E3.2).
  - 5 CONNECT TO RECEPTACLE IN RESIDENT BATHROOM (REFER TO UNIT PART PLANS).
  - 6 FIRE ALARM ANNUNCIATOR PANEL.
  - 7 CONNECT TO 120 VOLT NORMAL POWER CIRCUIT(S) IN RESIDENT ROOM (REFER TO 1/4" SCALE UNIT PART PLANS ON DRAWING E3.2).
  - 8 CONNECT TO 120 VOLT GENERATOR POWER CIRCUIT IN RESIDENT ROOM (REFER TO 1/4" SCALE UNIT PART PLANS ON DRAWING E3.2).
  - 9 CONNECT TO RECEPTACLE IN RESIDENT BATHROOM (REFER TO UNIT PART PLANS).
  - 10 COORDINATE RECEPTACLES FOR FISH TANK WITH SUPPLIER.
  - 11 CONNECT TO ROOM LIGHTING CIRCUIT AND CONTROLS.
  - 12 JUNCTION BOX FOR POWER TO MOTORIZED DOOR - COORDINATE EXACT LOCATION AND POWER REQUIREMENTS WITH DOOR SUPPLIER.
  - 13 NEW LOCATION OF EXISTING MED GAS ALARM PANEL.
  - 14 NEW LOCATION OF EXISTING RESIDENT GUARD CONTROL PANEL.
  - 15 NEW LOCATION OF EXISTING GENERATOR ANNUNCIATOR PANEL.
  - 16 NEW LOCATION OF EXISTING SECURITY CONTROL PANEL.
  - 17 PROVIDE 2-CHANNEL TIMELOCK AND TWO, 1-POLE, 20 AMP CONTACTORS - LOCATE TIMELOCK AND CONTACTORS NEXT TO PANEL 'AH1'. PROVIDE TWO MANUAL OVERRIDE SWITCHES (ONE FOR EACH ZONE CONTROLLED) NEXT TO TIMELOCK. APL-44
  - 18 RECEPTACLE FOR NURSING ROOMS PDI TELEVISION POWER.
  - 19 CONNECT 120 VOLT TO MOTORIZED DAMPER.

WORK PREVIOUSLY SHOWN IN THIS AREA HAS BEEN REMOVED FROM THE SCOPE.

8"X4"X3/4" THICK PLYWOOD TELECOM BACKBOARD - SEE COMMUNICATION RACEWAY DIAGRAM ON DRAWING E4.2 FOR ADDITIONAL INFORMATION  
NURSE CALL CONTROL PANEL  
FIRE ALARM BOOSTER PANEL ACP1-9  
PANEL 'AH1'  
PANEL 'AP1'

**FIRST FLOOR PLAN ADDITION - POWER**  
SCALE: 1/8" = 1'-0"

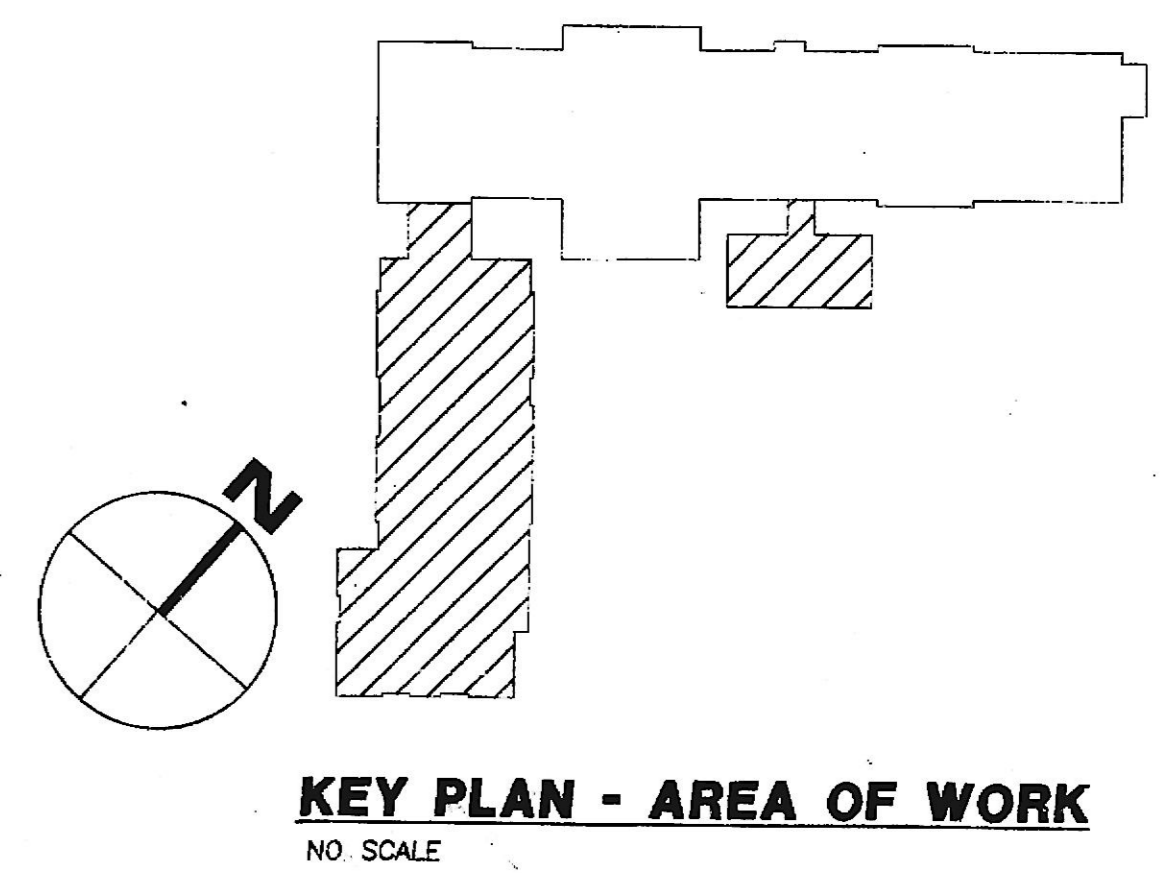

REVISION	BY
PERMIT COMMENTS	
REVISION 2	
ADDENDUM #2	

Professional Certification  
I certify that these documents were prepared or approved by me, and that I am duly licensed Professional Engineer under the laws of the State of Maryland, license number 22792, expiration date August 04, 2020.

**SRBR**  
MEP Consulting Engineers since 1959  
37 Frederick Road Suite 300 - Catonsville, Maryland 21228  
Phone: 410-869-7282  
Web: www.SRBRengineers.com

**Lorien Nursing - Elkridge Addition**  
7615 Washington Blvd  
Elkridge, Maryland 21075

**FIRST FLOOR PLAN ADDITION POWER**

DATE	Dec. 08, 2019
SCALE	As Noted
DRAWN	
JOB	
SHEET	

**E1.4**  
OF SHEETS

ADDENDUM #2 12/06/2019  
SRBR No:18131