
FAX: 410-893-9295





® DEMOLITION MECHANICAL PLAN SECOND FLOOR

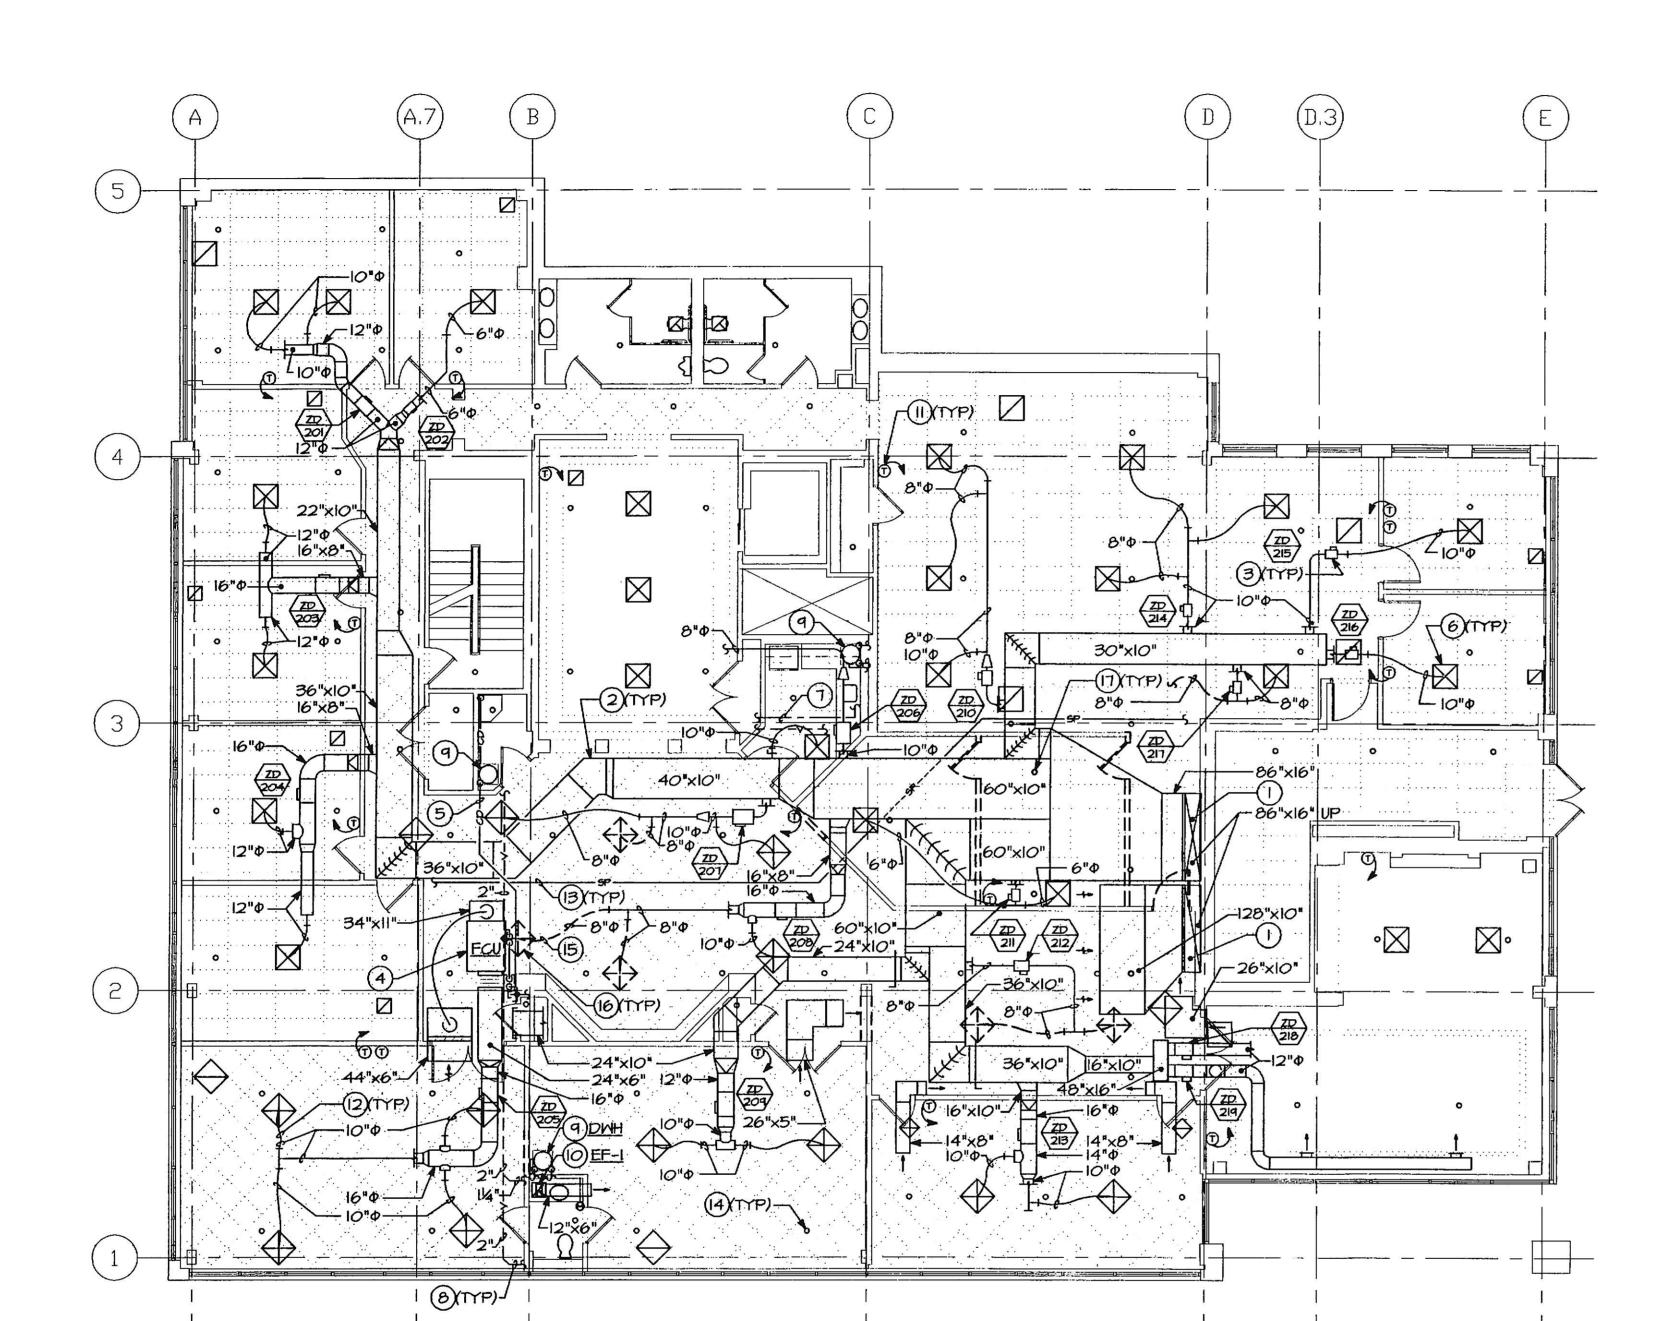

DRAWING NOTES

- (I) SUPPLY AND RETURN AIR DUCTS UP TO ROOFTOP UNIT TO REMAIN.
- 2 SUPPLY/RETURN AIR DUCT TO REMAIN. CONTRACTOR SHALL VERIFY CONDITION OF EXISTING DUCTWRAP INSULATION AND ADVISE BUILDING OWNER IF DETERMINED TO BE IN POOR CONDITION.
- 3 ZONE DAMPER LOCATED ABOVE CEILING TO REMAIN. CONTRACTOR SHALL INSPECT, CLEAN, SERVICE, AND MAKE READY ALL EXISTING ZONE DAMPERS SERVING THE SECOND FLOOR.
- (4) HORIZONTAL FAN COIL UNIT MOUNTED ABOVE CEILING SPACE TO REMAIN.
- (5) CONDENSATE PIPING IN CEILING SPACE TO REMAIN.
- (6) CEILING MOUNTED AIR DEVICE TO REMAIN.
- (7) DOMESTIC WATER PIPING LOCATED ABOVE CEILING TO REMAIN.
- (8) VENT PIPING LOCATED ABOVE CEILING TO REMAIN.
- (9) ELECTRIC WATER HEATER ABOVE CEILING TO REMAIN.
- (O) EXHAUST FAN LOCATED ABOVE CEILING TO REMAIN.
- (II) WALL MOUNTED THERMOSTAT TO REMAIN.
- (12) INSULATED FLEX DUCT RUNOUT TO REMAIN.
- (3) APPROXIMATE ROUTING OF SPRINKLER MAIN PIPING LOCATED ABOVE CEILING TO REMAIN.
- (4) SPRINKLER HEAD TO REMAIN.
- (5) REMOVE AND RELOCATE FLEX DUCT RUNOUT AS SHOWN, REFER TO MECHANICAL PLAN SECOND FLOOR, SHEET M5, FOR NEW LOCATION.
- REMOVE AND RELOCATE AIR DEVICE AS SHOWN, REFER TO MECHANICAL PLAN SECOND FLOOR, SHEET M5, FOR NEW LOCATION:
- (17) REMOVE/RELOCATE SPRINKLER HEAD. REFER TO MECHANICAL PLAN SECOND FLOOR, SHEET M5, FOR NEW LOCATION.
- (B) THE CEILING SPACE THROUGHOUT THE SECOND FLOOR IS USED AS A RETURN PLENUM. ALL MATERIALS TO BE USED SHALL BE APPROVED FOR USE IN PLENUMS. ANY MATERIALS SUCH AS PVC PIPING WHICH ARE NOT APPROVED SHALL BE REMOVED.

SCALE

6/14/02

DESIGNED BY

DRAWN BY

CHK. BY

PROJECT #

REVISIONS

02020A

AUTOCAD FILE:



