


SCHEDULE FOR PANEL: 'B' BUSSING AMPS: 125A VOLTAGE: 120Y208V PHASE: 3 WIRE: 4 NEMA: 1
 MAINS: MLO MOUNTING: FLUSH TYPE: LOADCENTER REMARKS: EXISTING


LOAD DESCRIPTION	WIRE	P	AMP	CCT	PHASE	CCT AMP	P	WIRE	LOAD DESCRIPTION
COUNTER RECEPTS.	12	1	20	1	A	2	<	<	<
FLOOR RECEPTS.	12	1	20	3	B	4	20	2	12
FLOOR RECEPT. XRAY	12	1	20	5	C	6	20	1	12
VACUUM	12	2	20	9	B	10	20	1	12
RECEPTS.	12	1	20	11	C	12	20	1	12
SPACE	nn	n	nn	13	A	14	nn	n	nn
SPACE	nn	n	nn	15	B	15	nn	n	nn
SPACE	nn	n	nn	17	C	18	nn	n	nn
SPACE	nn	n	nn	19	A	20	nn	n	nn
SPACE	nn	n	nn	21	B	22	nn	n	nn
SPACE	nn	n	nn	23	C	24	nn	n	nn

SCHEDULE FOR PANEL: 'G' BUSSING AMPS: 225A VOLTAGE: 120Y208V PHASE: 3 WIRE: 4 NEMA: 1
 MAINS: MLO MOUNTING: FLUSH TYPE: LOADCENTER REMARKS: NEW


LOAD DESCRIPTION	WIRE	P	AMP	CCT	PHASE	CCT AMP	P	WIRE	LOAD DESCRIPTION
5-TON	>	>	>	1	A	2	<	<	<
ROOF TOP	2	3	80	3	B	4	30	2	10
UNIT	>	>	>	5	C	6	20	1	12
MEETING ROOM RECEPTS.	12	1	20	7	A	8	20	1	12
MEETING ROOM RECEPTS.	12	1	20	9	B	10	20	1	12
MEETING ROOM RECEPTS.	12	1	20	11	C	12	20	1	12
WORKSPACE RECEPTS.	12	1	20	13	A	14	20	1	12
MEETING ROOM RECEPTS.	12	1	20	15	B	16	20	1	12
OFFICE, VESTIBULE, BATH, STOR. LTG.	12	1	20	17	C	18	20	1	12
OFFICE, STORAGE LTG.	12	1	20	19	A	20	20	1	12
POWER SCREEN	12	1	20	21	B	22	20	1	12
CEILING RECEPT. MEETING RM.	12	1	20	23	C	24	nn	n	nn
SPACE	nn	n	nn	25	A	26	nn	n	nn
SPACE	nn	n	nn	27	B	28	nn	n	nn
SPACE	nn	n	nn	29	C	30	nn	n	nn
SPACE	nn	n	nn	31	A	32	nn	n	nn
SPACE	nn	n	nn	33	B	34	nn	n	nn
SPACE	nn	n	nn	35	C	36	nn	n	nn
SPACE	nn	n	nn	37	A	38	nn	n	nn
SPACE	nn	n	nn	39	B	40	nn	n	nn
SPACE	nn	n	nn	41	C	42	nn	n	nn

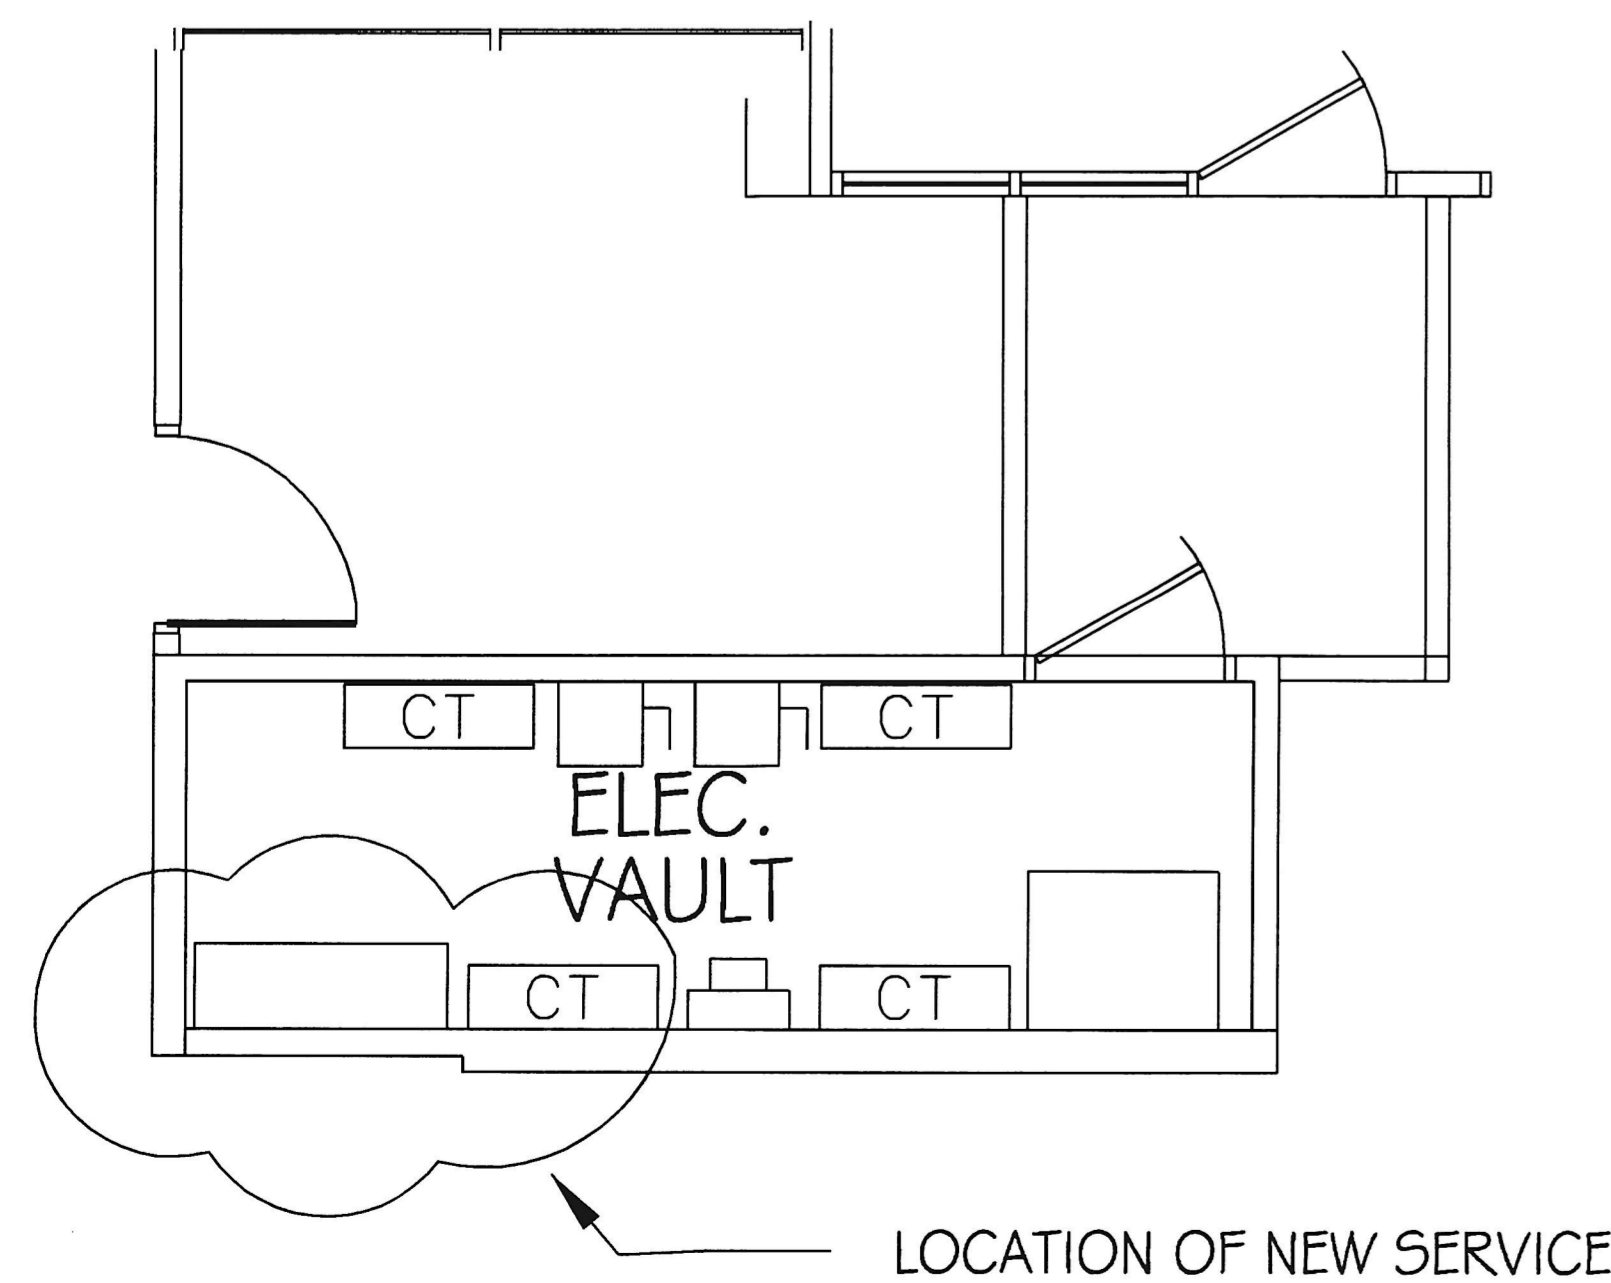

EXISTING SERVICE

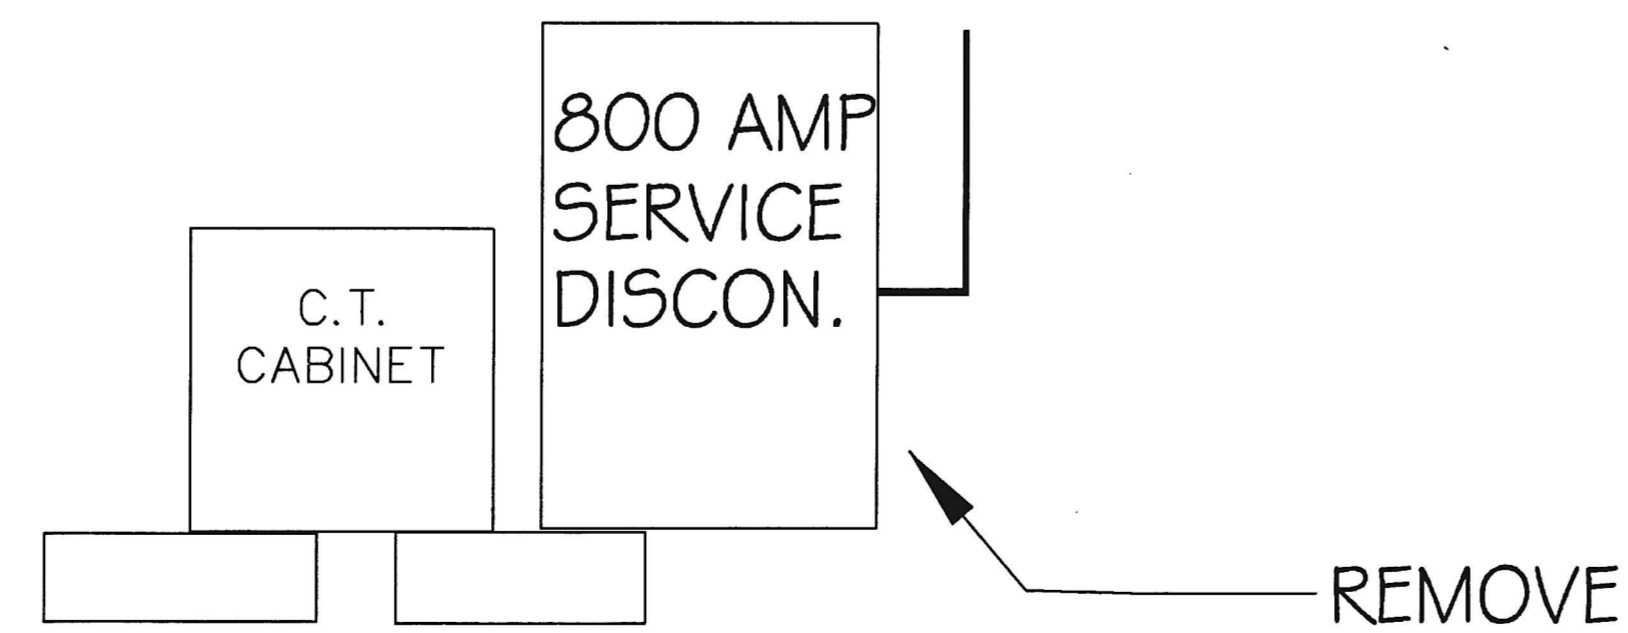

PROPOSED SERVICE

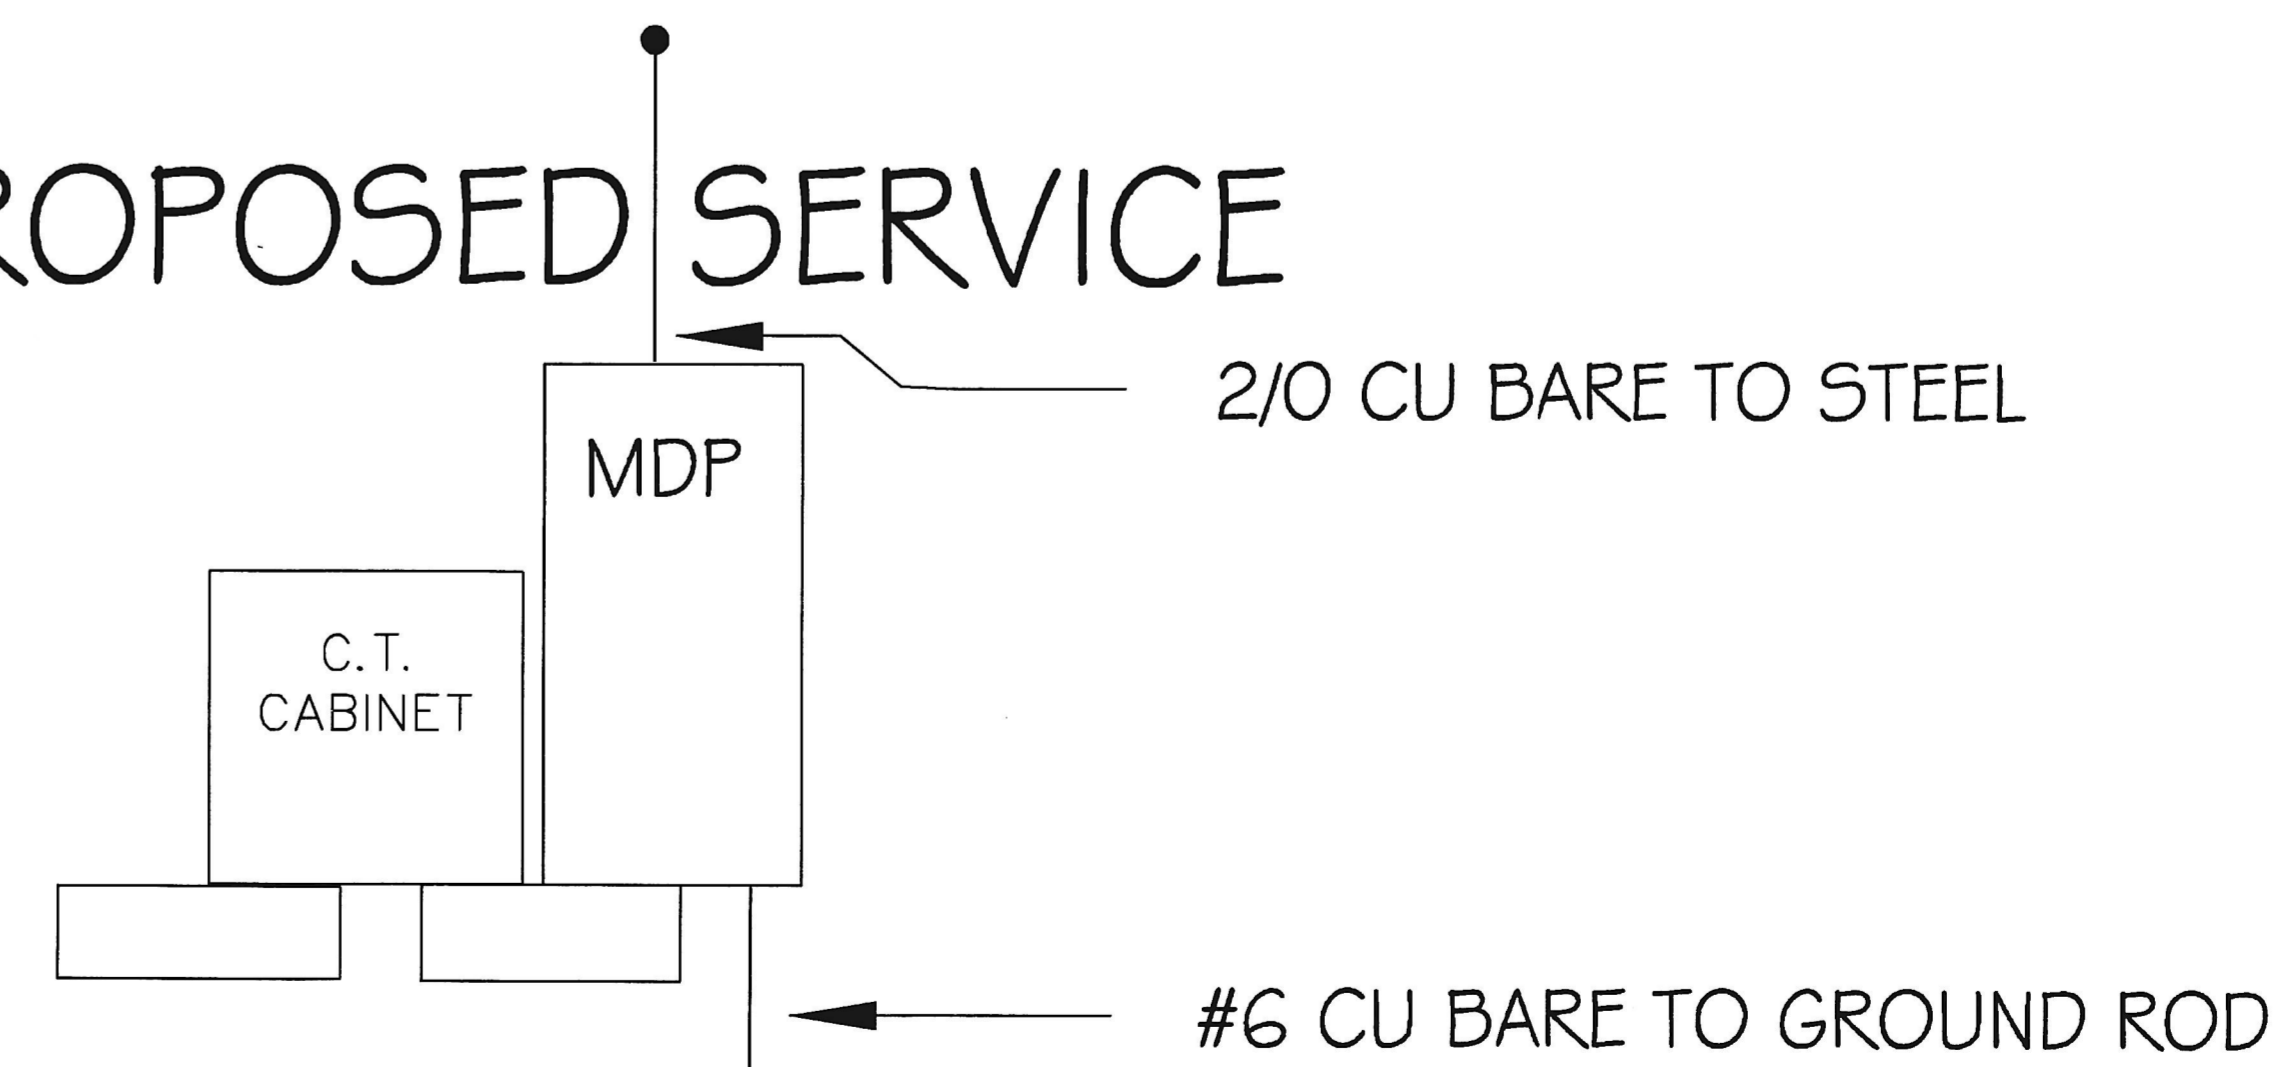

MDSDA

6410 DOBBIN ROAD
COLUMBIA, MD 21045

DRAWN BY:
GARY REEDY

CHECKED BY:

DATE:
APRIL 20, 2010

SCALE:
1/8" = 1'0"

FILE NAME:

REVISIONS:

