




- CONDENSATE DRAIN SHALL RUN TO A NEARBY DRAIN WITH REQUIRED AIR CONTRACTOR SHALL ELEVATE UNIT AS REQUIRED TO ALLOW INSTALLATION OF TRAP AND FOR PROPER DRAINAGE OF CONDENSATE PIPE OVER AN INDIRECT WASTE RECEPTOR.

#### INDOOR FLOOR MOUNTED UNIT DETAIL NOT TO SCALE

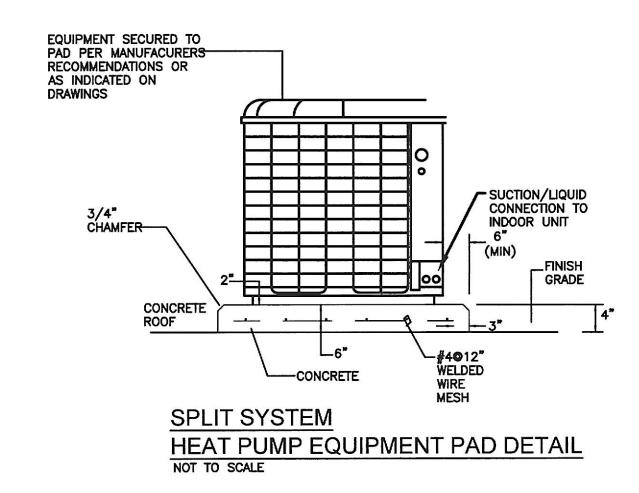


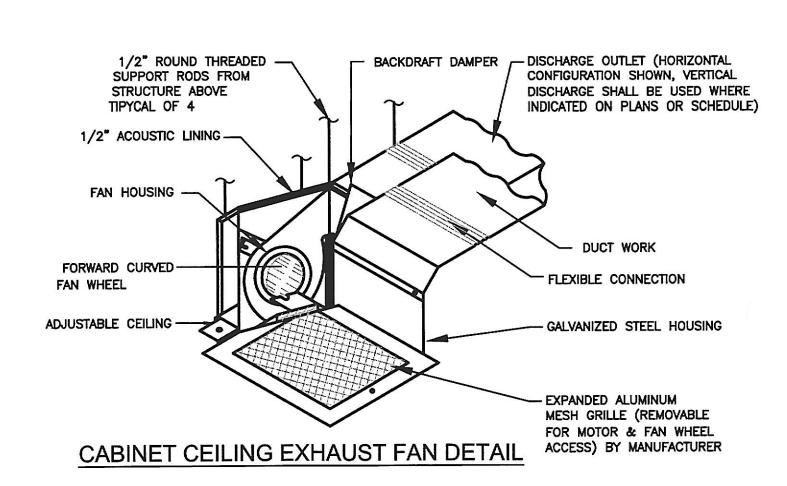

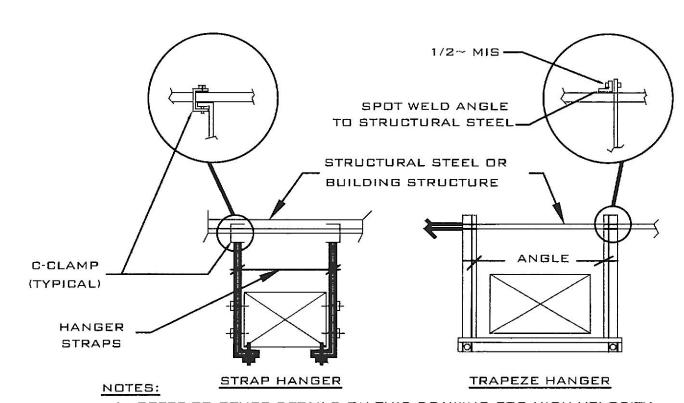


- 1 REFER TO OTHER DETAILS ON THIS DRAWING FOR HIGH VELOCITY DUCTWORK DETAILS AS REQUIRED.
- 2 FOR STRAP AND TRAPEZE HANGER SIZE, REFER TO SMACNA
- 3 NO POP RIVETS ALLOWED, USE SELF-TAPPING SHEETMETAL SCREWS ONLY.


# DUCT HANGER DETAIL (LOW VELOCITY)

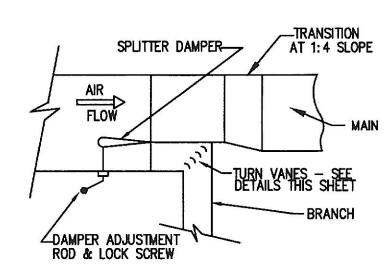

### TYPICAL SPLITTER DAMPER NOT TO SCALE

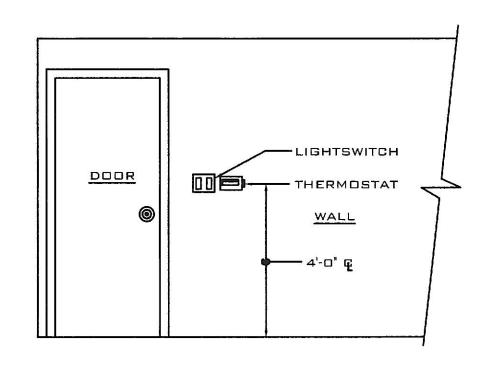


TYP. THERMOSTAT MOUNTING DETAIL

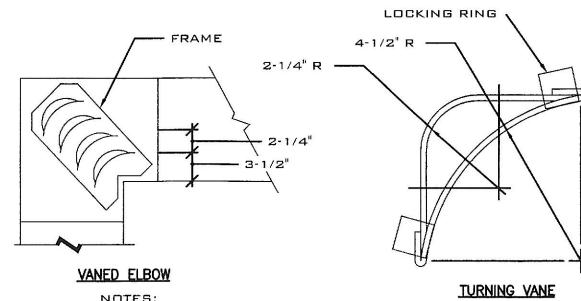

- 1 LOCKING LUGS INTEGRAL WITH VANE.
- 2 MAXIMUM UNSUPPORTED VANE LENGHT 48".
- 3 FRAMES-BOLTED OR RIVETED TO ELBOW. 4 VANES AND FRAMES — SAME GAUGE AS ELBOW.


## DOUBLE THICKNESS TURNING VANES FOR SQUARE ELBOW

NOT TO SCALE

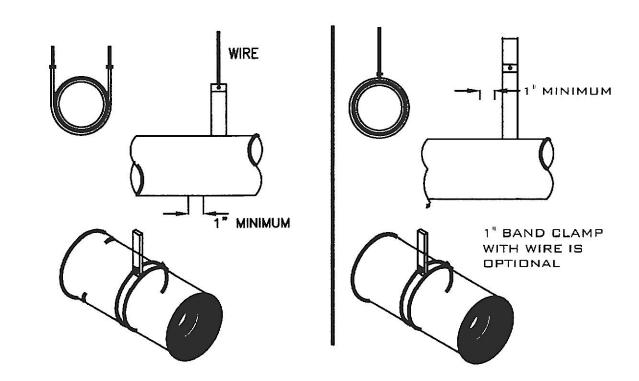



NOTES: SUPPORT SYSTEM MUST NOT DAMAGE DUCT OR CAUSE OUT OF ROUND SHAPE.

### FLEXIBLE DUCT SUPPORT NOT TO SCALE

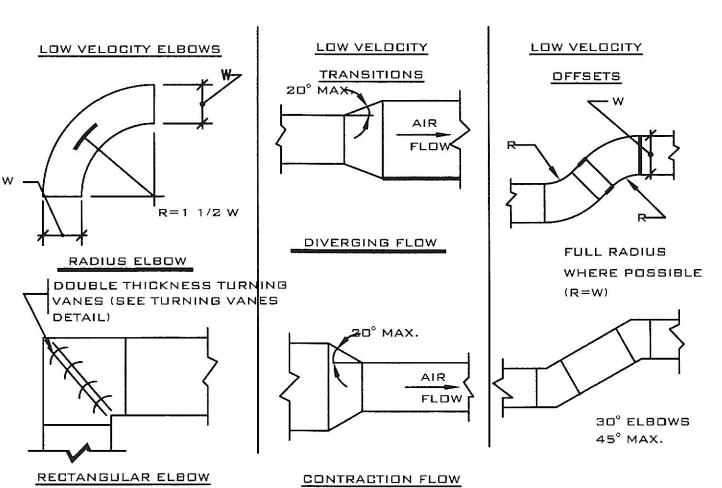

# LOW VELOCITY TRANSITIONS, OFFSETS AND ELBOWS



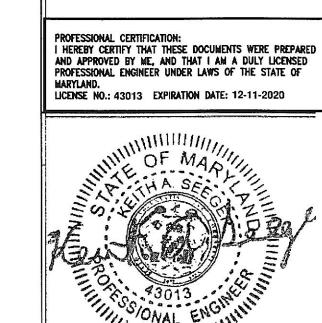

AS NOTED SCALE: DATE: PROJECT NUMBER:

DETAILS



