


NOTES

1. Shaded ductwork this dwg. indicates extent of plaster enclosure around duct providing 2 hr. fire rating. Plastering shall be under Architectural Division of specifications.
2. For exact location of perimeter diffusers see Architectural Drawings.

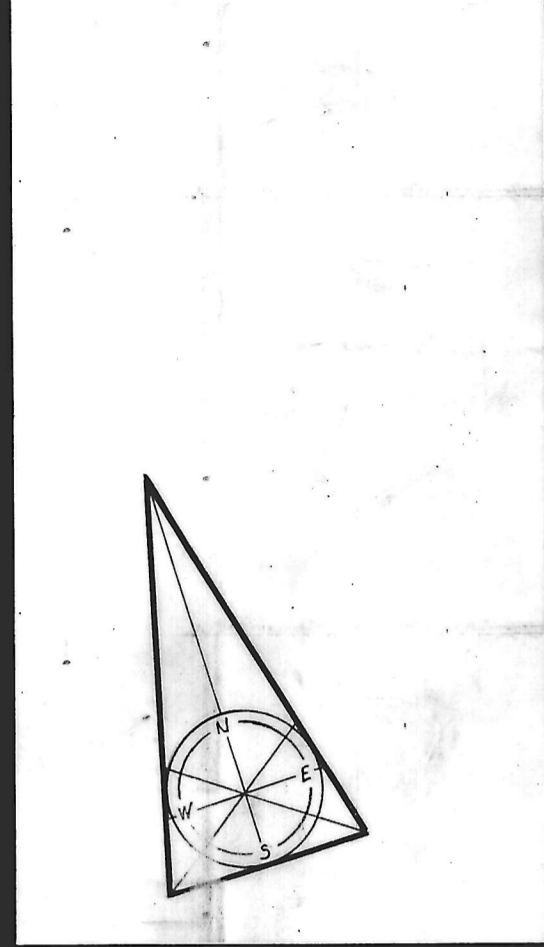

REVISIONS			
NO.	DATE	ITEM	REF.
1	8-15-67	ALEX. BROWN & SONS	▲
2	6-14-68	MERCANTILE TRUST CO.	▲

FIRM: H. ADAMS
 DESIGNED BY: GHZ
 DRAWN BY: ACP
 CHECKED BY: AEW
 APPROVED BY: KVB

STRUCTURAL ENGINEERING
 VAN RENSSLAER P. SAXE
 1701 ST. PAUL ST. BALTO., MD. 21202

MECHANICAL-ELECTRICAL ENGINEERING
 HENRY ADAMS, INC.
 2315 ST. PAUL ST. BALTO., MD. 21216

CHRISTIE, NILES & ANDREWS
 ARCHITECTS
 22 N. CALVERT ST. BALTO., MD. 21202
 1047 31st Street, N.W. Washington, D.C. 20007

OFFICE BUILDING
 FOR
NOTTINGHAM FARMS INC.

102 W. PENNSYLVANIA AVE.
 TOWSON, MARYLAND 21204

FIRST FLOOR PLAN

JOB NO.	6522	M-2
SCALE	AS NOTED	
DATE	SEPT. 27, 1966	
LAST REV.	JUNE 14, 1968	

MICROFILMED