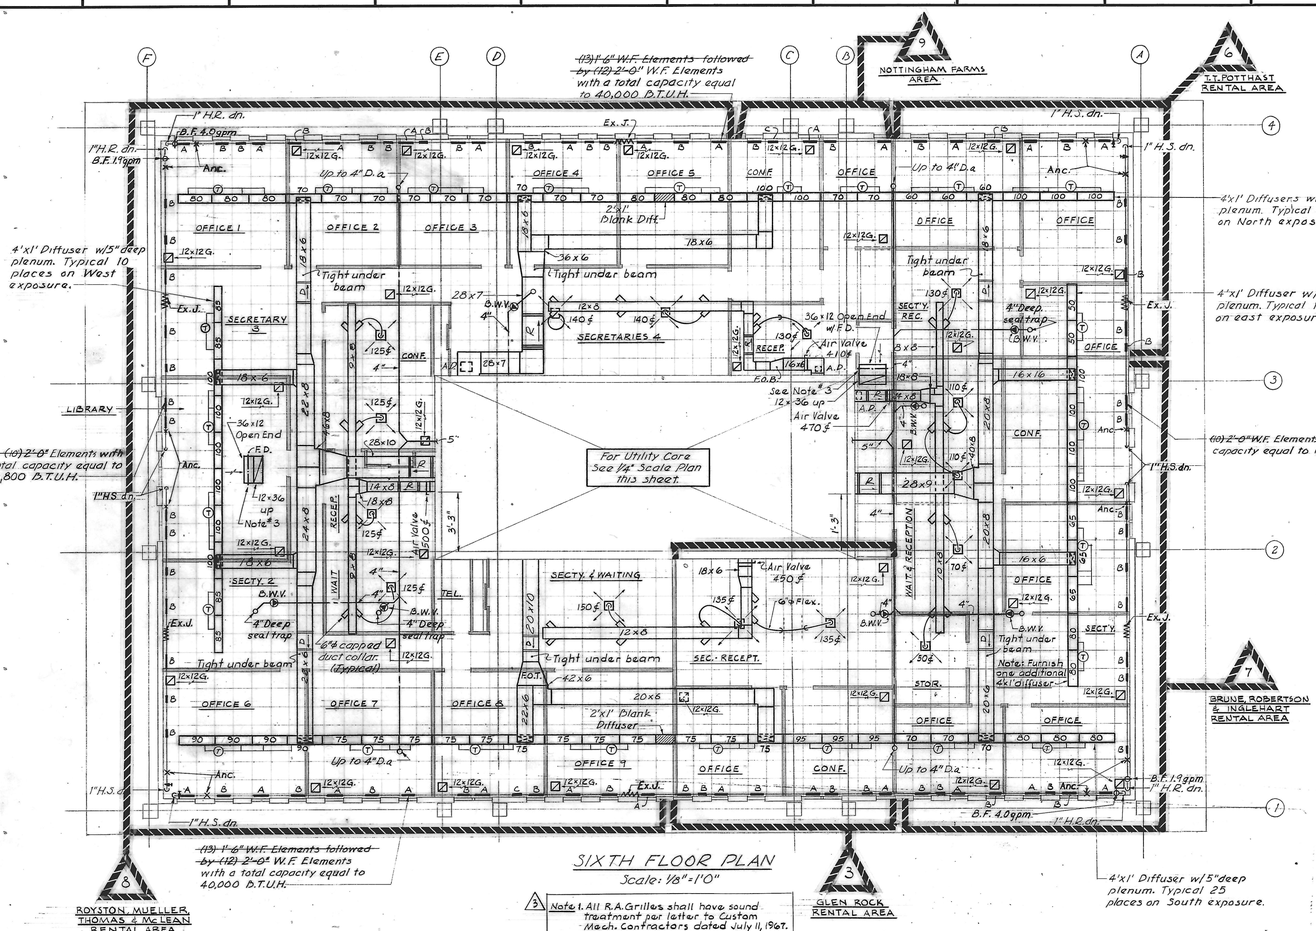

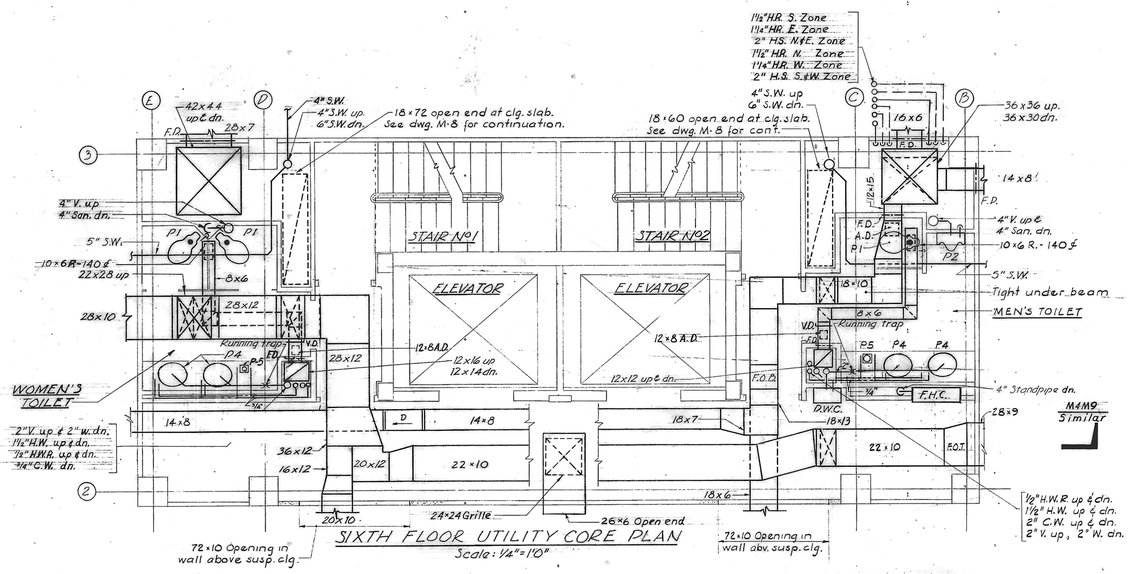

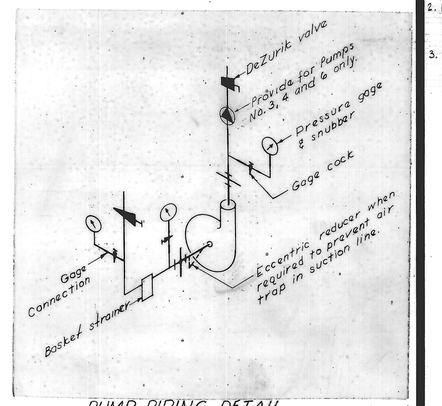

PUMP PIPING DETAIL
No Scale

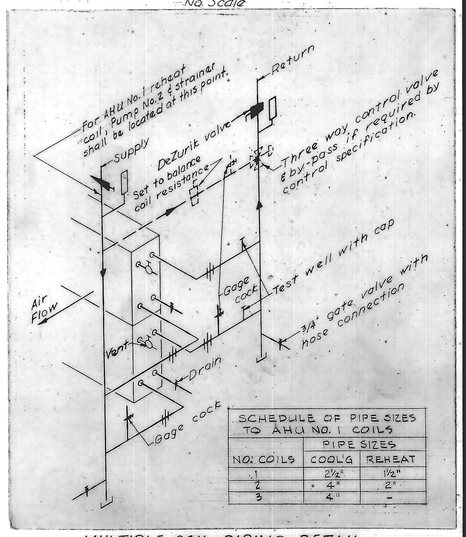

MULTIPLE COIL PIPING DETAIL
No Scale

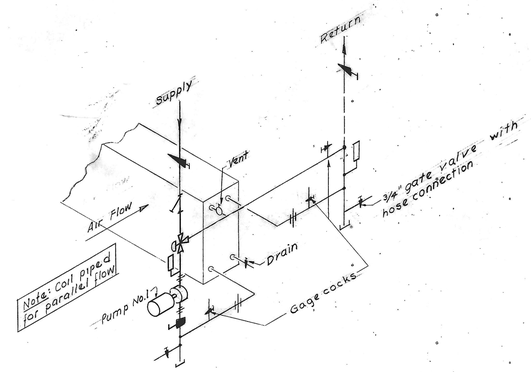

A.H.U. No 1 PREHEAT COIL PIPING DETAIL
Not to Scale

MICROFILMED

NOTES

1. All shaded ductwork this drawing shall be lined with 1" thick acoustic duct lining.
2. For exact location of perimeter Diffusers see Architectural drawings.
3. Duct shall be plastered from clg. slab to F.D., providing 2 Hr. rating, where indicated. Plastering under Arch. Division.

REVISIONS

NO.	DATE	ITEM	REF.
1	9-26-67	GLEN ROCK	3
2	9-29-67	T.T. POTTHAST	4
3	9-29-67	BRUNE, ROBERTSON & INGLEHART	7
4	10-9-67	ROYSTON, MUELLER, THOMAS & McLEAN	8
5	10-11-67	NOTTINGHAM FARMS	9

FIRM H. ADAMS
DESIGNED BY GHZ
DRAWN BY ACP
CHECKED BY AEW
APPROVED BY KVB
SEAL H.A. JOB NO. N-16
STATE OF MARYLAND KENNETH V. ELLIS No. 7376 REGISTERED PROFESSIONAL ENGINEER

CHRISTIE, NILES & ANDREWS ARCHITECTS
27 W. Pennsylvania Ave. Towson, Maryland 21204
1047 31st Street, N.W. Washington, D.C. 20007

OFFICE BUILDING
FOR
NOTTINGHAM FARMS INC.
102 W. PENNSYLVANIA AVE.
TOWSON, MARYLAND 21204

SIXTH FLOOR PLAN

JOB NO.	6522
SCALE	AS NOTED
DATE	SEPT. 27, 1966
LAST REV.	OCT. 11, 1967

M-7