



18076069
REVIEWED FOR COMPLIANCE

Performance of this review does not relieve the applicant from full responsibility to comply with all applicable codes, ordinances and regulations 10/29/18



KEYED PLAN NOTES:

- 1 CONNECT EXIT, NIGHT, AND EMERGENCY LIGHTS UNSWITCHED TO CIRCUIT SERVING LIGHTS IN SAME AREA
- 2 SWITCHBANK LOCATION COORDINATE WITH ARCHITECT
- 3 CEILING/WALL MOUNTED MOTION SENSOR, PROVIDE POWER PACKS WITH WALL MTD. OVERRIDE SWITCH AS REQUIRED. LINK SENSORS TOGETHER TO CONTROL ALL LIGHTS IN SAME AREA. (30 MINUTE DELAY). QUANTITY AND LOCATION TO BE COORDINATED IN FIELD DEPENDING ON MODEL CHOSEN
- 4 NEW WALL MOUNTED VACANCY SWITCH
- 5 CONNECTION FOR HOOD LIGHTS, SEE POWER PLAN, COORDINATE W/ EQUIP
- 6 ALL EXTERIOR LIGHTING TO BE CONTROLLED VIA TIMECLOCK AND PHOTOCELL, (VERIFY)
- 7 RECEPTACLE AT WINDOW, LOCATED EVERY 12' FEET, COORDINATE EXACT LOCATION WITH ARCHITECT
- 8 DASHED LINE INDICATES DAYLIGHTING OPENING, 15" IN TO SPACE) ALL LIGHTING INSIDE AREA TO BE CONTROLLED VIA SEPARATE DAYLIGHTING SENSOR (DS) AND DAYLIGHTING CONTROLLER (DC). OCCUPANCY SENSOR SHALL STILL MAINTAIN AUTOMATIC SHUT OFF
- 9 CONNECTION FOR SIGN, CONTROL VIA TIMECLOCK AND PHOTOCELL, COORDINATE EXACT LOCATION WITH ARCHITECT

LANDLORD NOTES:

- 1: ALL HOME RUNS TO TENANTS PANELS SHALL BE IN EMT.
- 2: ALL EXPOSED WIRING IN CEILINGS OR INTERIOR WALLS SHALL BE IN EMT. ALL WIRING IN LANDLORD DEMISING WALLS MUST BE IN EMT.
- 3: COORDINATE ALL FLOOR CUT MEANS AND METHODS OF ROUTING CONDUIT THROUGH THE FLOOR WITH MALL OPERATIONS.
- 4: NO CONDUIT TO BE SUPPORTED FROM THE ROOF DECK.
- 5: MOUNT ALL PANELS SURFACE MOUNTED ON PLYWOOD BACKERS. DO NOT MOUNT RECESSED WITHIN LANDLORDS DEMISING WALL.

NOTE:
1: CONTRACTOR TO COORDINATE ALL CIRCUITS/ ZONING/ DIMMING W/ ARCHITECT BEFORE PURCHASE AND ROUGH-IN.
2: CEILING AND EQUIPMENT NOT SHOWN FOR CLARITY, COORDINATE WITH ARCHITECTURAL DRAWINGS.
3: EXIT, NIGHT, AND EMERGENCY LIGHTING ARE TO BE PROVIDED AND INSTALLED AS PER LOCAL CODE, COORDINATE WITH ARCHITECT

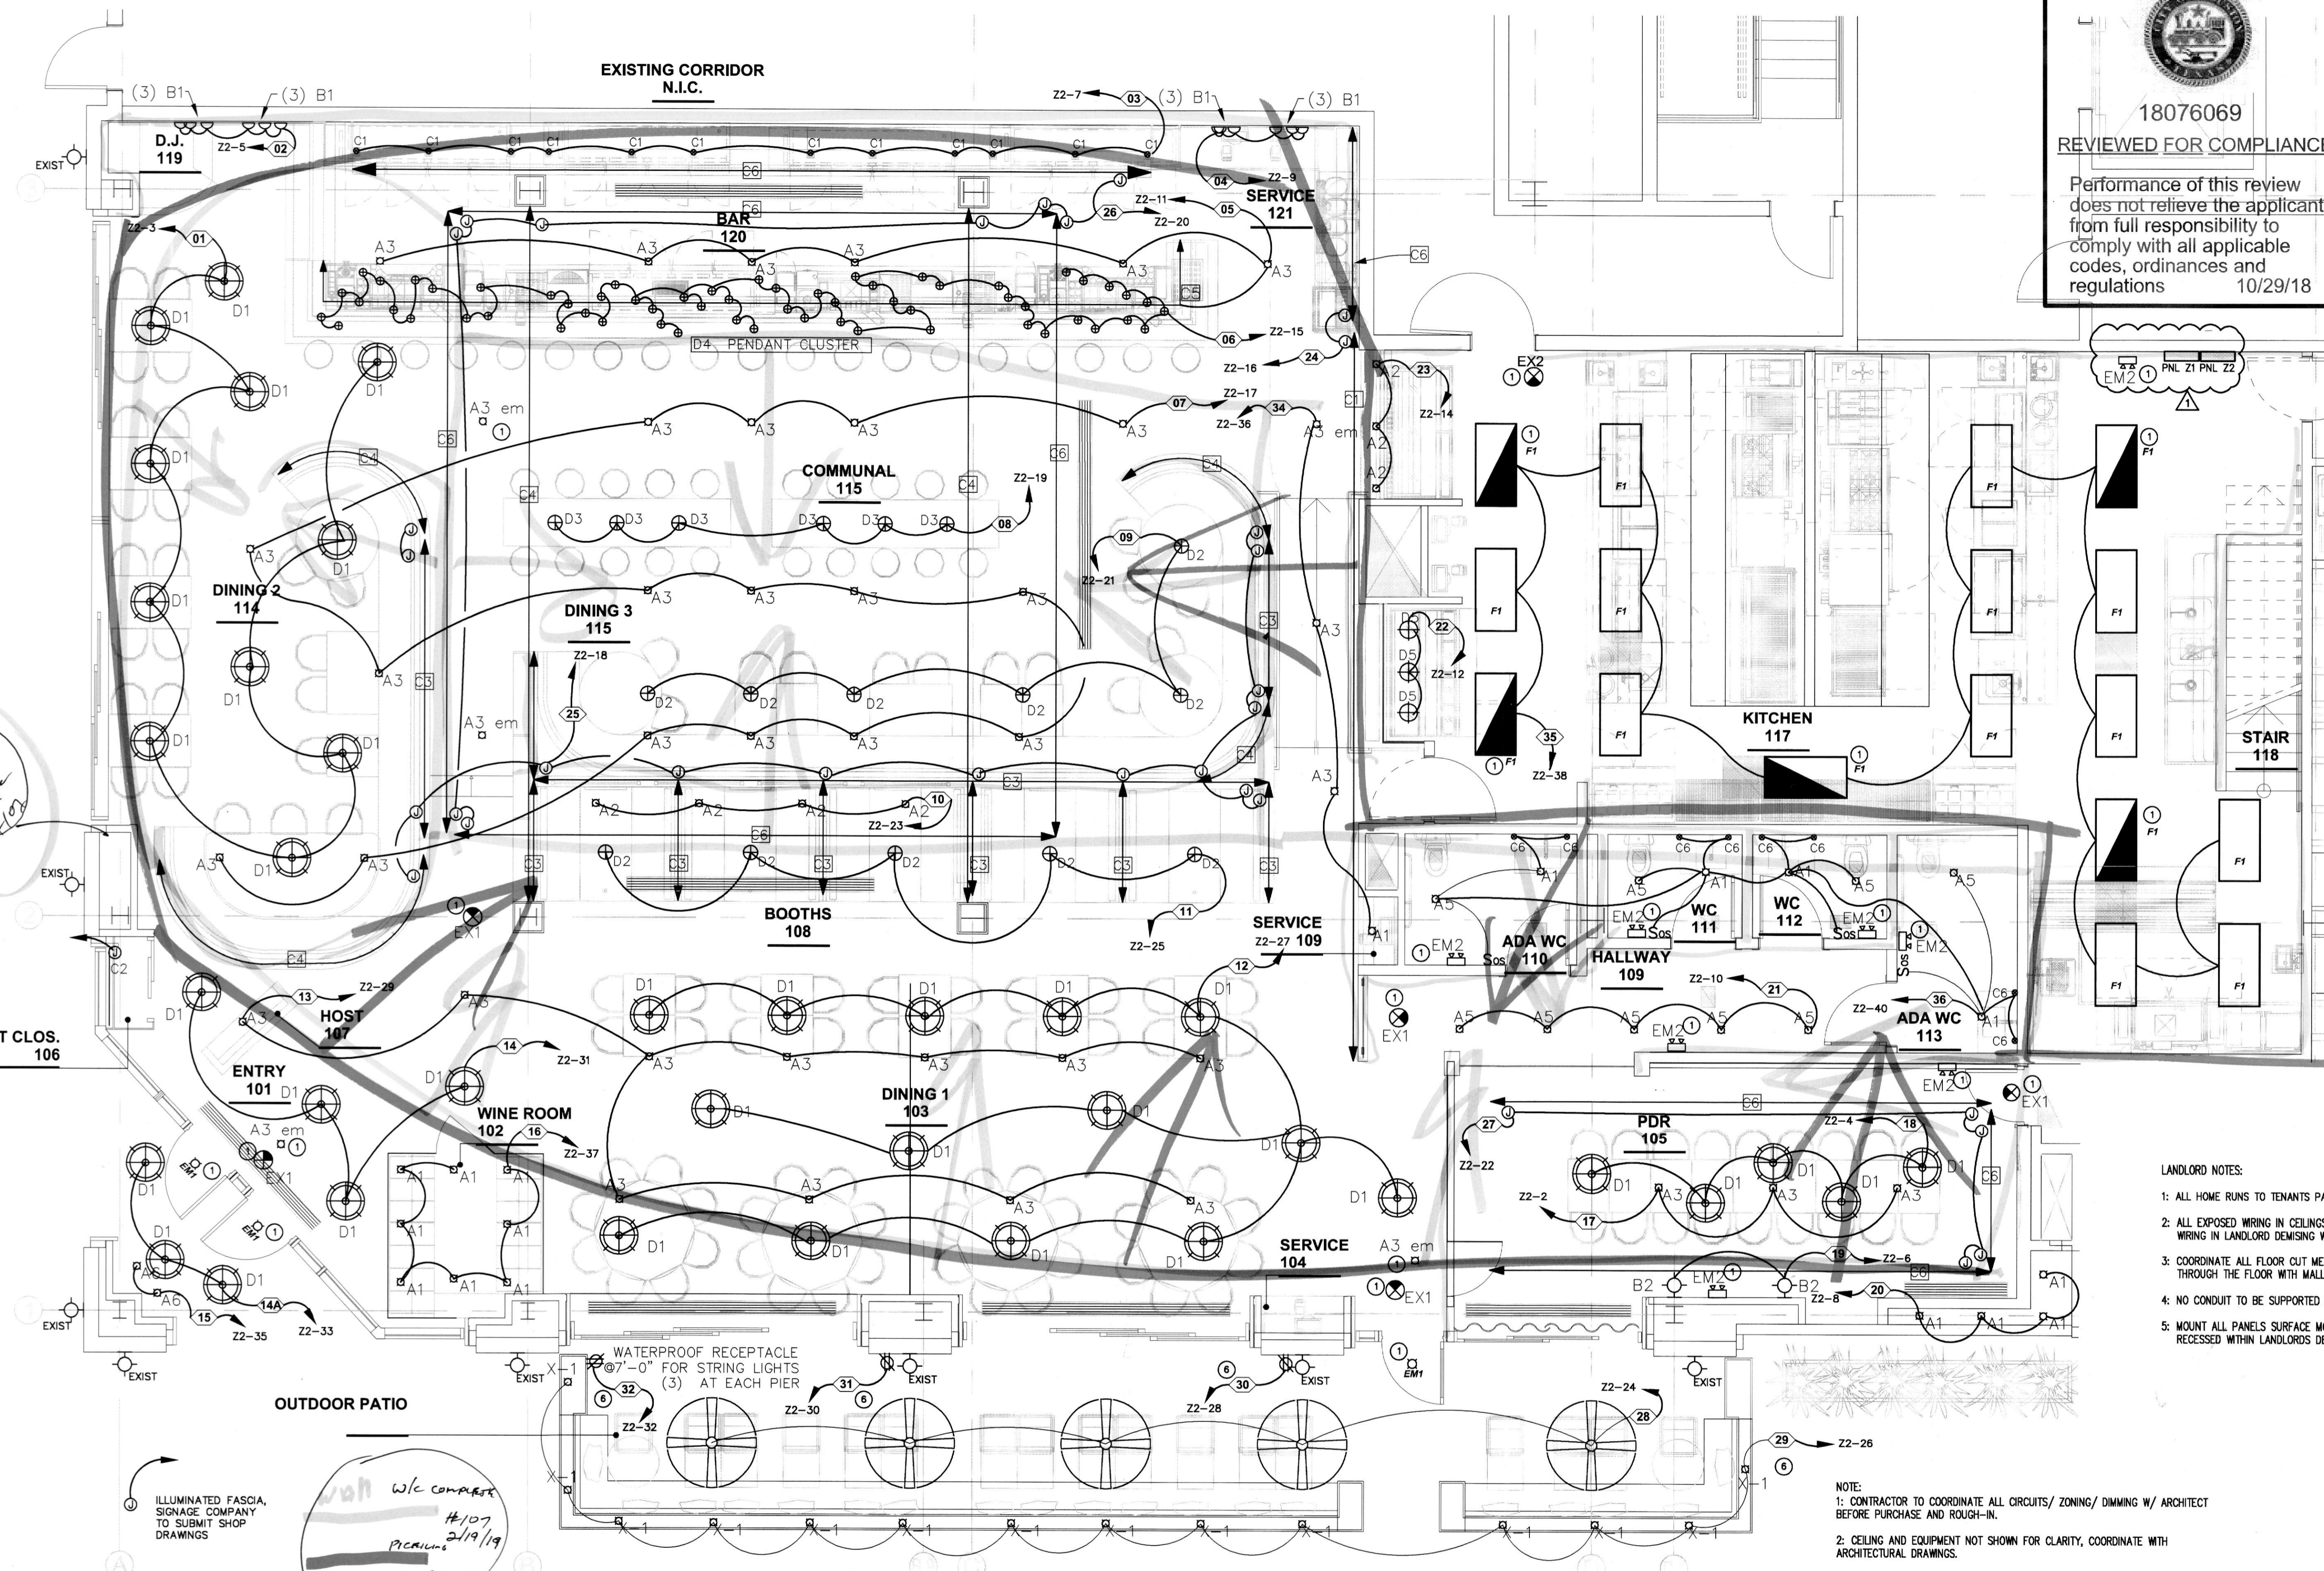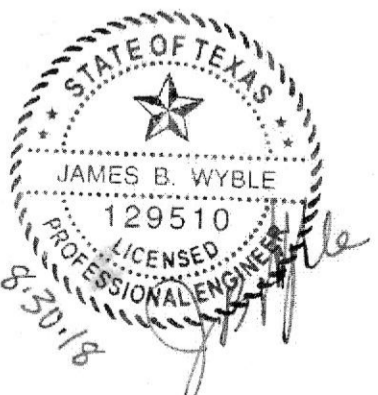

GROUND FLOOR - OUZO BAY - LIGHTING PLAN
SCALE: 1/4" = 1'-0"

P:\Market Projects\Hapstak Demetriou\OUZO HOUSTON 17-6-04-04-01 LIGHTING.dwg, 8/24/2018 11:35:57 AM, DWG TO PDF.PLOT, J.B. Wyble and Associates, P.E.

ARCHITECT HapstakDemetriou + ARCHITECTURE DESIGN 2715 M STREET NW, 4th Floor WASHINGTON, DC 20007 202.333.9038 www.hd-ad.com info@hd-ad.com	CLIENT Alexanader Smith (410) 241-1224 afsmith11@gmail.com STRUCTURAL ENGINEER BEI Structural Engineers 3930 Pender Dr. Suite 175 Fairfax, VA 22030	MEP ENGINEER J.B. Wyble and Associates, P.A. 7950 Norfolk Ave., Bethesda, MD 301-654-1410 FOOD SERVICE CONSULTANT JLA Corp 13031 US Highway 19N, Clearwater, FL 33764 727-470-7862	OUZO BAY/ LOCH BAR HOUSTON 4444 WESTHEIMER RD, HOUSTON, TX 77027 PROJECT NO. JBW17108		I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF TEXAS. P.E. LICENSE #: 129510, EXPIRATION DATE: DECEMBER 31, 2018 FIRM LICENSE #: F19615, EXPIRATION DATE: MARCH 31, 2019	OUZO BAY GROUND FLOOR LIGHTING PLAN E.03																								
			<table border="1"> <tr> <th>REV</th> <th>DATE</th> <th>ISSUED FOR</th> </tr> <tr> <td>05/16/2018</td> <td></td> <td>PROGRESS SET</td> </tr> <tr> <td>06/11/2018</td> <td></td> <td>PERMIT SET</td> </tr> <tr> <td>08/30/2018</td> <td></td> <td>PERMIT COMMENTS</td> </tr> </table>	REV			DATE	ISSUED FOR	05/16/2018		PROGRESS SET	06/11/2018		PERMIT SET	08/30/2018		PERMIT COMMENTS	<table border="1"> <tr> <th>REV</th> <th>DATE</th> <th>ISSUED FOR</th> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </table>	REV	DATE	ISSUED FOR									
			REV	DATE			ISSUED FOR																							
			05/16/2018				PROGRESS SET																							
06/11/2018		PERMIT SET																												
08/30/2018		PERMIT COMMENTS																												
REV	DATE	ISSUED FOR																												