




KEYE

IS:


- ① CONTRACTOR TO COORDINATE ALL CIRCUITS/ZONING/DIMMING W/ ARCHITECT BEFORE PURCHASE AND ROUGH-IN.
- ② CEILING AND EQUIPMENT NOT SHOWN FOR CLARITY, COORDINATE WITH ARCHITECTURAL DRAWINGS.
- ③ EXIT, NIGHT, AND EMERGENCY LIGHTING ARE TO BE PROVIDED AND INSTALLED AS PER LOCAL CODE, COORDINATE WITH ARCHITECT
- ④ ALL EXTERIOR LIGHTING TO BE CONTROLLED VIA TIMECLOCK AND PHOTOCCELL, (VERIFY)
- ⑤ RECEPTACLE AT WINDOW, LOCATED EVERY 12' FEET, COORDINATE EXACT LOCATION WITH ARCHITECT
- ⑥ DASHED LINE INDICATES DAYLIGHTING ZONE (2' TO EITHER SIDE OF OPENING, 15' IN TO SPACE) ALL LIGHTING INSIDE AREA TO BE CONTROLLED VIA SEPARATE DAYLIGHTING SENSOR (DS) AND DAYLIGHTING CONTROLLER (DC), OCCUPANCY SENSOR SHALL STILL MAINTAIN AUTOMATIC SHUT OFF

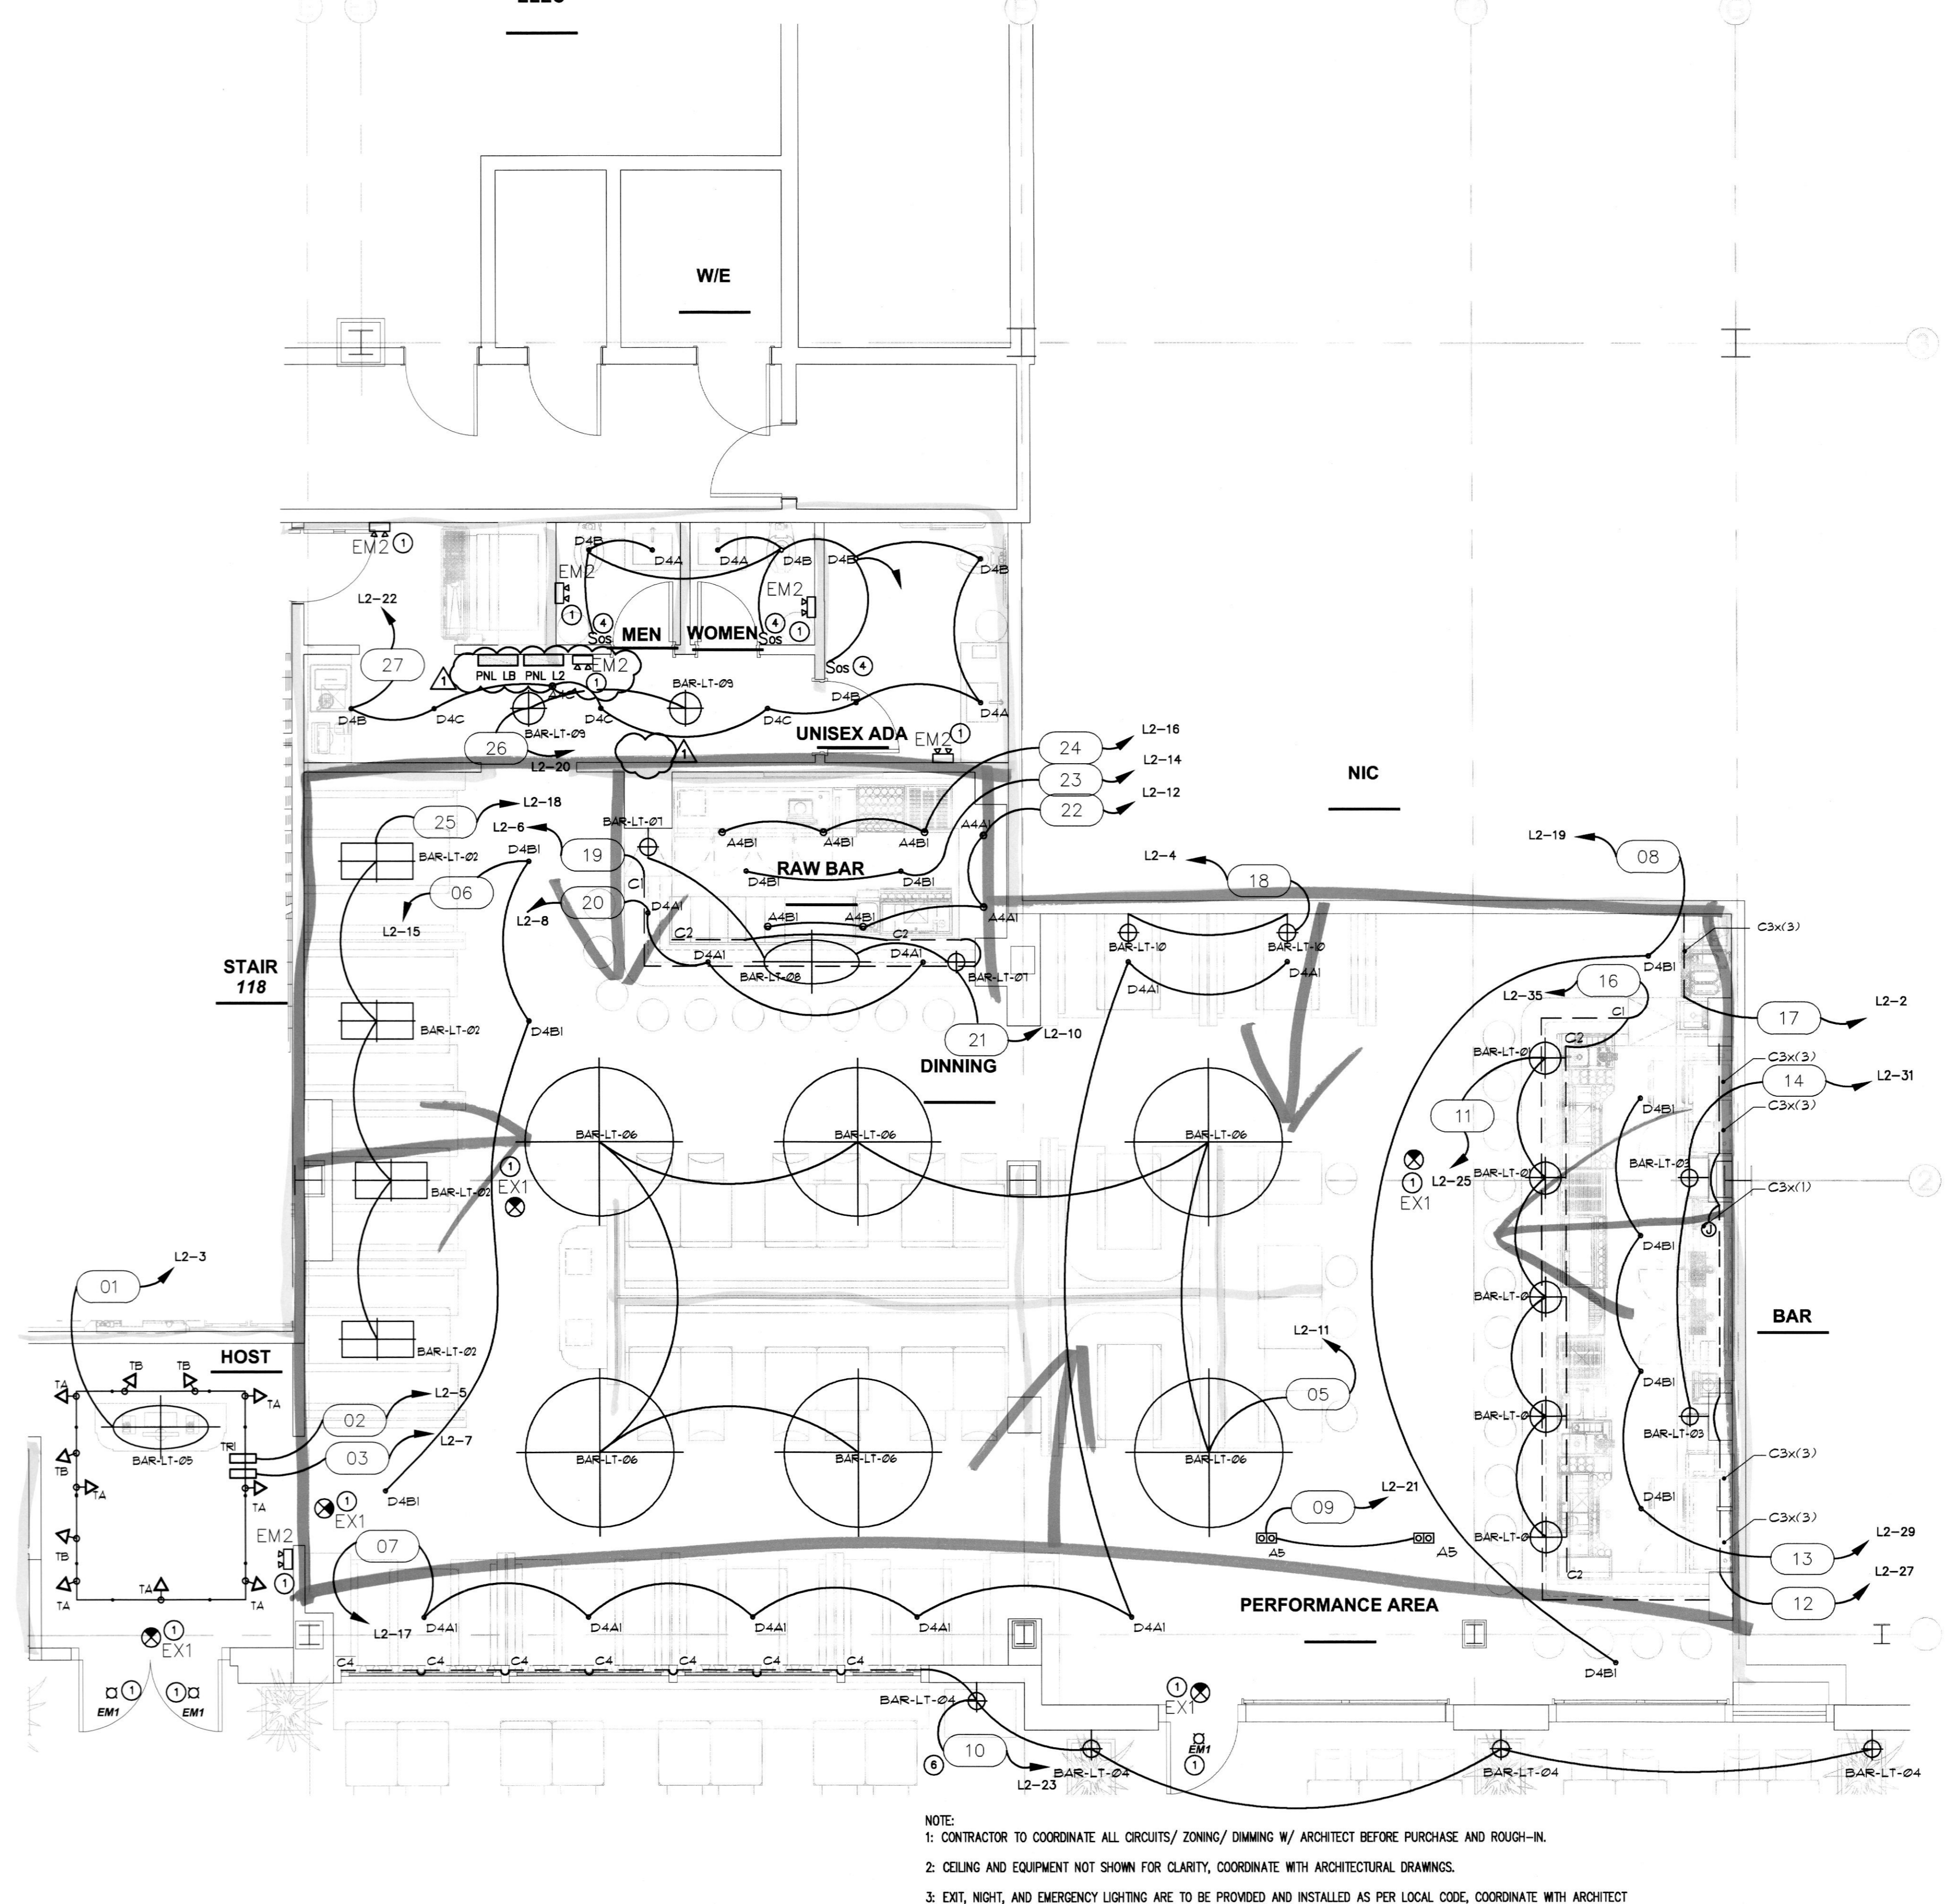

- LANDLORD NOTES:
- 1: ALL HOME RUNS TO TENANTS PANELS SHALL BE IN EMT.
 - 2: ALL EXPOSED WIRING IN CEILINGS OR INTERIOR WALLS SHALL BE IN EMT. ALL WIRING IN LANDLORD DEMISING WALLS MUST BE IN EMT.
 - 3: COORDINATE ALL FLOOR CUT MEANS AND METHODS OF ROUTING CONDUIT THROUGH THE FLOOR WITH MALL OPERATIONS.
 - 4: NO CONDUIT TO BE SUPPORTED FROM THE ROOF DECK.
 - 5: MOUNT ALL PANELS SURFACE MOUNTED ON PLYWOOD BACKERS. DO NOT MOUNT RECESSED WITHIN LANDLORDS DEMISING WALL.

NOTE:
 1: CONTRACTOR TO COORDINATE ALL CIRCUITS/ZONING/DIMMING W/ ARCHITECT BEFORE PURCHASE AND ROUGH-IN.
 2: CEILING AND EQUIPMENT NOT SHOWN FOR CLARITY, COORDINATE WITH ARCHITECTURAL DRAWINGS.
 3: EXIT, NIGHT, AND EMERGENCY LIGHTING ARE TO BE PROVIDED AND INSTALLED AS PER LOCAL CODE, COORDINATE WITH ARCHITECT

1
 E.04 GROUND FLOOR - LOCH BAR - LIGHTING PLAN
 SCALE: 1/4" = 1'-0"

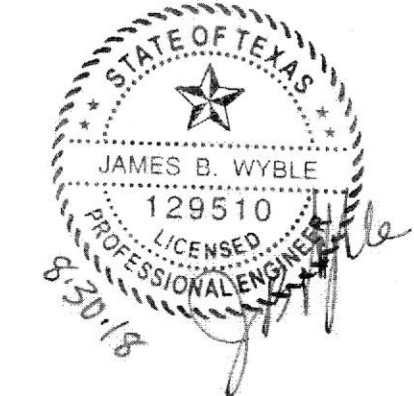

ARCHITECT HapstakDemetriou + ARCHITECTURE DESIGN 2715 M STREET NW, 4th Floor WASHINGTON, DC 20007 202.333.9038 www.hd-ad.com info@hd-ad.com	CLIENT Alexanader Smith (410) 241-1224 afsmith11@gmail.com	MEP ENGINEER J.B. Wyble and Associates, P.A. 7950 Norfolk Ave. , Bethesda, MD 301-654-1410	OUZO BAY/ LOCH BAR HOUSTON 4444 WESTHEIMER RD, HOUSTON, TX 77027 PROJECT NO. JBW17108 I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF TEXAS. PE LICENSE #: 129510, EXPIRATION DATE: DECEMBER 31, 2018 FIRM LICENSE #: F19615, EXPIRATION DATE: MARCH 31, 2019	REV DATE ISSUED FOR 05/16/2018 PROGRESS SET 06/11/2018 PERMIT SET 08/30/2018 PERMIT COMMENTS	REV DATE ISSUED FOR _____ _____ _____	LOCH BAR GROUND FLOOR LIGHTING PLAN E.04
	STRUCTURAL ENGINEER BEI Structural Engineers 3930 Pender Dr. Suite175 Fairfax, VA 22030	FOOD SERVICE CONSULTANT JLA Corp 13031 US Highway 19N, Clearwater, FL 33764 727-470-7862		_____ _____ _____		
	_____ _____ _____	_____ _____ _____		_____ _____ _____		
	_____ _____ _____	_____ _____ _____		_____ _____ _____		

P:\Autocad Projects\HapstakDemetriou\0202018\LOCH BAR LIGHTING.dwg, 07/11/2018 11:40:19 AM, JBM DAVIS TO PDF.pc3, J.B. Wyble and Associates, P.A.