


KEYED PLAN NOTES:

- 1 DUCT SMOKE DETECTORS, COORDINATE WITH MECHANICAL PLANS
- 2 NEW PANEL SEE PANEL SCHEDULE & RISER
- 3 REFER TO KEC AND CAPTIVE AIR DRAWINGS FOR ROUGH-INS AND FINAL CONNECTIONS TO KITCHEN EQUIPMENT AND KITCHEN EXHAUST SYSTEMS
- 4 CONNECTION FOR FIRE SUPPRESSION SYSTEM, COORDINATE WITH HOOD MANUFACTURER, 120 VOLT N.O. MOMENTARY CONTACT MICROSWITCH MOUNTED IN HOOD EXTINGUISHING SYSTEM SUCH THAT OPERATION OF EXTINGUISHING SYSTEM SHALL CAUSE MICROSWITCH TO CLOSE. ACTIVATION OF SUPPRESSION SYSTEM WILL ACTIVATE SHUNT TRIP SYSTEM IN HOOD CONTROL PANEL, AND ANY SHUNT TRIP BREAKERS FOR EQUIPMENT UNDER HOOD TO DISCONNECT ALL POWER TO HOOD AND EQUIPMENT.
- 5 CONNECTION FOR HOOD LIGHTS, COORDINATE WITH HOOD DRAWINGS
- 6 PROVIDE ISOLATED GROUND AND COORDINATE REQUIREMENTS FOR POS WITH POS SYSTEM PROVIDER, REFER TO POS SYSTEM SCHEMATIC E110.
- 7 FIRE SUPPRESSION PULL STATION TO BE LOCATED MINIMUM 10' & MAXIMUM OF 20' FROM HOOD ALONG PATH OF EGRESS
- 8 SHOW WINDOW RECEPTACLE MOUNTED ABOVE WINDOWS, LOCATE EVERY 12', COORDINATE WITH ARCHITECT
- 9 WSH-P-6
MCA 11.8, MOCP 15A
PROVIDE 3P-30A FSS (WP) FUSE AT 15A
ALL 480V, 3Ø
#12 CONDUCTORS
- 10 WSH-P-7
MCA 11.8, MOCP 15A
PROVIDE 3P-30A FSS (WP) FUSE AT 15A
ALL 480V, 3Ø
#12 CONDUCTORS

- LANDLORD NOTES:**
- 1: ALL HOME RUNS TO TENANTS PANELS SHALL BE IN EMT.
 - 2: ALL EXPOSED WIRING IN CEILINGS OR INTERIOR WALLS SHALL BE IN EMT. ALL WIRING IN LANDLORD DEMISING WALLS MUST BE IN EMT.
 - 3: COORDINATE ALL FLOOR CUT MEANS AND METHODS OF ROUTING CONDUIT THROUGH THE FLOOR WITH WALL OPERATIONS.
 - 4: NO CONDUIT TO BE SUPPORTED FROM THE ROOF DECK.
 - 5: MOUNT ALL PANELS SURFACE MOUNTED ON PLYWOOD BACKERS. DO NOT MOUNT RECESSED WITHIN LANDLORDS DEMISING WALL.

COORDINATE EXACT LOCATION OF RECEPTACLES FOR ALL KITCHEN EQUIPMENT WITH KITCHEN EQUIPMENT SUPPLIER DRAWINGS

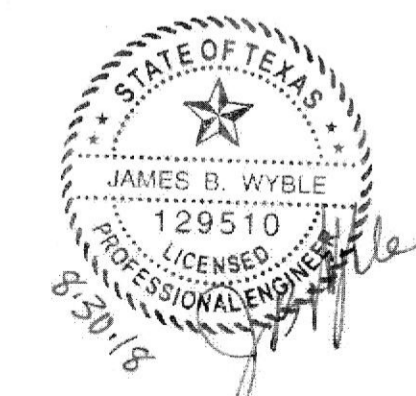

1 GROUND FLOOR - OUZO BAY - POWER PLAN
 E.05 SCALE: 1/4" = 1'-0"

ARCHITECT
 HapstakDemetriou +
 ARCHITECTURE | DESIGN
 2715 M STREET NW, 4th Floor
 WASHINGTON, DC 20007
 202.333.9038
 www.hd-ad.com info@hd-ad.com

CLIENT
 Alexander Smith
 (410) 241-1224
 a smith11@gmail.com

STRUCTURAL ENGINEER
 BEI Structural Engineers
 3930 Pender Dr. Suite 175
 Fairfax, VA 22030

MEP ENGINEER
 J.B. Wyble and Associates, P.A.
 7950 Norfolk Ave., Bethesda, MD
 301-654-1410

FOOD SERVICE CONSULTANT
 JLA Corp
 13031 US Highway 19N, Clearwater, FL 33764
 727-470-7862

OUZO BAY/ LOCH BAR HOUSTON
 4444 WESTHEIMER RD, HOUSTON, TX 77027
PROJECT NO. JBW17108

 I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF TEXAS.
 PE LICENSE #: 129510, EXPIRATION DATE: DECEMBER 31, 2018
 FIRM LICENSE #: F19615, EXPIRATION DATE: MARCH 31, 2019

| REV | DATE | ISSUED FOR | REV | DATE | ISSUED FOR |
|-----|------------|-----------------|-----|------|------------|
| | 05/16/2018 | PROGRESS SET | | | |
| | 06/11/2018 | PERMIT SET | | | |
| | 08/30/2018 | PERMIT COMMENTS | | | |

OUZO BAY GROUND FLOOR POWER PLAN
E.05

P:\Mutual Projects\Hapstak_Demetriou\OUZO HOUSTON 171-08-05-06 020 POWER.dwg, 04/24/2018, 11:36:05 AM, JBW DWG TO PDF.plt, 1/8, WYBLE and Associates, R18