


Performance of this review does not relieve the applicant from full responsibility to comply with all applicable codes, ordinances and regulations 10/29/18



ROOF PLAN NOTES:

- PROVIDE A "FS." BOX MOUNTED ON A STUBBED-UP RIGID CONDUIT WITH A DUPLEX GROUNG FAULT INTERRUPTER RECEPTACLE UNDER A (WP) COVER. PROVIDE A STONCO #150-L W (1) 150 WATT PAR-38 LAMP. PROVIDE A SWITCH WITH (WP) COVER LOCATED AT ROOF ACCESS. THE EXACT NUMBER OF DEVICES SHALL BE AS REQUIRED TO PROPERLY SERVE EQUIPMENT AS DETERMINED BY LOCAL CODE ENFORCING AUTHORITIES.
- PROVIDE AND INSTALL ALL HVAC EQUIPMENT OVERCURRENT PROTECTIVE DEVICES AS REQUIRED. FUSE OR CIRCUIT BREAKER SIZES ARE TO BE AS PER MANUFACTURER'S REQUIREMENTS, COORDINATE WITH EQUIPMENT, DO NOT CHANGE SIZE OF PROTECTIVE
- 3 LOCATE ALL HVAC EQUIPMENT DISCONNECT/ SAFETY SWITCHES AS PER N.E.C. AND SO AS TO NOT INTERFERE WITH AND/ OR OBSTRUCT NORMAL DAY TO DAY OPERATION OR UNSCHEDULED MAINTENANCE.
- 4 ALL EQUIPMENT ON EXTERIOR OF BUILDING SHALL BE WEATHERPROOF

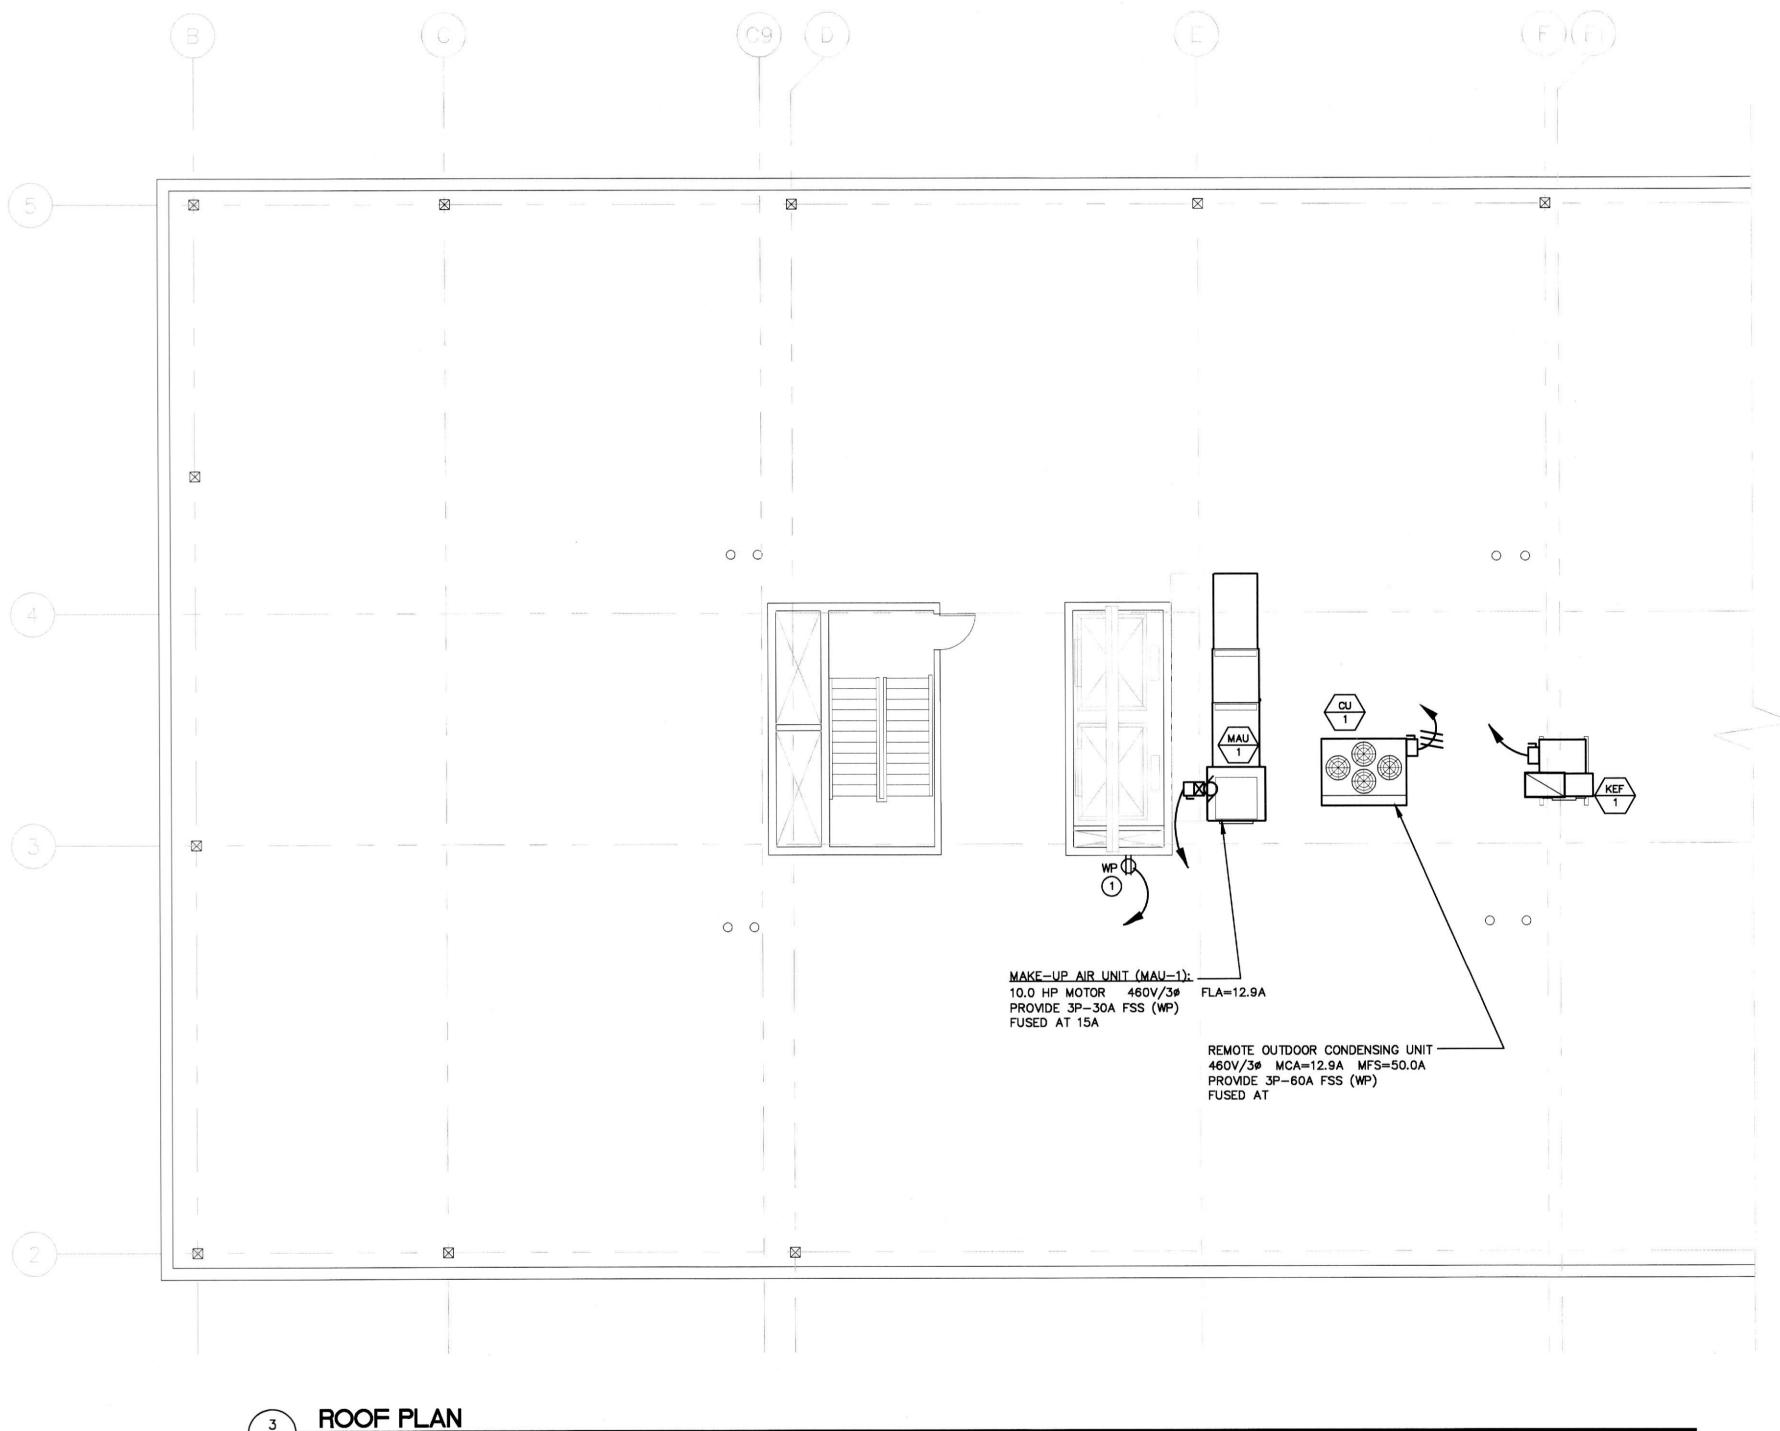

ARCHITECT

HapstakDemetriou +

ARCHITECTURE | DESIGN
2715 M STREET NW, 4th Floor
WASHINGTON, DC 20007
202.333.9038

www.hd-ad.com info@hd-ad.com

CLIENT

Alexanader Smith (410) 241-1224 afsmith11@gmail.com

STRUCTURAL ENGINEER BEI Structural Engineers 3930 Pender Dr. Suite175 Fairfax, VA 22030 MEP ENGINEER
J.B. Wyble and Associates, P.A.
7950 Norfolk Ave., Bethesda, MD
301-654-1410

FUDD SERVICE CONSULTANT JLA Corp 13031 US Highway 19N,Clearwater, FL 33764 727-470-7862

OUZO BAY/ LOCH BAR HOUSTON

4444 WESTHEIMER RD, HOUSTON, TX 77027

PROJECT NO. JBW17108

I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF TEXAS.

PE. LICENSE #: 129510, EXPIRATION DATE: DECEMBER 31, 2018 FIRM LICENSE #: F19615, EXPIRATION DATE: MARCH 31, 2019

REV DATE	ISSUED FOR	REV DATE ISSUED FOR	OUZO BAY/ LOCH E
05/16/2018	PROGRESS SET		ROOF PLAN
06/11/2018	PERMIT SET		

E.09