
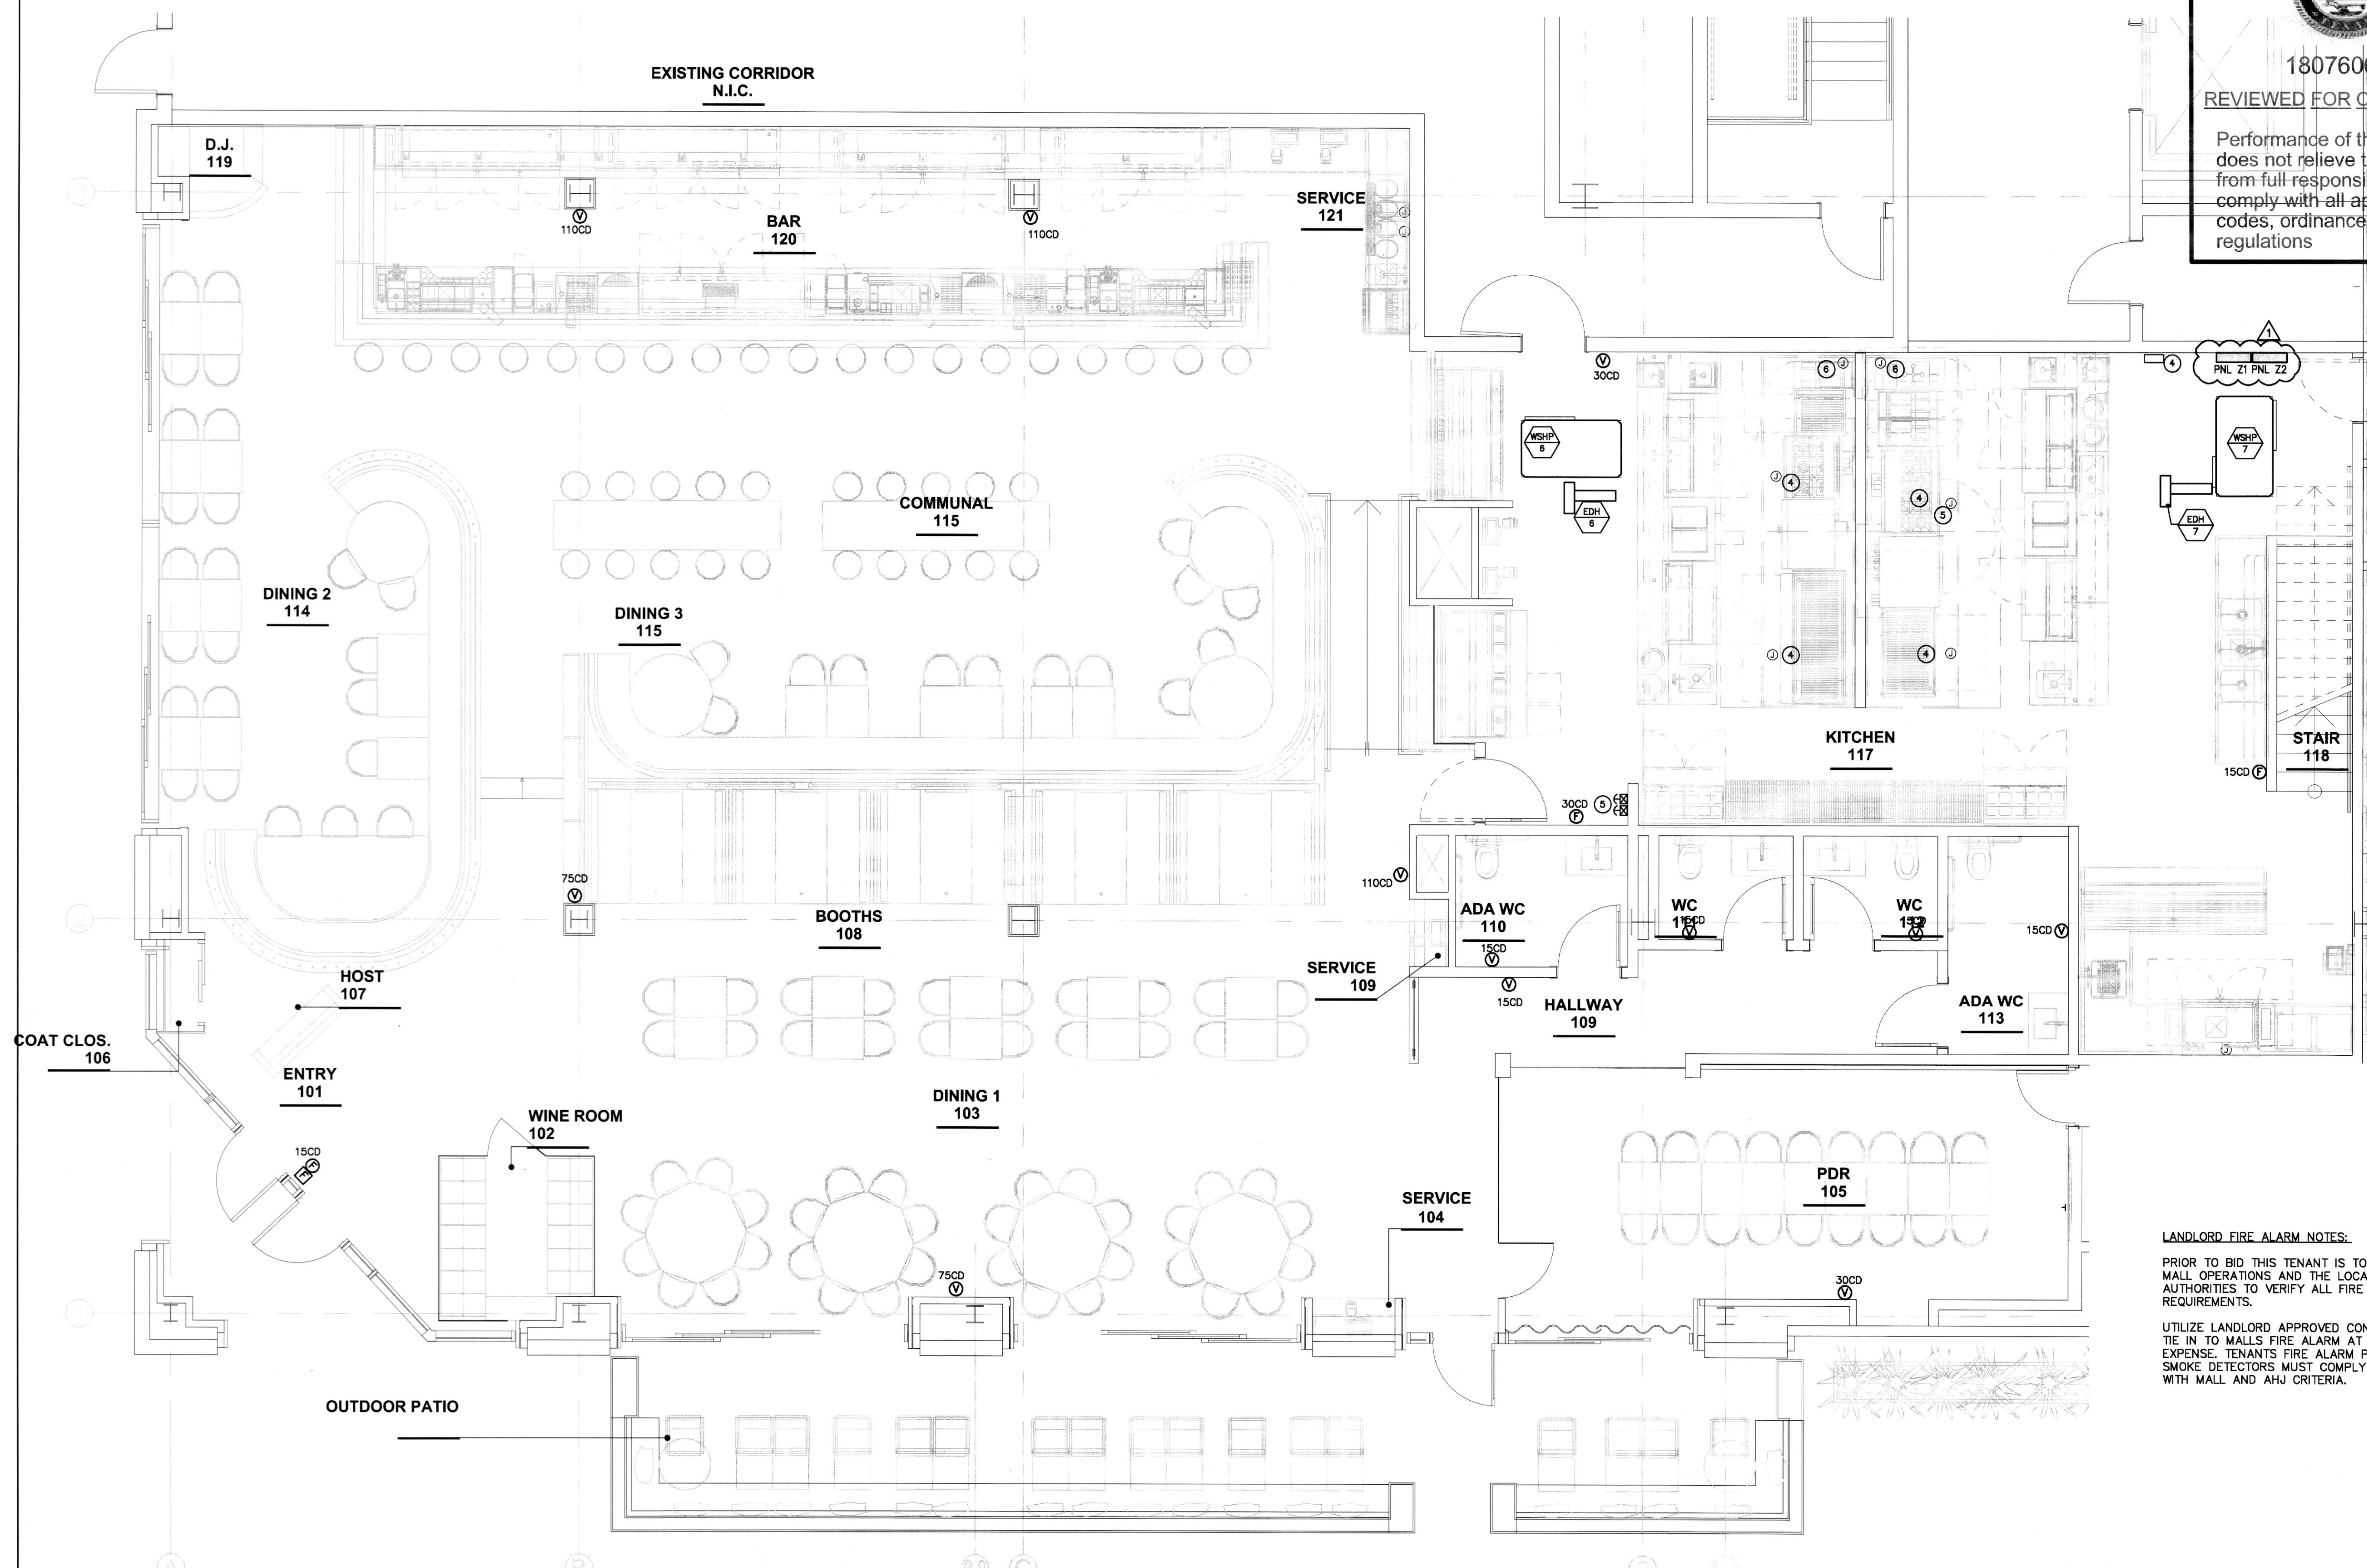


City of Houston Texas



18076069
REVIEWED FOR COMPLIANCE

Performance of this review does not relieve the applicant from full responsibility to comply with all applicable codes, ordinances and regulations 10/29/18



- KEYED PLAN NOTES:**
- DUCT SMOKE DETECTORS, COORDINATE WITH MECHANICAL PLANS
 - FA CONTRACTOR SHALL PROVIDE NEW FA EXTENDER PANEL AND INTERCONNECT WITH BUILDING FIRE ALARM SYSTEM.
 - REFER TO KEC AND CAPTIVE AIR DRAWINGS FOR ROUGH-INS AND FINAL CONNECTIONS TO KITCHEN EQUIPMENT AND KITCHEN EXHAUST SYSTEMS
 - CONNECTION FOR FIRE SUPPRESSION SYSTEM, COORDINATE WITH HOOD MANUFACTURER, 120 VOLT N.O. MOMENTARY CONTACT MICROSWITCH MOUNTED IN HOOD EXTINGUISHING SYSTEM SUCH THAT OPERATION OF EXTINGUISHING SYSTEM SHALL CAUSE MICROSWITCH TO CLOSE. ACTIVATION OF SUPPRESSION SYSTEM WILL ACTIVATE SHUNT TRIP SYSTEM IN HOOD CONTROL PANEL, GAS SOLENOID VALVE(S), AND ANY SHUNT TRIP BREAKERS FOR EQUIPMENT UNDER HOOD TO DISCONNECT ALL POWER TO HOOD AND EQUIPMENT.
 - FIRE SUPPRESSION PULL STATION TO BE LOCATED MINIMUM 10' & MAXIMUM OF 20' FROM HOOD ALONG PATH OF EGRESS
 - GAS SOLENOID VALVE, COORDINATE WITH PLUMBING PLANS AND FIRE SUPPRESSION SYSTEM

LANDLORD FIRE ALARM NOTES:

PRIOR TO BID THIS TENANT IS TO CONTACT MALL OPERATIONS AND THE LOCAL AUTHORITIES TO VERIFY ALL FIRE ALARM REQUIREMENTS.

UTILIZE LANDLORD APPROVED CONTRACTOR TO TIE IN TO MALLS FIRE ALARM AT TENANTS EXPENSE. TENANTS FIRE ALARM PANEL AND SMOKE DETECTORS MUST COMPLY WITH COMPLY WITH MALL AND AHJ CRITERIA.



1
F.02
GROUND FLOOR - OUZO BAY - FIRE ALARM PLAN
SCALE: 1/4" = 1'-0"

<p>ARCHITECT HapstakDemetriou + ARCHITECTURE DESIGN 2715 M STREET NW, 4th Floor WASHINGTON, DC 20007 202.333.9038 www.hd-ad.com info@hd-ad.com</p>	<p>CLIENT Alexander Smith (410) 241-1224 afsmith11@gmail.com</p> <p>STRUCTURAL ENGINEER BEI Structural Engineers 3930 Pender Dr. Suite175 Fairfax, VA 22030</p>	<p>MEP ENGINEER J.B. Wyble and Associates, P.A. 7950 Norfolk Ave., Bethesda, MD 301-654-1410</p> <p>FOOD SERVICE CONSULTANT JLA Corp 13031 US Highway 19N, Clearwater, FL 33764 727-470-7862</p>	<p>OUZO BAY/ LOCH BAR HOUSTON 4444 WESTHEIMER RD, HOUSTON, TX 77027</p> <p>PROJECT NO. JBW17108</p> <p>I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF TEXAS. P.E. LICENSE #: 129510, EXPIRATION DATE: DECEMBER 31, 2018 FIRM LICENSE #: F19615, EXPIRATION DATE: MARCH 31, 2019</p>	<table border="1"> <thead> <tr> <th>REV</th> <th>DATE</th> <th>ISSUED FOR</th> </tr> </thead> <tbody> <tr> <td>05/16/2018</td> <td>PROGRESS SET</td> <td></td> </tr> <tr> <td>06/11/2018</td> <td>PERMIT SET</td> <td></td> </tr> <tr> <td>08/30/2018</td> <td>PERMIT COMMENTS</td> <td></td> </tr> </tbody> </table>	REV	DATE	ISSUED FOR	05/16/2018	PROGRESS SET		06/11/2018	PERMIT SET		08/30/2018	PERMIT COMMENTS		<table border="1"> <thead> <tr> <th>REV</th> <th>DATE</th> <th>ISSUED FOR</th> </tr> </thead> <tbody> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> </tbody> </table>	REV	DATE	ISSUED FOR																															<p>OUZO BAY GROUND FLOOR FIRE ALARM PLAN</p> <p>F.02</p>
REV	DATE	ISSUED FOR																																																	
05/16/2018	PROGRESS SET																																																		
06/11/2018	PERMIT SET																																																		
08/30/2018	PERMIT COMMENTS																																																		
REV	DATE	ISSUED FOR																																																	