




18076069

REVIEWED FOR COMPLIANCE

Performance of this review does not relieve the applicant from full responsibility to comply with all applicable codes, ordinances and regulations 10/29/18

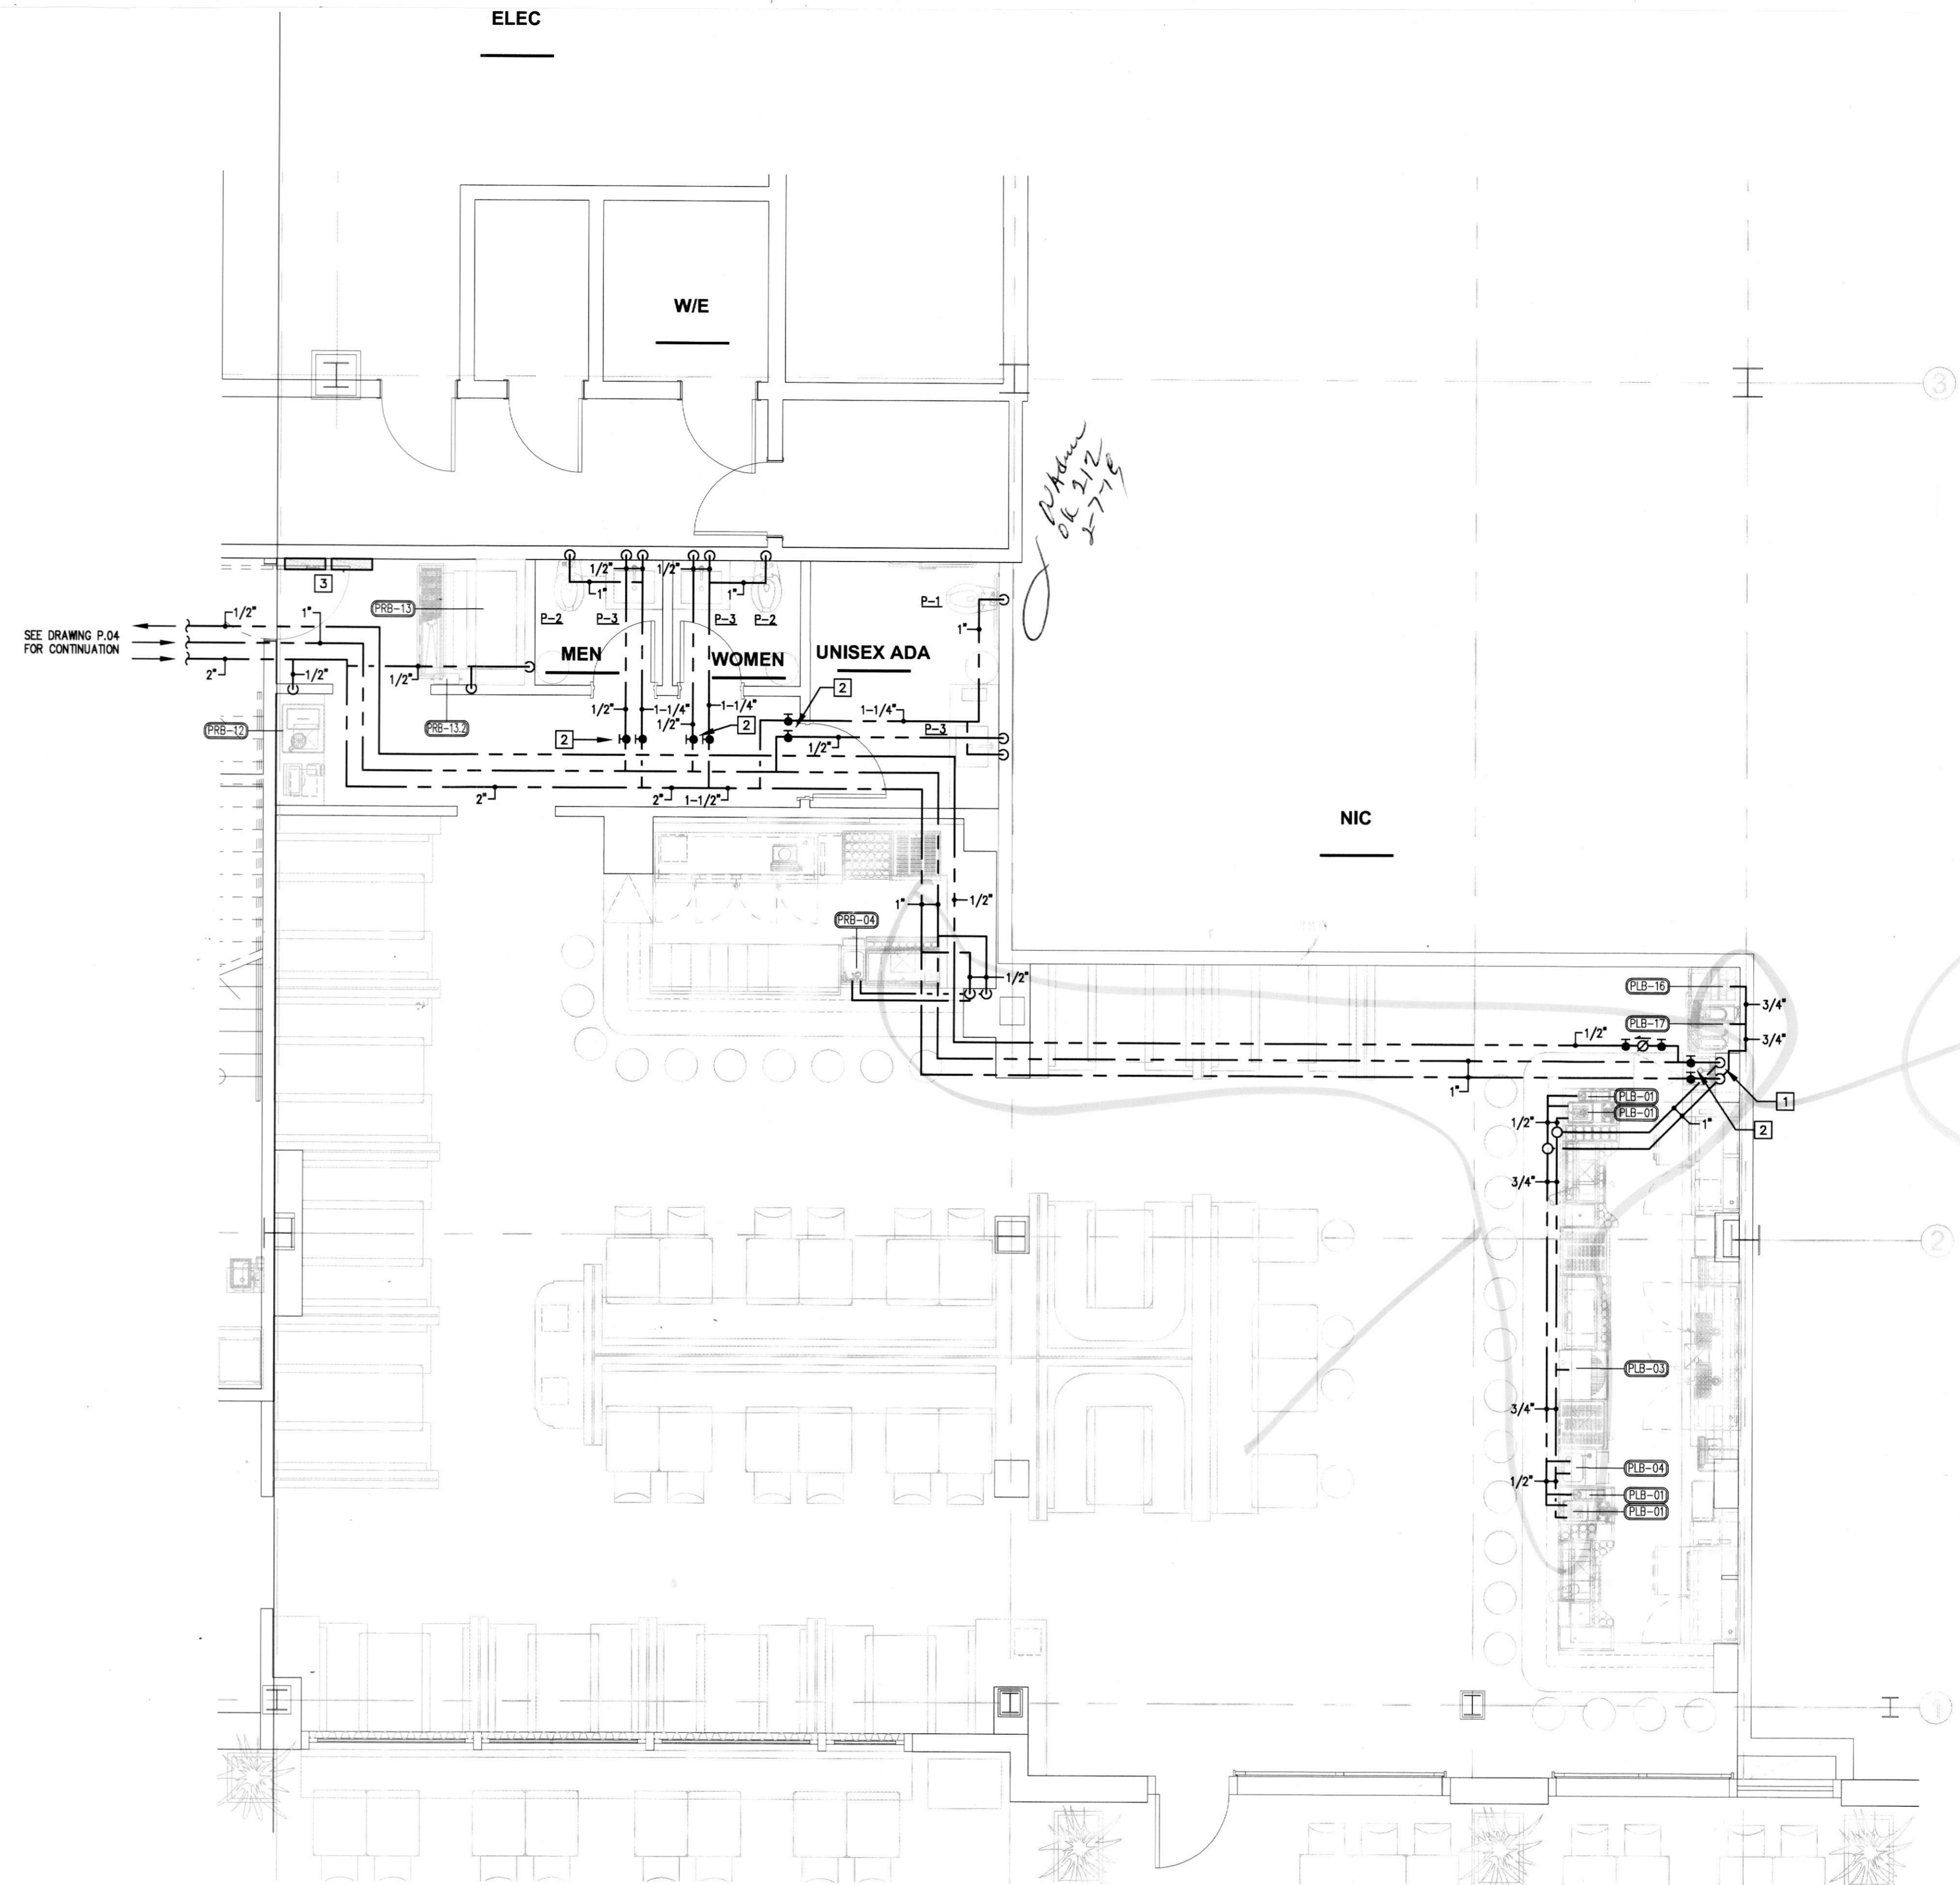

Handwritten notes:
 P.06
 12-28-18

DRAWING REFERENCE NOTES:

- 1 1" H&CW DN BELOW FLOOR AND UP UNDER THE COUNTER TO BAR EQUIPMENT. RUN PIPES BELOW FLOOR INSIDE PVC SLEEVE. SEE WATER RISER DIAGRAM FOR MORE DETAIL AND PIPE SIZES.
- 2 CONTRACTOR SHALL LOCATE SHUT-OFF VALVES IN AN EASILY ACCESSIBLE LOCATION ABOVE THE CEILING, NO HIGHER THAN 2'-0" ABOVE THE CEILING.
- 3 MAINTAIN MIN 3'-0" (FRONT) AND 15" (SIDE) CLEARANCE FOR ALL PIPES FROM ELECTRIC PANELS IF POSSIBLE. IN CASE THAT SOME PIPES MUST CROSS PANELS SEE GENERAL NOTE.

GENERAL NOTE:

PROVIDE GALVANIZED 2" DEEP SAFE PANS UNDER ALL PARTS OF PIPES THAT ARE CROSSING OVER ELECTRICAL PANELS AND TRANSFORMER. PROVIDE WATER DETECTION DEVICES IN SAFE PANS WITH LOCAL ALARM AND/OR RUN DRAIN LINE DOWN FROM SAFE PANS TO CLOSEST FLOOR SINK.

1 WATER AND GAS PLUMBING PLAN - GROUND FLOOR - LOCH BAR
 P.06 SCALE: 1/4" = 1'-0"

HEALTH



<p>ARCHITECT HapstakDemetriou + ARCHITECTURE DESIGN 2715 M STREET NW, 4th Floor WASHINGTON, DC 20007 202.333.9038 www.hd-ad.com info@hd-ad.com</p>	<p>CLIENT Alexanader Smith (410) 241-1224 afsmith11@gmail.com</p> <p>STRUCTURAL ENGINEER BEI Structural Engineers 3930 Pender Dr. Suite175 Fairfax, VA 22030</p>	<p>MEP ENGINEER J.B. Wyble and Associates, P.A. 7950 Norfolk Ave., Bethesda, MD 301-654-1410</p> <p>FOOD SERVICE CONSULTANT JLA Corp 13031 US Highway 19N, Clearwater, FL 33764 727-470-7862</p>	<p>OUZO BAY/ LOCH BAR HOUSTON 4444 WESTHEIMER RD, HOUSTON, TX 77027</p> <p>PROJECT NO. JBW17108</p> <p>I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF TEXAS. PE, LICENSE #: 129510, EXPIRATION DATE: DECEMBER 31, 2018 FIRM LICENSE #: F19615, EXPIRATION DATE: MARCH 31, 2019</p>	<p>REV DATE ISSUED FOR</p> <p>05/16/2018 PROGRESS SET</p> <p>06/11/2018 PERMIT SET</p> <p>08/30/2018 PERMIT COMMENTS</p>	<p>REV DATE ISSUED FOR</p> <p> </p> <p> </p> <p> </p> <p> </p>	<p>WATER AND GAS PLUMBING PLAN GROUND FLOOR - LOCH BAR P.06</p>