




ROOFTOP UNIT CONDENSATE TRAP DETAIL NO SCALE

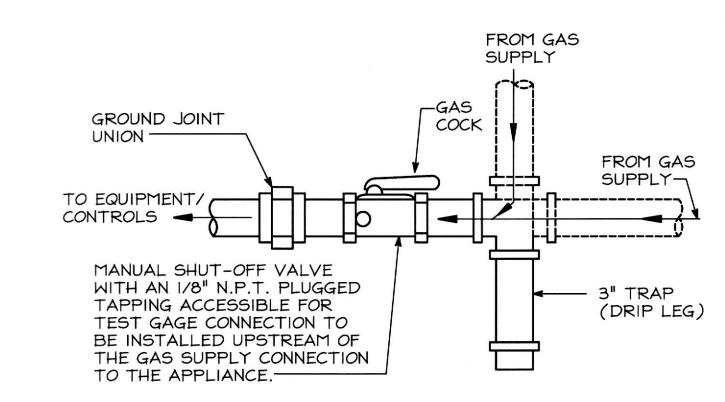


GAS CONNECTION DETAIL

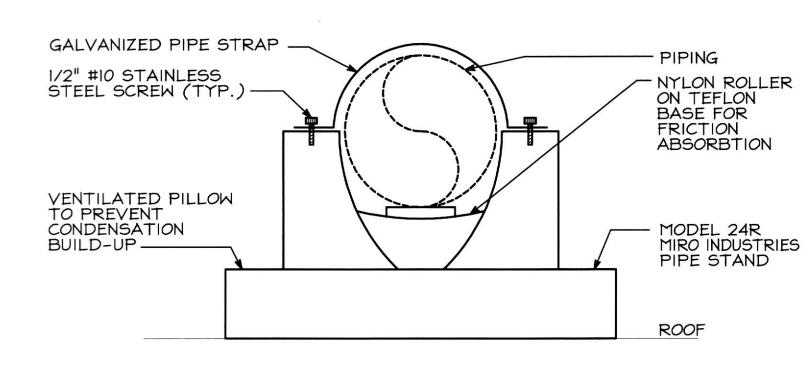


PILLOW BLOCK PIPESTAND DETAIL NO SCALE

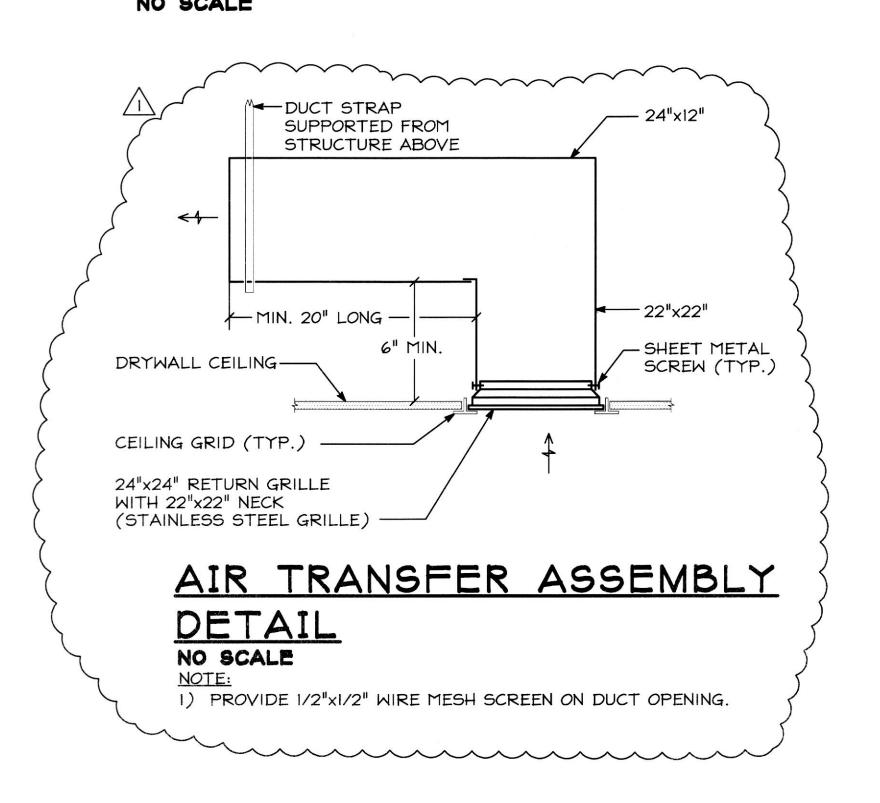


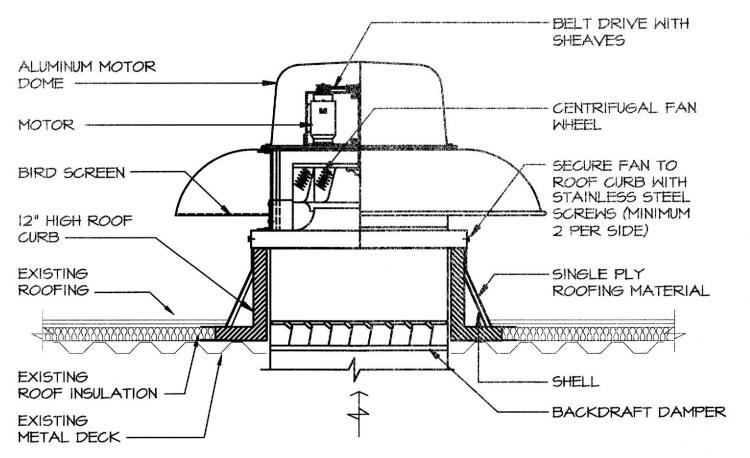

ROOF MOUNTED EXHAUST FAN DETAIL NO SCALE

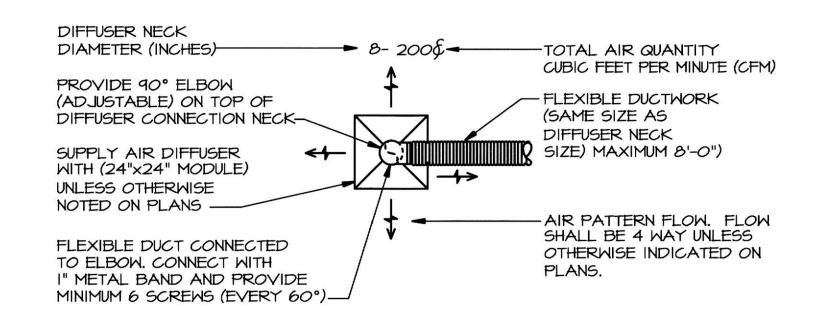

SUPPLY AIR DIFFUSER KEY NO SCALE

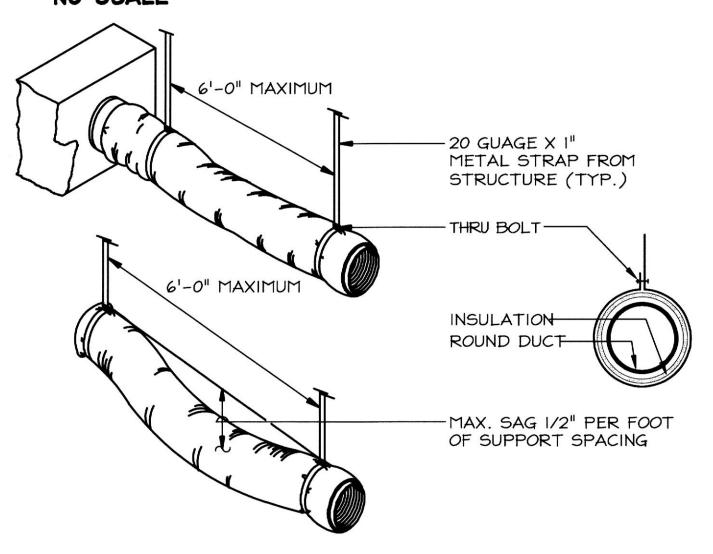


FLEXIBLE DUCT RUN-OUT SUPPORT DETAIL NO SCALE

NOTES:

1) FLEXIBLE DUCT SHOULD EXTEND STRAIGHT FOR SEVERAL INCHES FROM RECTANGULAR DUCT CONNECTION BEFORE


2) FLEXIBLE DUCT SHOULD NOT EXCEED 6'-0" IN LENGTH. USE RIGID ROUND DUCTWORK WHEN ROUNDOUTS EXCEED

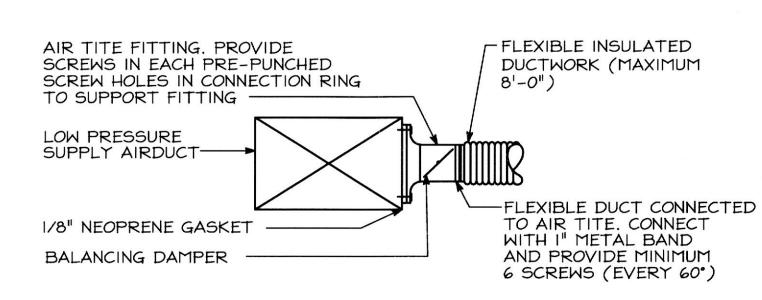

AIR TITE FITTING DETAIL


AIR TITE SIZE CHART			
DUCTSIZE	CONNECTION RING	DUCTSIZE	CONNECTION RING
5"	8"	9"	12"
6"	9"	10"	13"
7"	10"	11"	14"
8"	11"	12"	15"

I) WHERE CONNECTION RING SIZE IS LARGER THAN SUPPLY DUCT. THEN CONNECTION RING SHALL BE CRIMPED OVER DUCT AND CONNECTED, SCREWED AND SEALED ON TOP AND BOTTOM OF SUPPLY DUĆT.

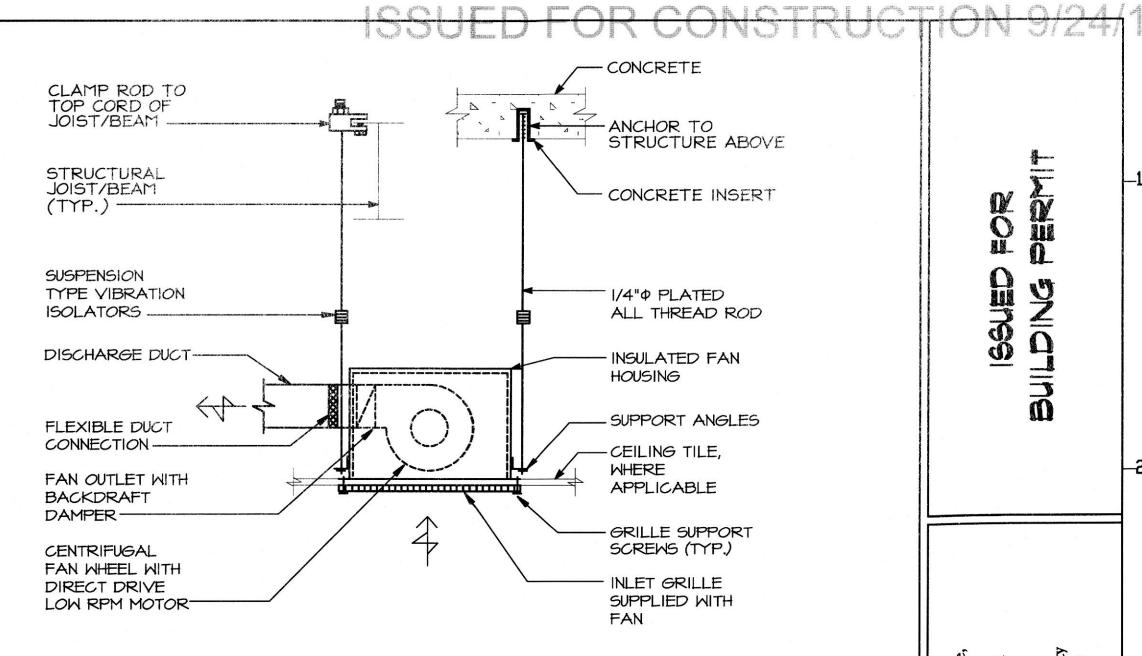

CEILING MOUNTED EXHAUST FAN DETAIL NO SCALE

1) PROVIDE VARIABLE SPEED SWITCH ON THE SIDE OF THE CASING FOR FINAL AIR BALANCE.

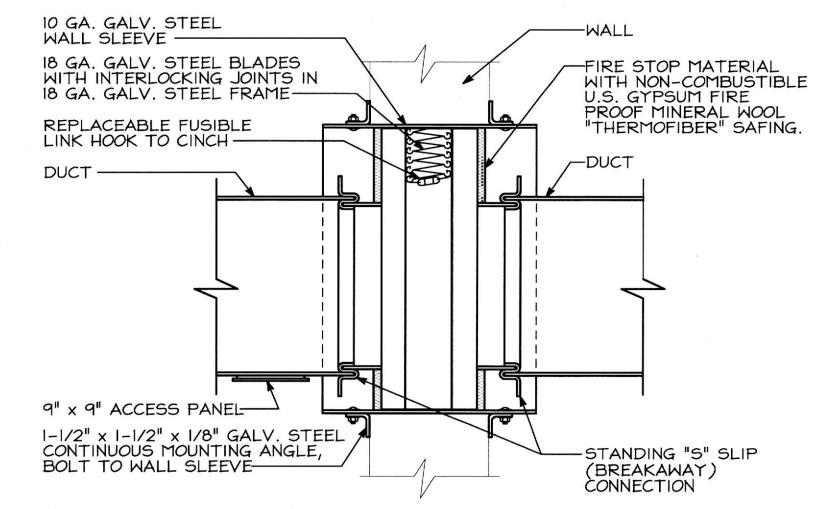


HORIZONTAL DUCT FIRE DAMPER DETAIL NO SCALE

NOTES:

1. FIRE DAMPERS TO HAVE BREAKAWAY JOINT BETWEEN COLLARS AND DUCT. (COLLARS SHALL BE INTEGRAL WITH FIRE DAMPERS FRAME.)

2. FIRE DAMPER SHALL BE U.L. LABELED.

3. ACCESS PANELS ARE REQUIRED FOR EVERY FIRE DAMPER LOCATION.
THIS <u>MUST</u> BE CLEARLY/NEATLY IDENTIFY ON THE CEILING GRID WITH I/2"
HIGH LETTERS JUST BELOW EACH FIRE DAMPER ACCESS PANEL.

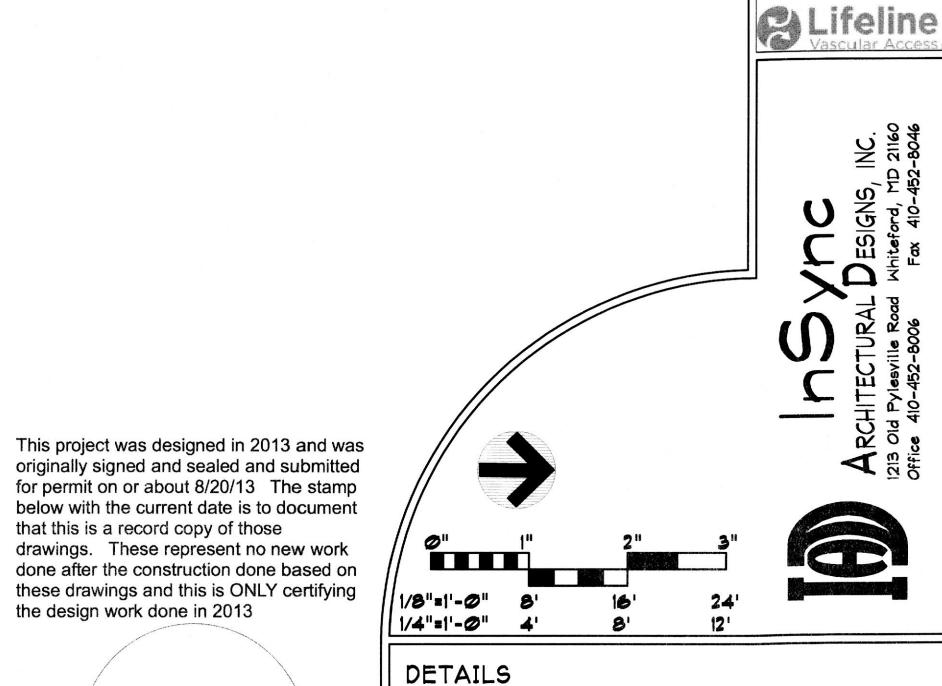

REVISIONS REV# DATE

DESCRIPTION M-104.00 1 7/16/13 OWNER'S REVISION

11206 DLI

that this is a record copy of those

the design work done in 2013

DRAWING NO.

SHEET 4 OF 9 DATE DRAWN BY 4/19/13 DLI JOB NUMBER CHECKED BY

Stern

ے.

Richard

TENANT ACC 1733 Br

SDI# 2013-01H