

Appr.	Date	Description	Symbol






Checked by: WTT	Date: 02/27/04
Dwn by: ICT	CADD File Name: 312M03.DGN
DAE487-03-0-0006	ICT Project No. 203121
Approved by:	Plot date: 02/27/04
Chief, P. J. Mgmt. Division	Plot scale:

TASK ORDER #1 FRR004
 PADUCAH, KENTUCKY
 VOICE 270-442-8620

 NASHVILLE, TENNESSEE
 PHONE (615) 346-3400

DEFENSE INFORMATION SCHOOL
 MARYLAND
 FT. MEADE
AHU FLOW SCHEMATIC DIAGRAMS

Sheet reference number:
M-103

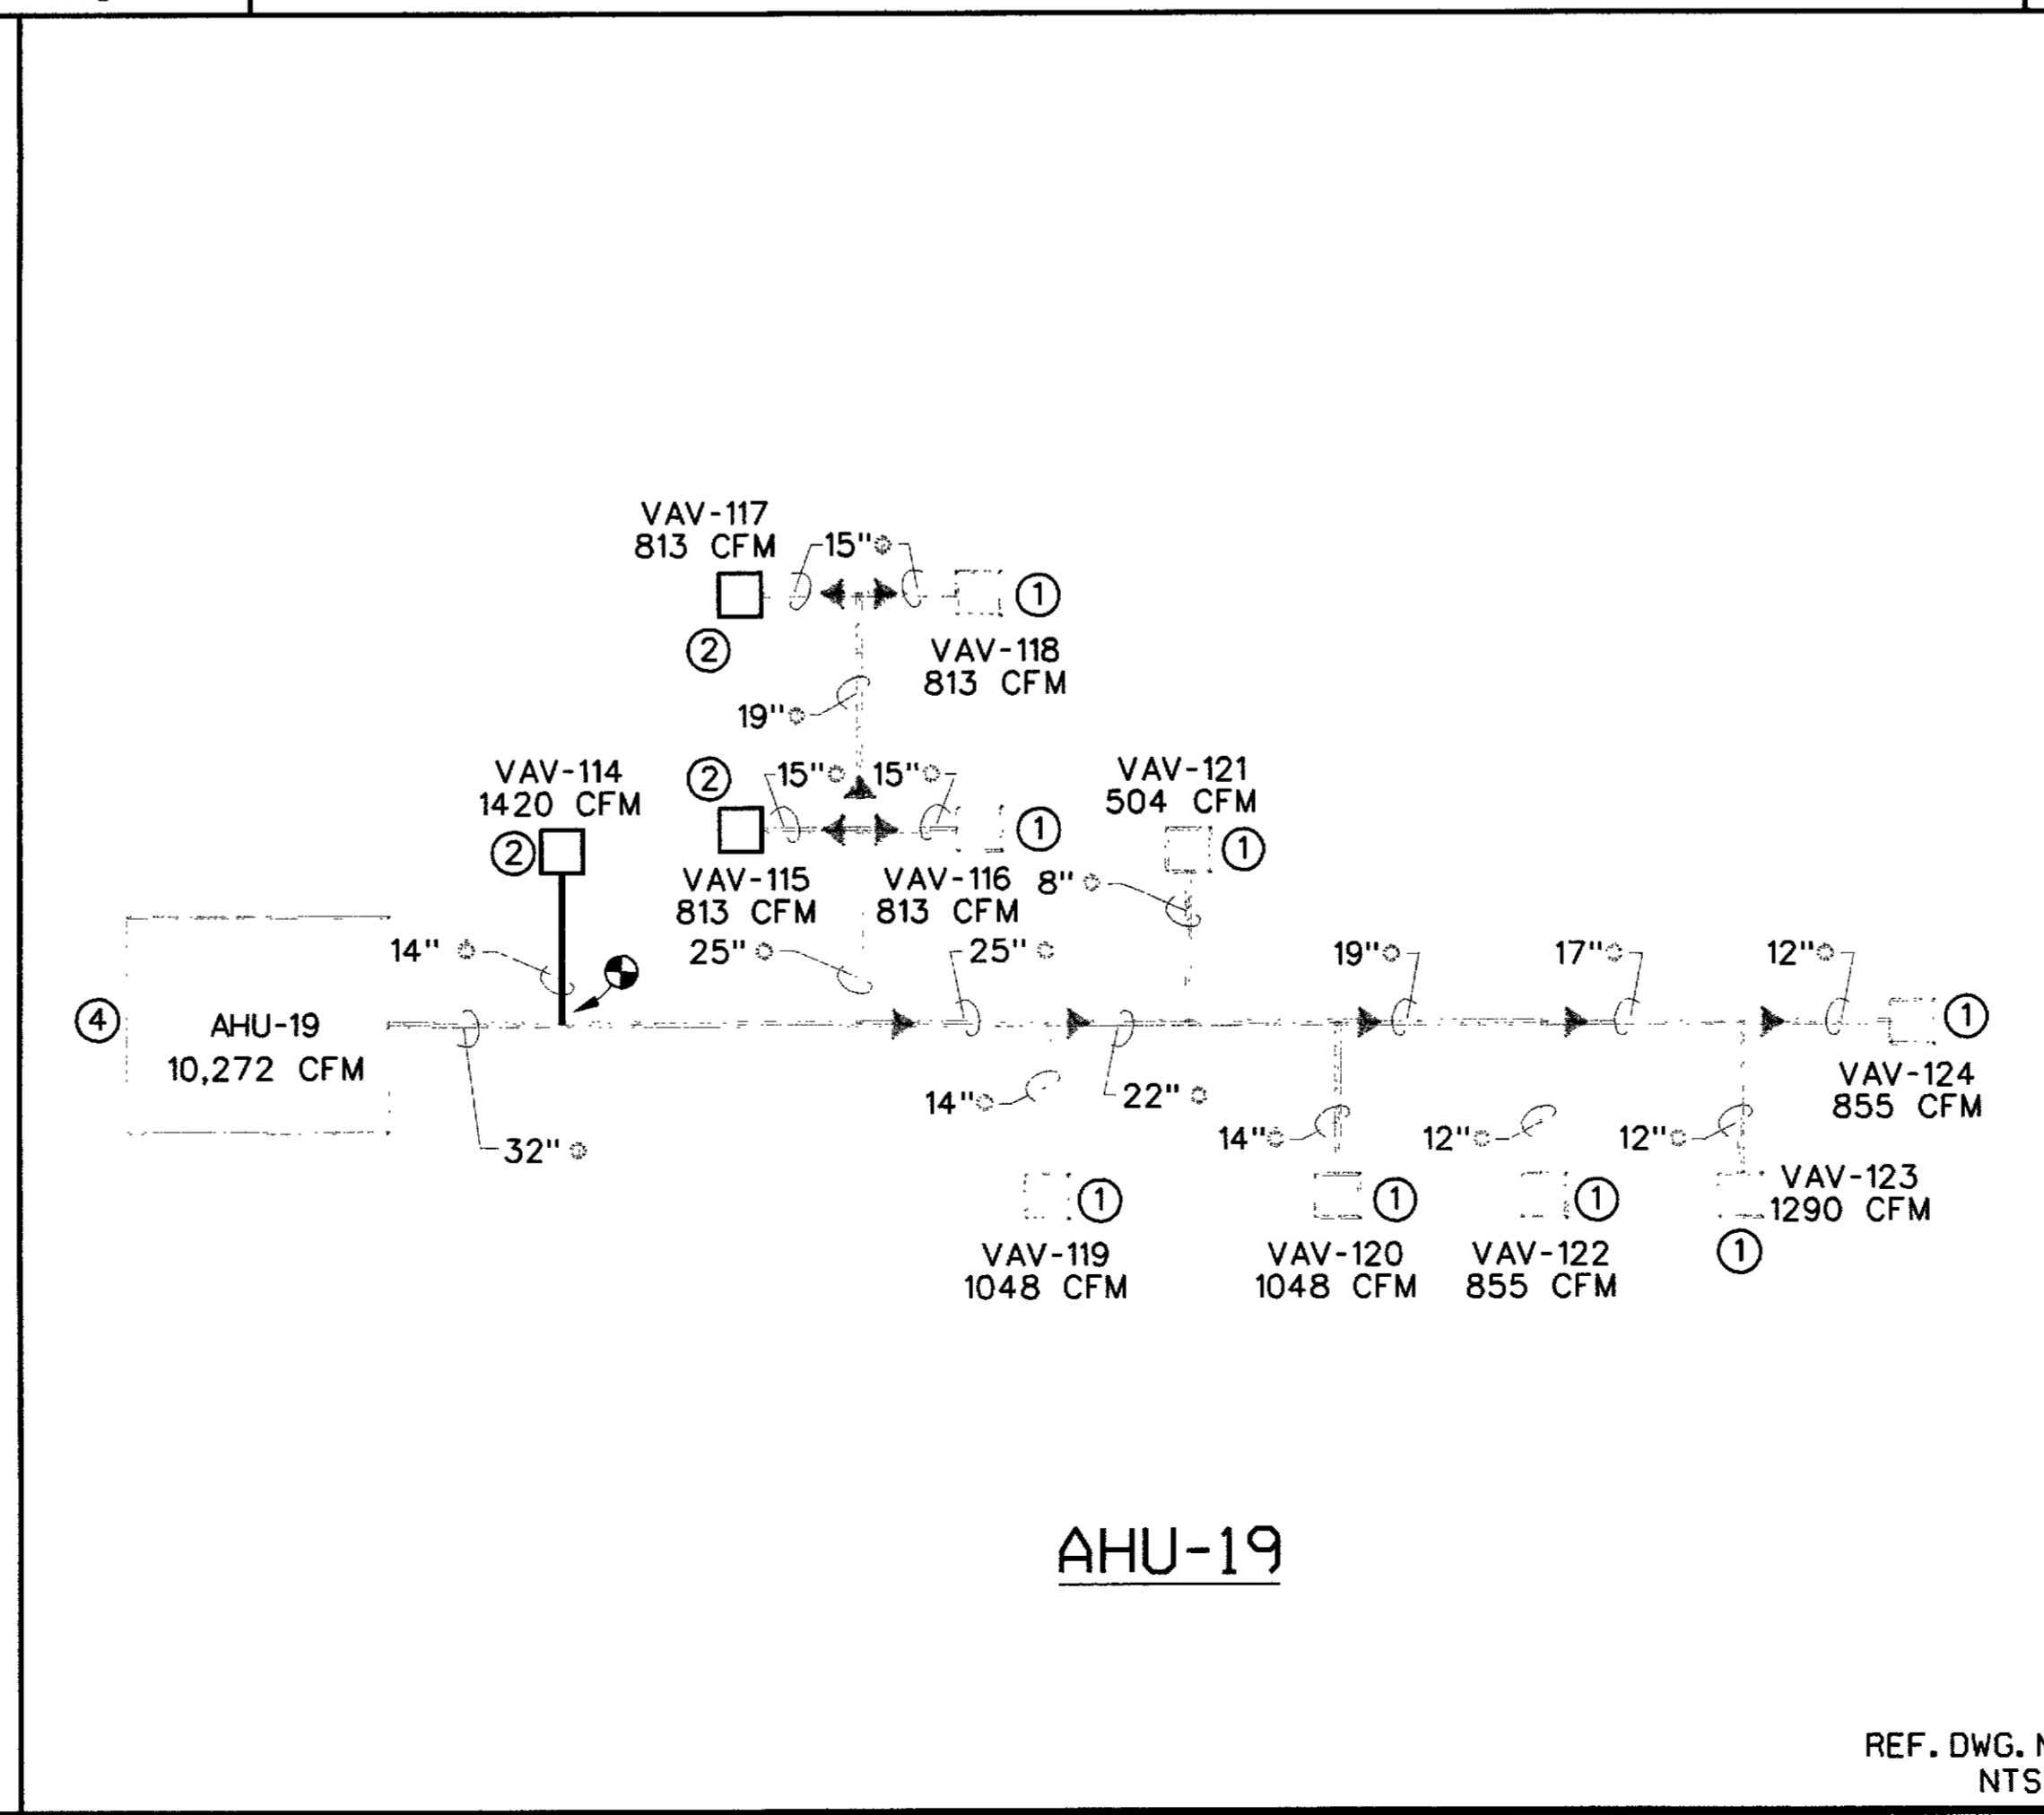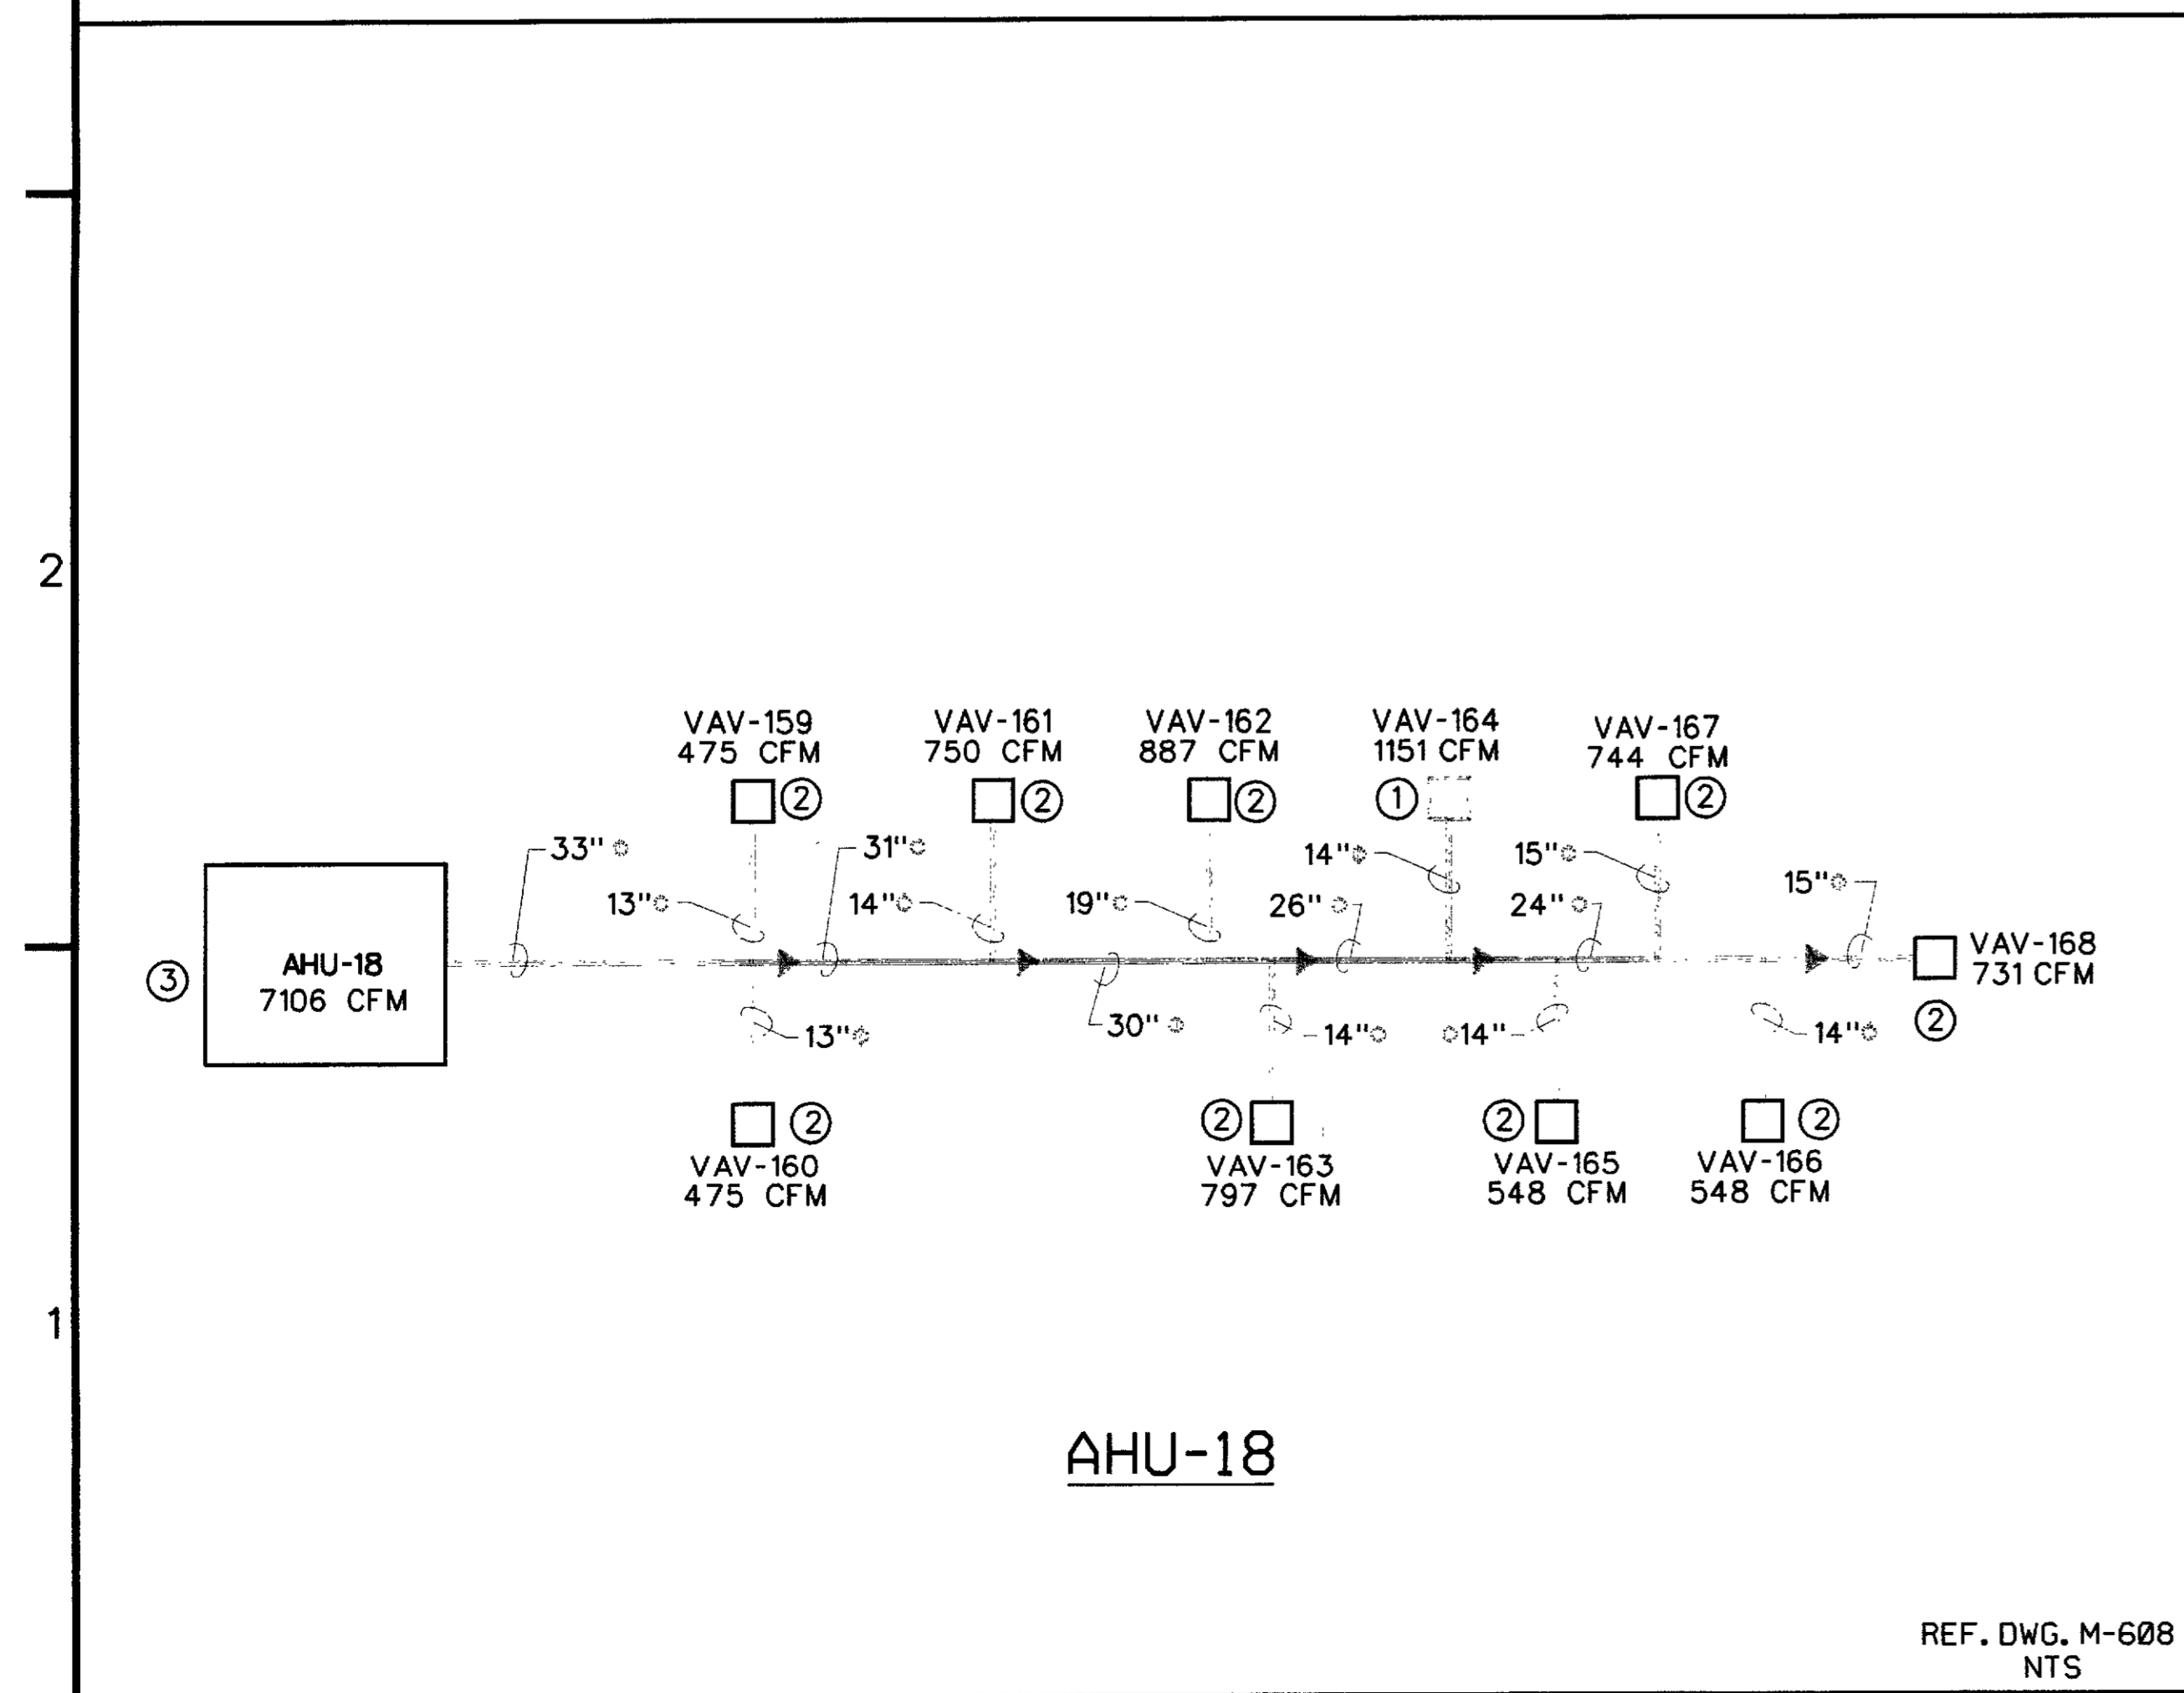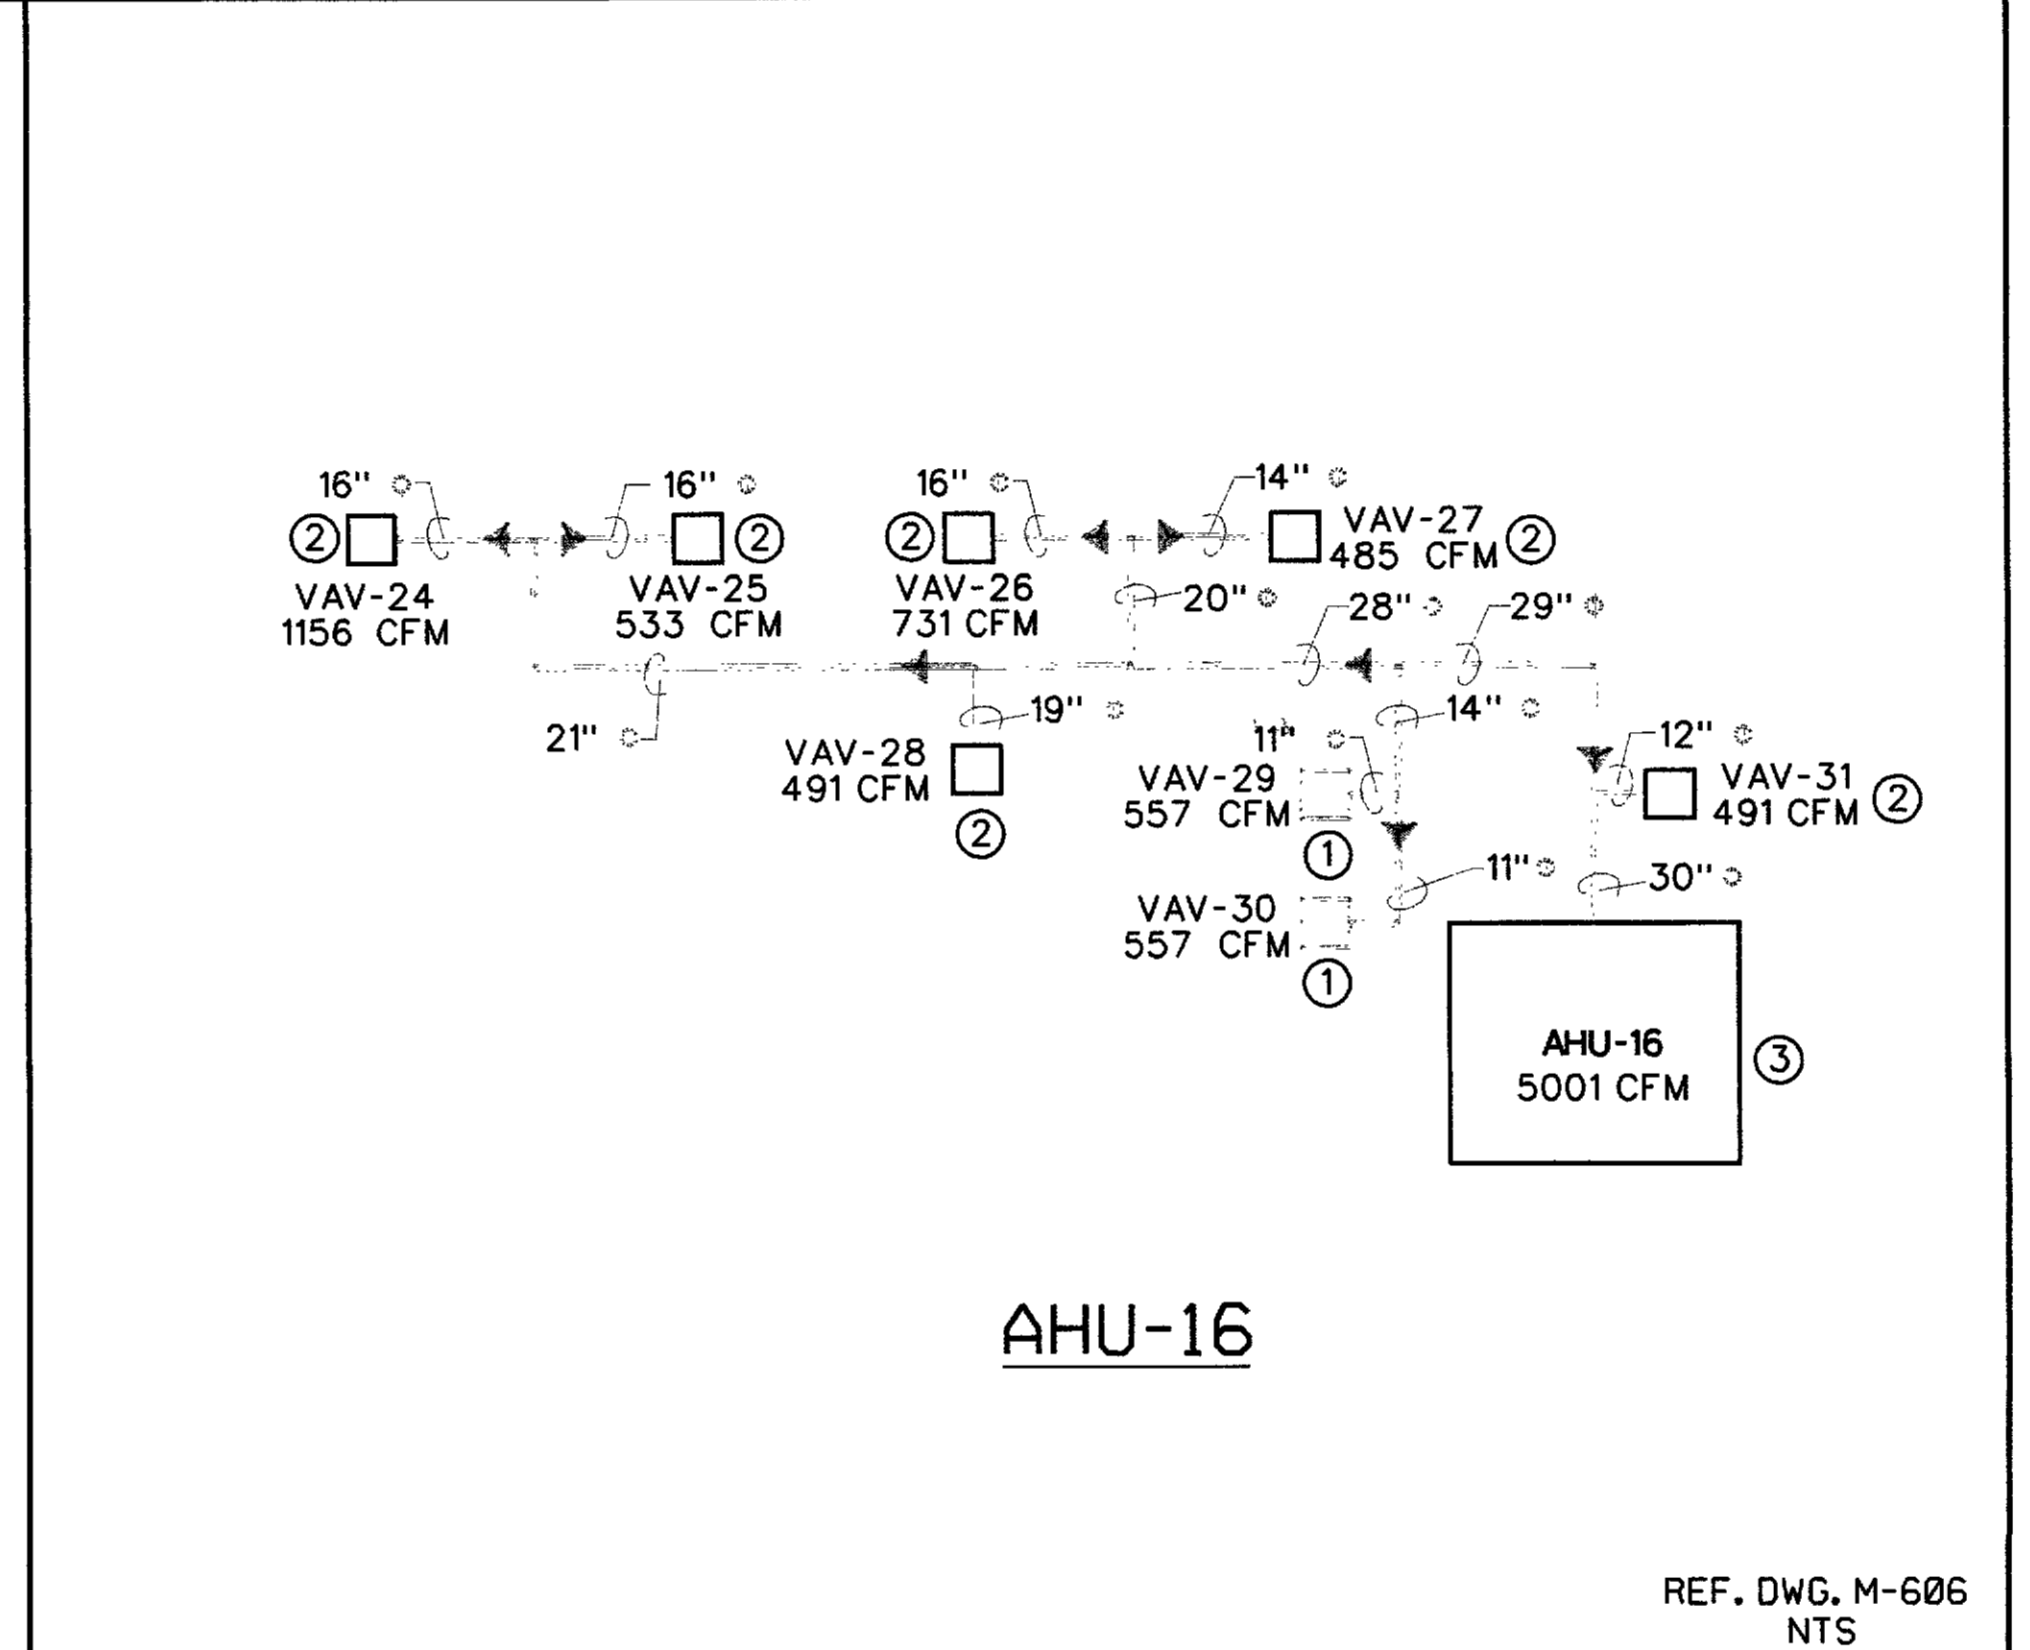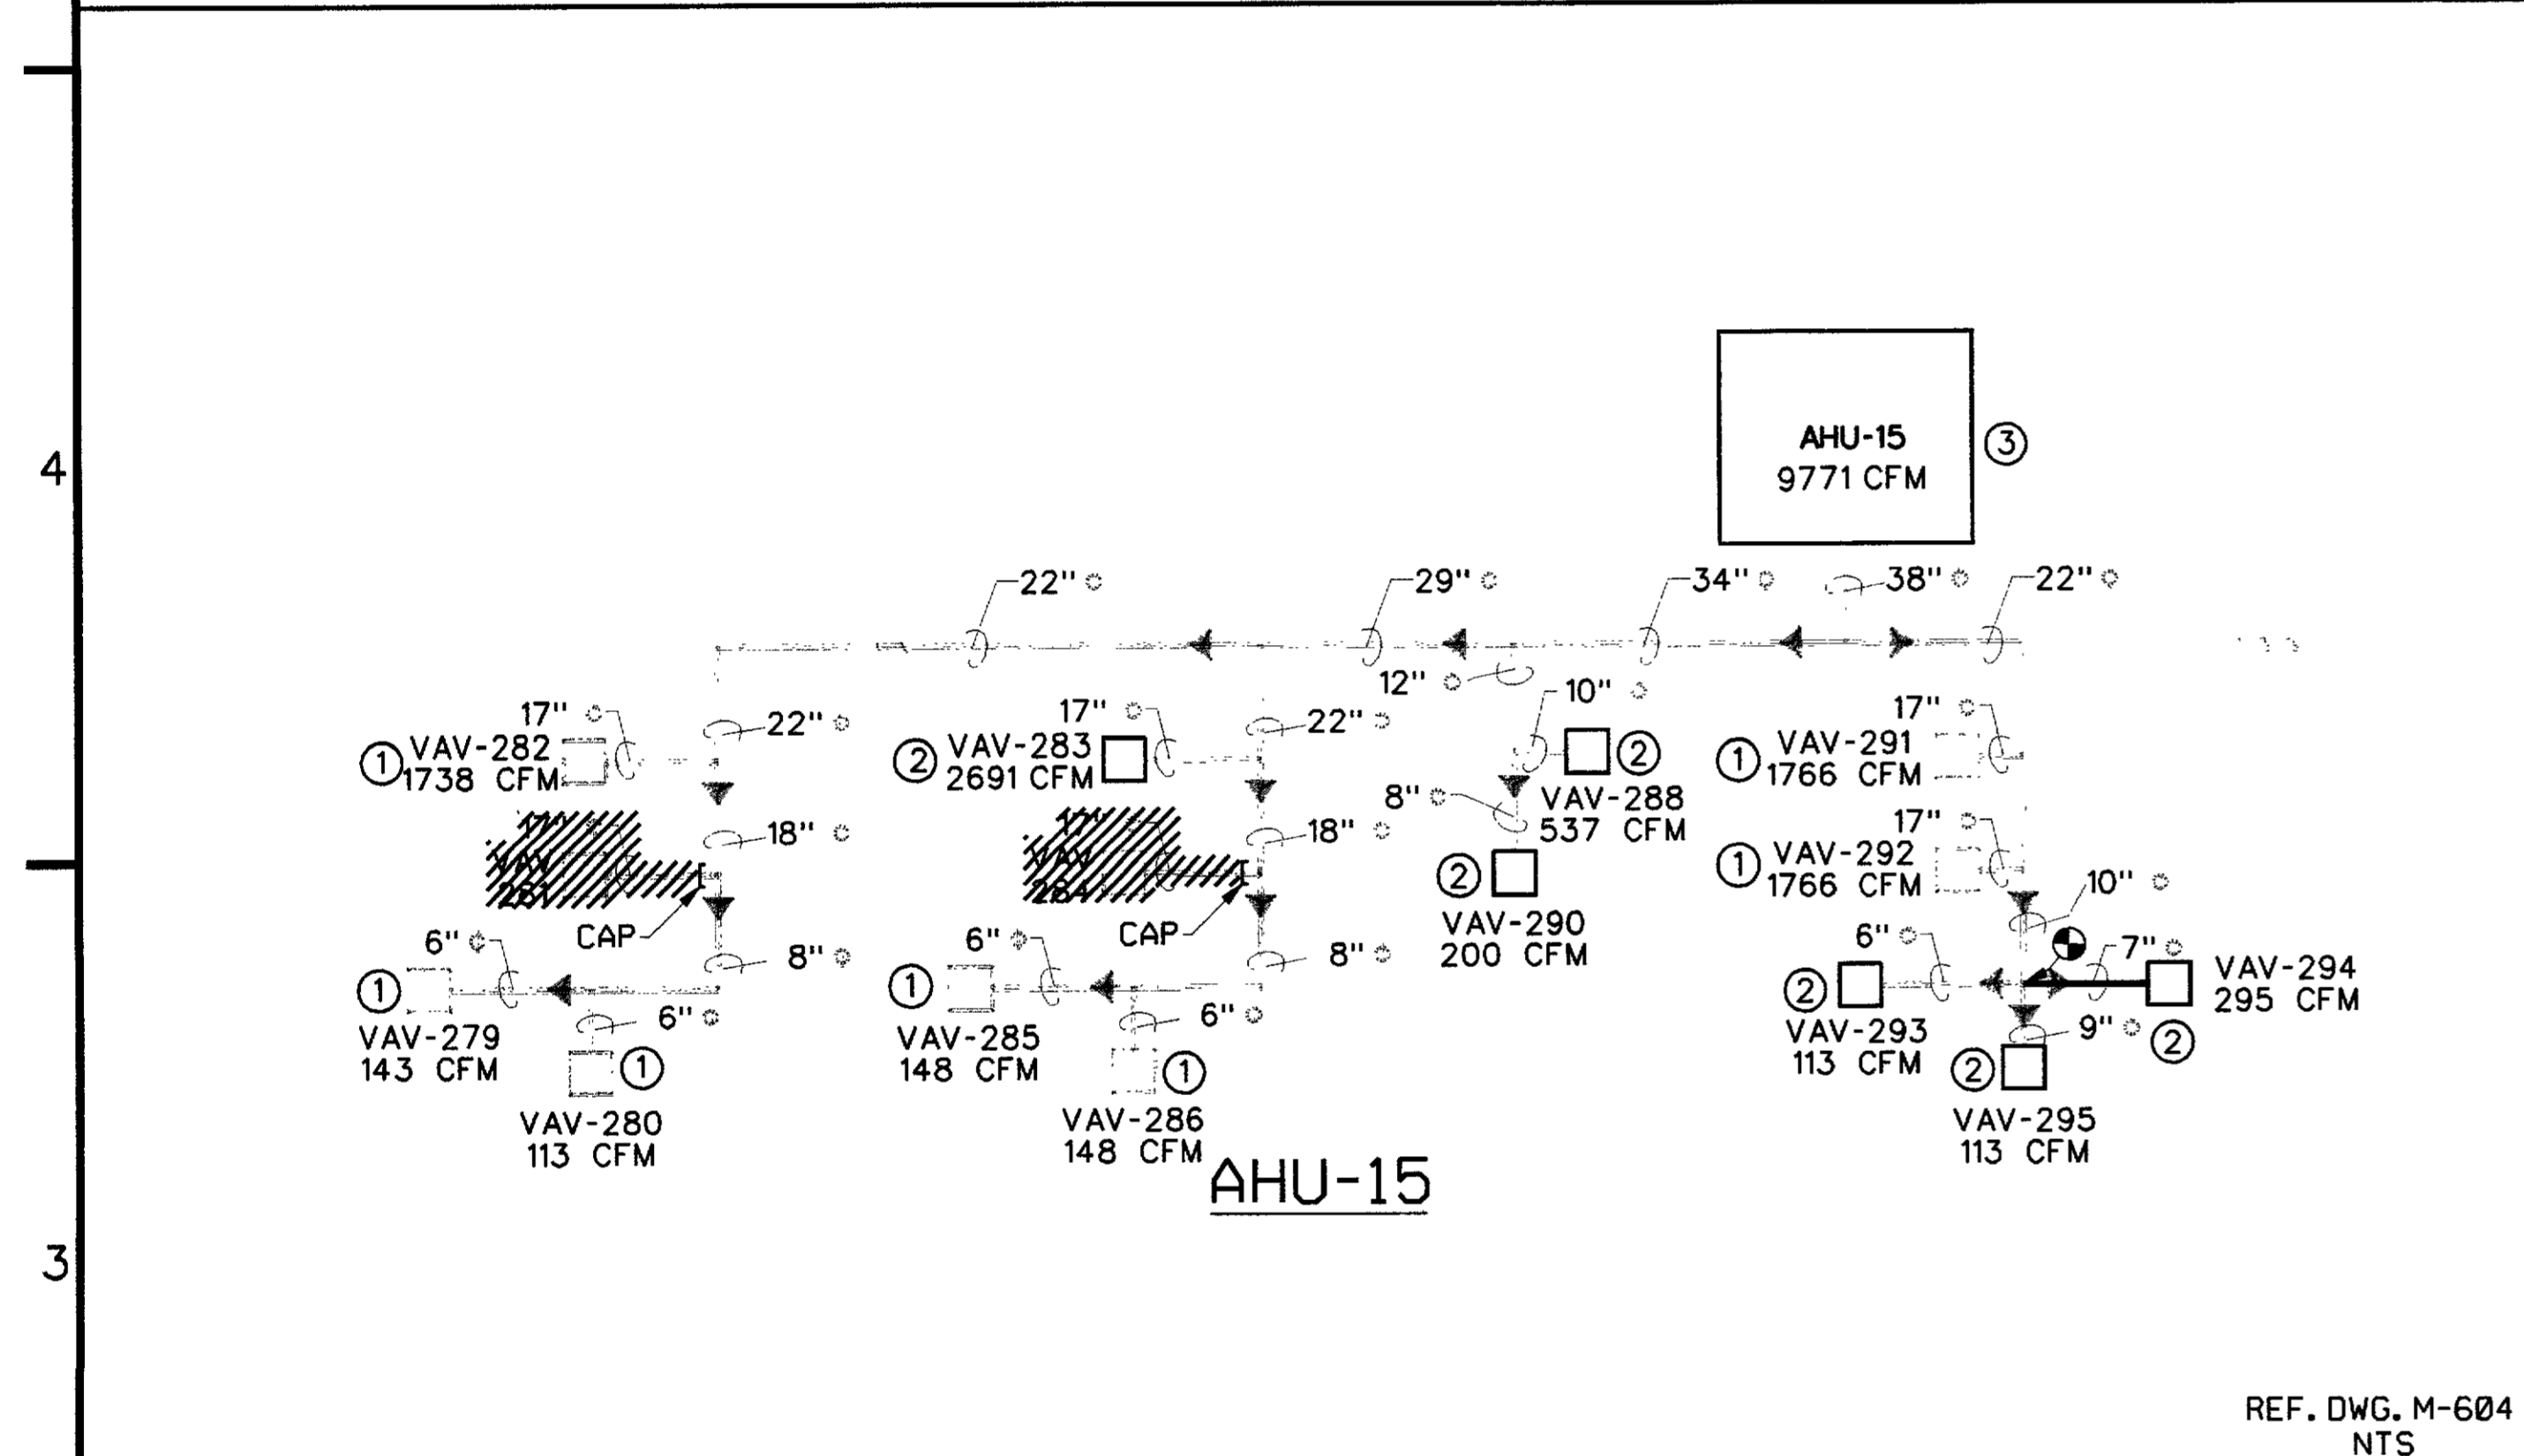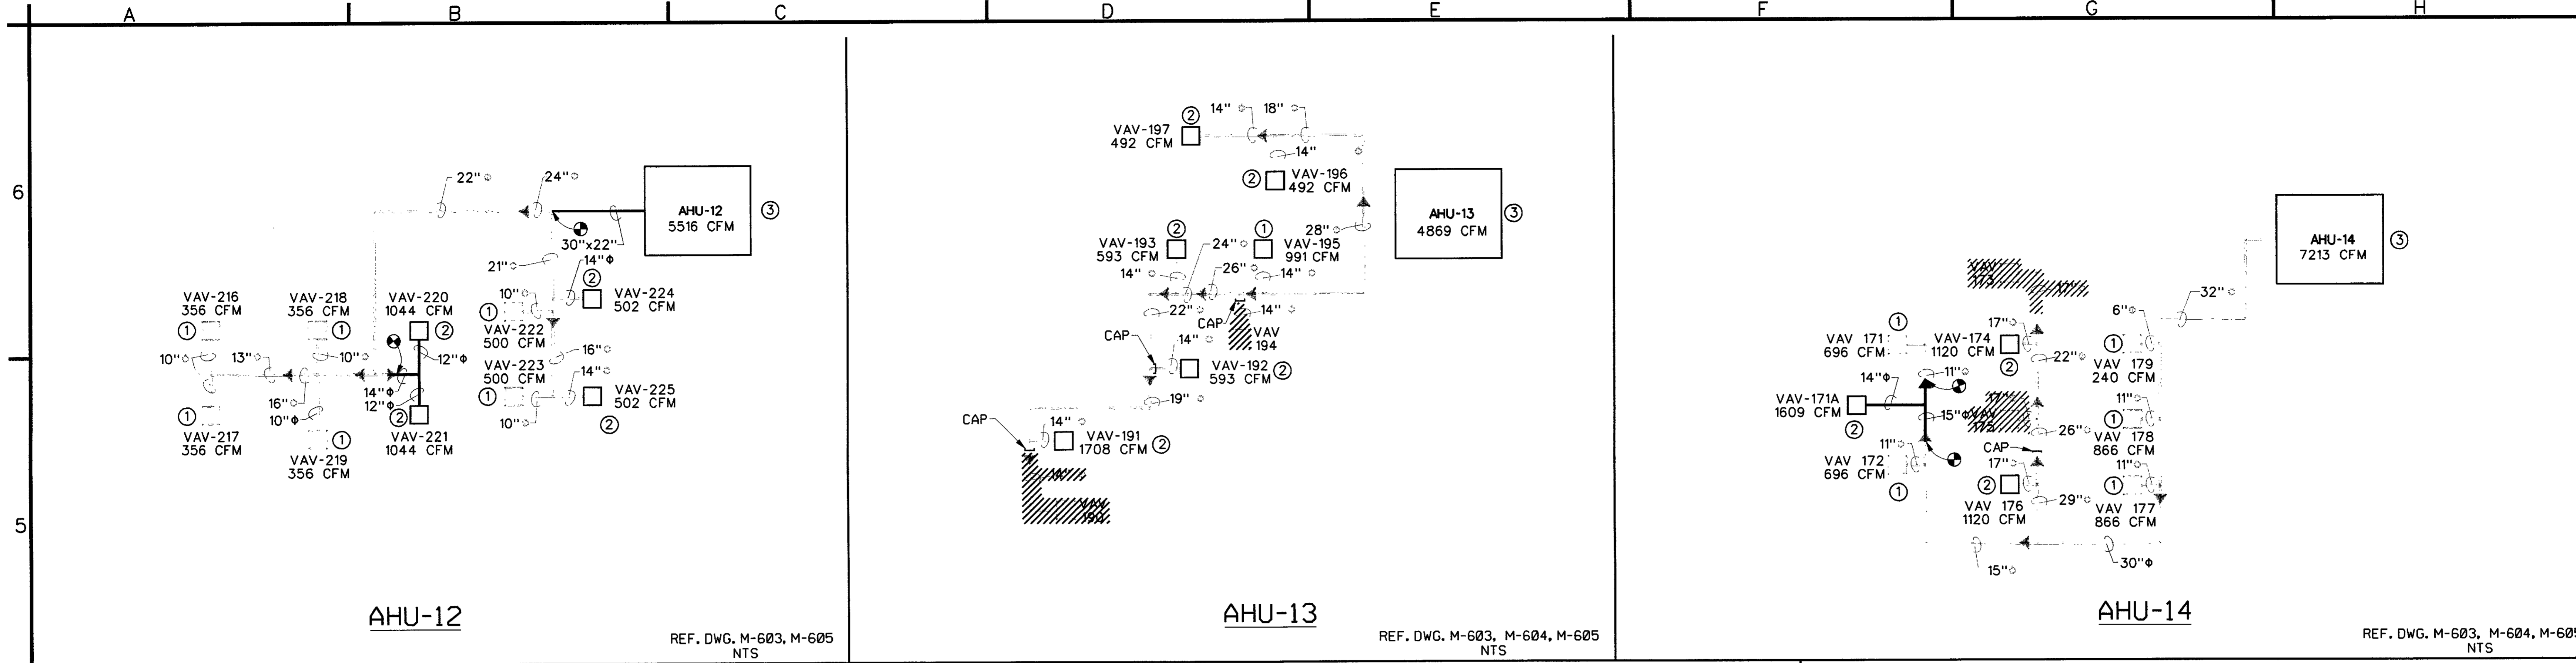

LEGEND

EXISTING: _____
 NEW: _____
 DEMO: ///////////////

NOTE(S):

- REBALANCE VAV (AIR AND HOT WATER FLOW) PER VAV BOX SCHEDULE.
- REPLACE VAV BOX SHOWN AS NEW. SEE VAV BOX SCHEDULE FOR DETAILS.
- REPLACE AHU SHOWN AS NEW. SEE AHU SCHEDULE FOR DETAILS.
- REBALANCE AHU. SEE SCHEDULE FOR DETAILS.
- NEW VAV BOX WILL REQUIRE NEW MP DUCT, HOTWATER PIPING, ELECTRICAL CONNECTION TO BOX AND NEW LP DUCT AND DIFFUSER FROM BOX. SEE SCHEDULE AND FLOOR PLANS FOR DETAILS.

STATE OF MARYLAND
 PROFESSIONAL ENGINEER
 No. 00000000

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITY STATEMENT ON COVER SHEET.