

- NOTE(S):
- ① REBALANCE EXISTING HOT WATER REHEAT COIL FLOW TO INDICATED REQUIREMENTS.
 - ② NEW HWS/R TO NEW DUCT HTG. COIL OR NEW VAV BOX. BALANCE REHEAT COIL TO INDICATED REQUIREMENTS.
 - ③ NEW HOT WATER SUPPLY & RETURN TO NEW AHU. NEW PIPE AND ROOF PENETRATION AT EACH COIL.
 - ④ REFER TO DRAWING 611-620 FOR FLOOR PLAN DETAILS.

INDICATES NEW VAV BOX OR AHU AND FLOW REQUIREMENTS.

INDICATES EXISTING VAV BOX OR AHU

FLOW MEASURING STATION, SEE DETAIL M-501.

HW - FLOW SCHEMATIC - 2nd FLOOR & ROOF


| Date | Apr. | Symbol | Description |
|------|------|--------|-------------|
| | | | |
| | | | |
| | | | |
| | | | |

| | |
|-----------------------------------|------------------------------|
| Checked by: WTT | Date: 02/27/04 |
| Dwn by: ICT | CADD File Name: 312.MI07.DGN |
| Approved by: J.C. Thomasson, Inc. | ICT Project No. 203321 |
| Chief, Proj. Mgmt. Division | Plot date: 02/27/04 |
| Plot scale: | |

DEFENSE INFORMATION SCHOOL

FT. MEADE
MARYLAND

2nd FLOOR HOT WATER FLOW SCHEMATIC DIAGRAM

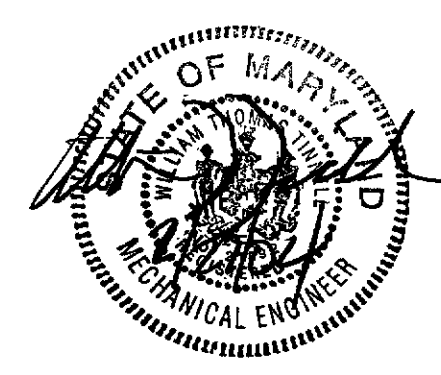

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITY STATEMENT ON COVER SHEET.

Sheet reference number: **M-107**