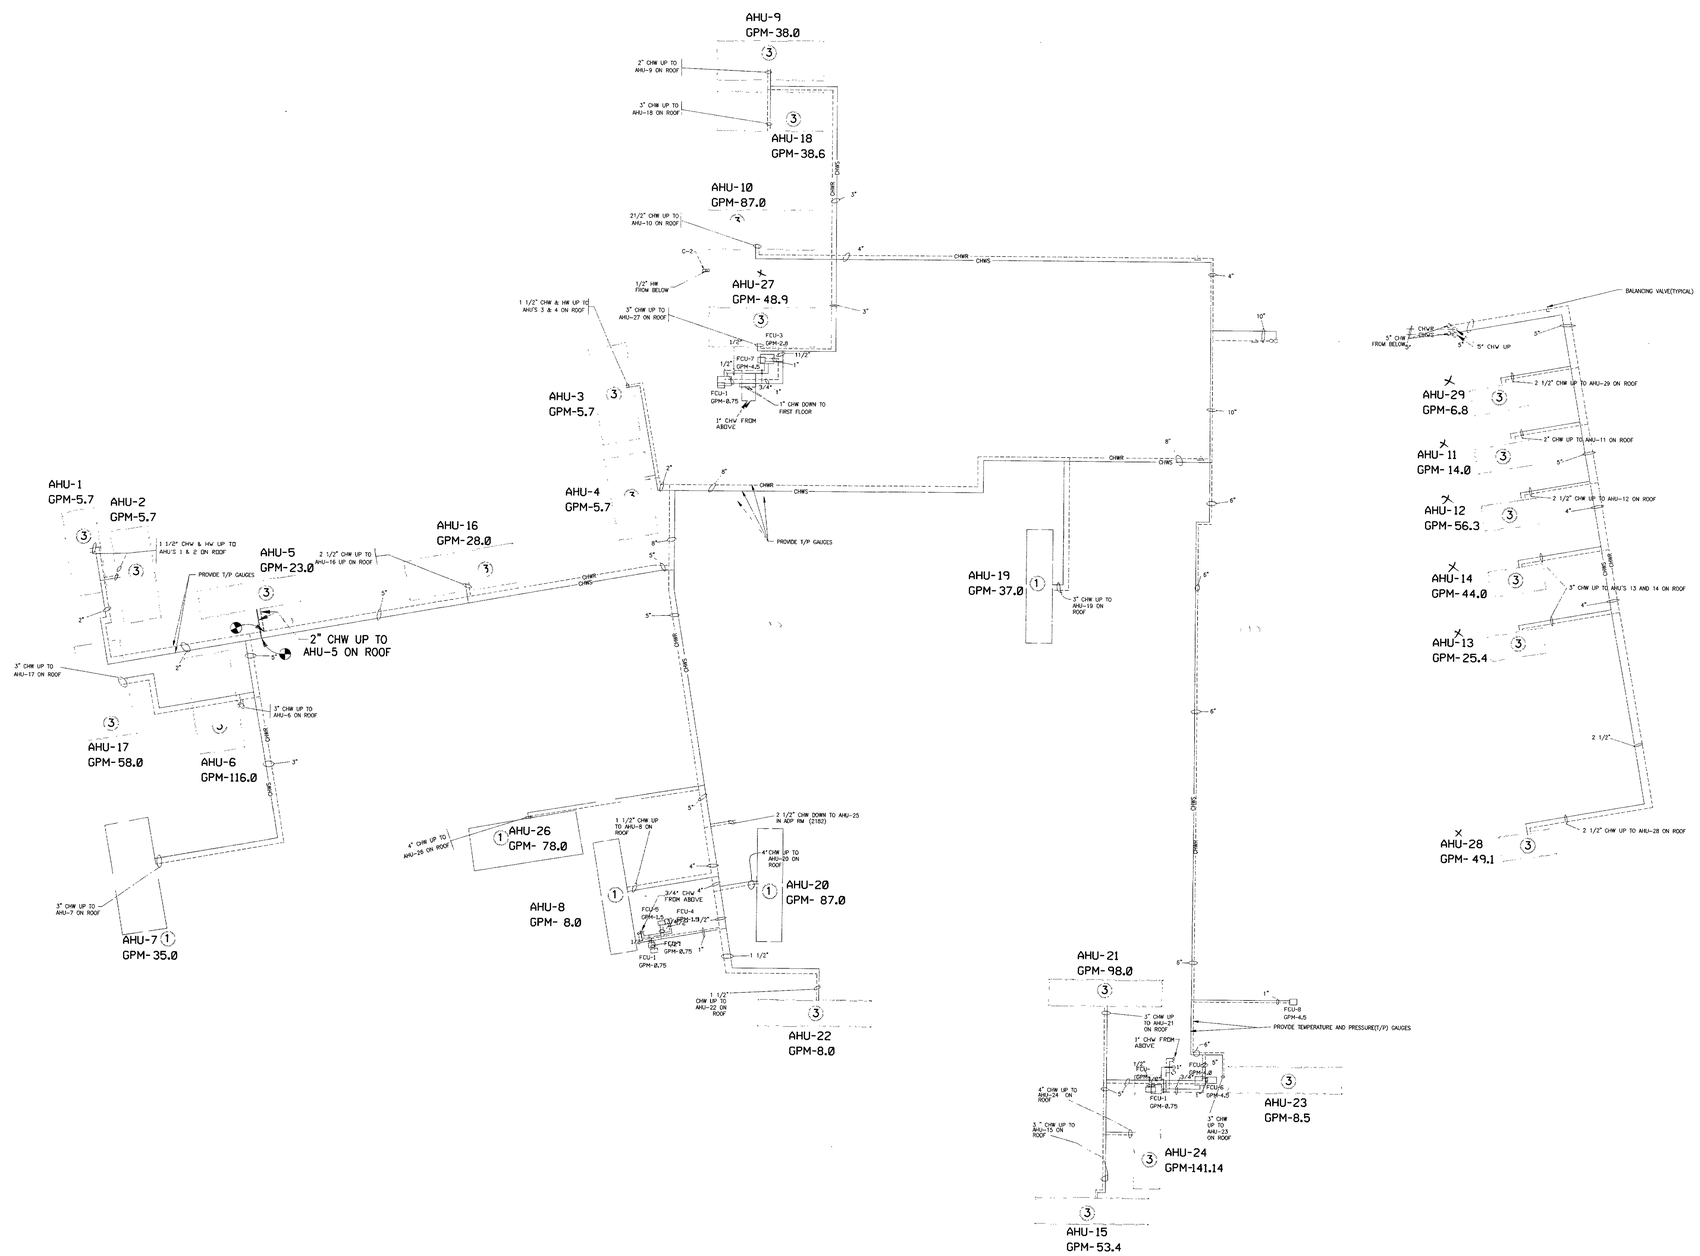

NOTE(S):

1. REBALANCE EXISTING HOT WATER REHEAT COIL FLOW TO INDICATED REQUIREMENTS.
2. NEW HWS/R TO NEW DUCT HTG. COIL OR NEW VAV BOX. BALANCE REHEAT COIL TO INDICATED REQUIREMENTS.
3. NEW HOT WATER SUPPLY & RETURN TO NEW AHU. NEW PIPE AND ROOF PENETRATION AT EACH COIL.
4. REFER TO DRAWING 611-620 FOR FLOOR PLAN DETAILS.

INDICATES NEW VAV BOX OR AHU AND FLOW REQUIREMENTS.

INDICATES EXISTING VAV BOX OR AHU

CW - FLOW SCHEMATIC - 2nd FLOOR PLAN

NTS

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIAIBILITIES STATEMENT ON COVER SHEET.

US ARMY ENGINEERING AND SUPPORT CENTER HUNTSVILLE

Symbol	Description	Date	Appr.	Symbol	Description	Date	Appr.

Date: 02/27/04
Checked by: WTT
CADD File Name: 312M108.DGN
Dwn by: ICT
ICT Project No. 203121
DAC487-03-D-0006
Plot date: 02/27/04
Approved by:
Plot scale:
Chief, Prj. Mgmt. Division

TASK ORDER #: FRR004

VINGLAWD

PADUCAH, KENTUCKY
VOICE 270-442-8620

I.C. Thomasson Associates, Inc.
MOBILE, ALABAMA 36608
PHONE (615) 345-5400

DEFENSE INFORMATION SCHOOL
FT. MEADE MARYLAND

CHILLED WATER FLOW SCHEMATIC DIAGRAM

STATE OF MARYLAND
MECHANICAL ENGINEER

Sheet reference number:
M-108