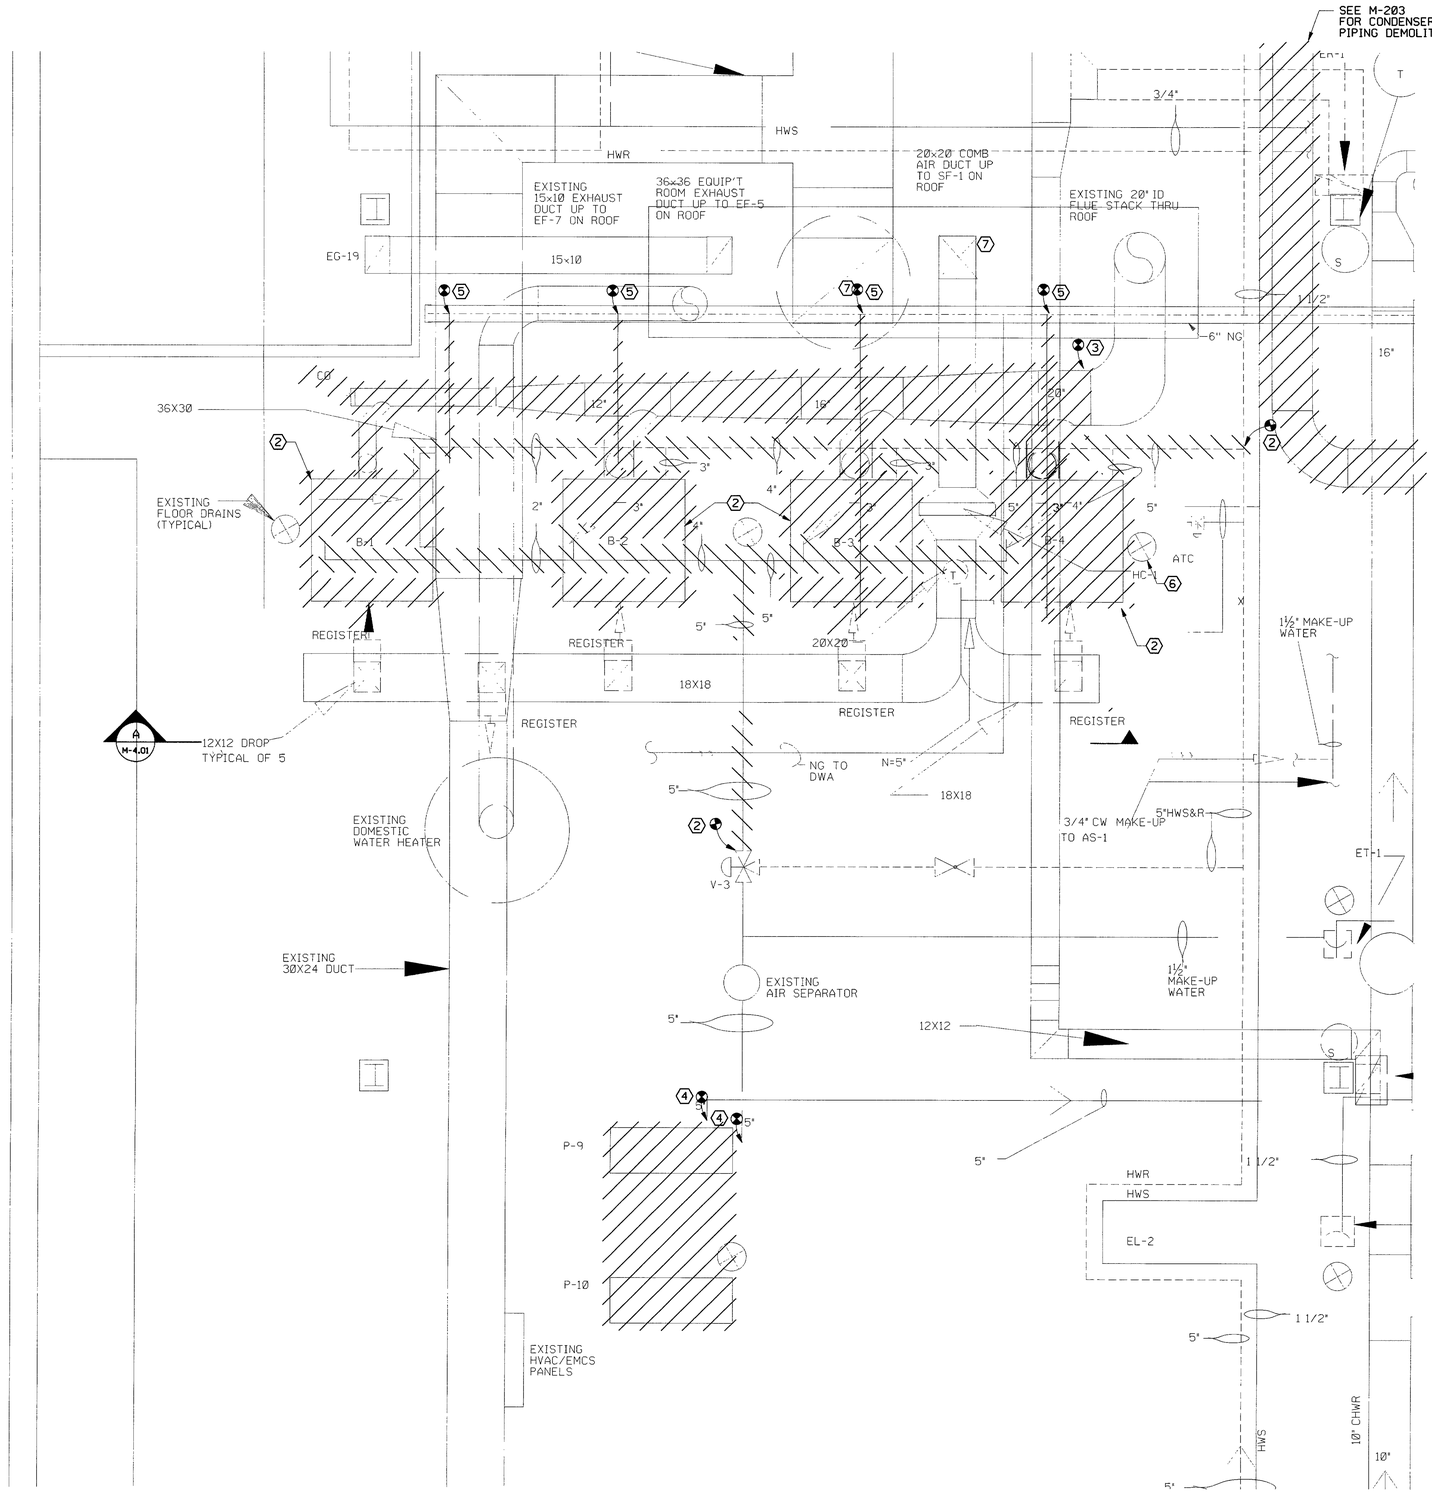

NOTES:
~~NOT USED~~

1. REMOVE EXISTING BOILERS AND ALL APPURTENANCES INCLUDING PIPING, POWER WIRING AND CONTROLS. (TYPICAL FOR 4 BOILERS)
2. REMOVE EXISTING FLUE GAS VENT TO POINT INDICATED.
3. REMOVE TWO EXISTING HOT WATER PUMPS (P-9 & P-10) WITH ASSOCIATED PIPING INCLUDING TRIPLE DUTY VALVES AS REQUIRED FOR INSTALLATION OF NEW PUMPS (FIELD VERIFY ACTUAL EXTENT OF PIPE DEMOLITION). REMOVE EXISTING VFD POWERING PUMPS.
4. REMOVE EXISTING NATURAL GAS PIPING BACK TO HEADER.
5. REMOVE EXISTING FLOOR DRAIN AND ASSOCIATED PIPING TO BELOW FLOOR SLAB. CAP EXISTING PIPING AND PATCH EXISTING SLAB AS REQUIRED.
6. REMOVE EXISTING COMBUSTION AIR FAN SF-1 ON ROOF, SEE M-301 AND M-503 FOR ADDITIONAL INFORMATION.

PARTIAL MECHANICAL ROOM HW DEMOLITION

0 5

½" = 1'-0"

LEGEND
- DEMO
- EXISTING
- EXTENT OF DEMOLITION

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITIES STATEMENT ON COVER SHEET.

US ARMY ENGINEERING AND SUPPORT CENTER HUNTSVILLE

Symbol	Description	Date	Appr.

TASK ORDER #: FRR004

PADUCAH, KENTUCKY VOICE 270-442-8620
I.C. Thomasson Associates, Inc.
NASHVILLE, TENNESSEE PHONE (615) 346-3400

Checked by: WTT	Date: 02/27/04
Dsn by: ICT	CADD File Name: 312M201DGN
DACA87-03-D-0006	ICT Project No. 203121
Approved by: Chief, Prj. Mgmt. Division	Plot date: 02/27/04 Plot scale:

DEFENSE INFORMATION SCHOOL
FT. MEADE MARYLAND

MECHANICAL ROOM HOT WATER DEMOLITION

Sheet reference number:
M-201