




NOTES:

- ① REMOVE EXISTING CONTROL VALVE V-2 AND ASSOCIATED PIPING AS INDICATED.
- ② REMOVE EXISTING TRIPLE-DUTY VALVE. SEE M-502 FOR REPLACEMENT COMPONENTS.

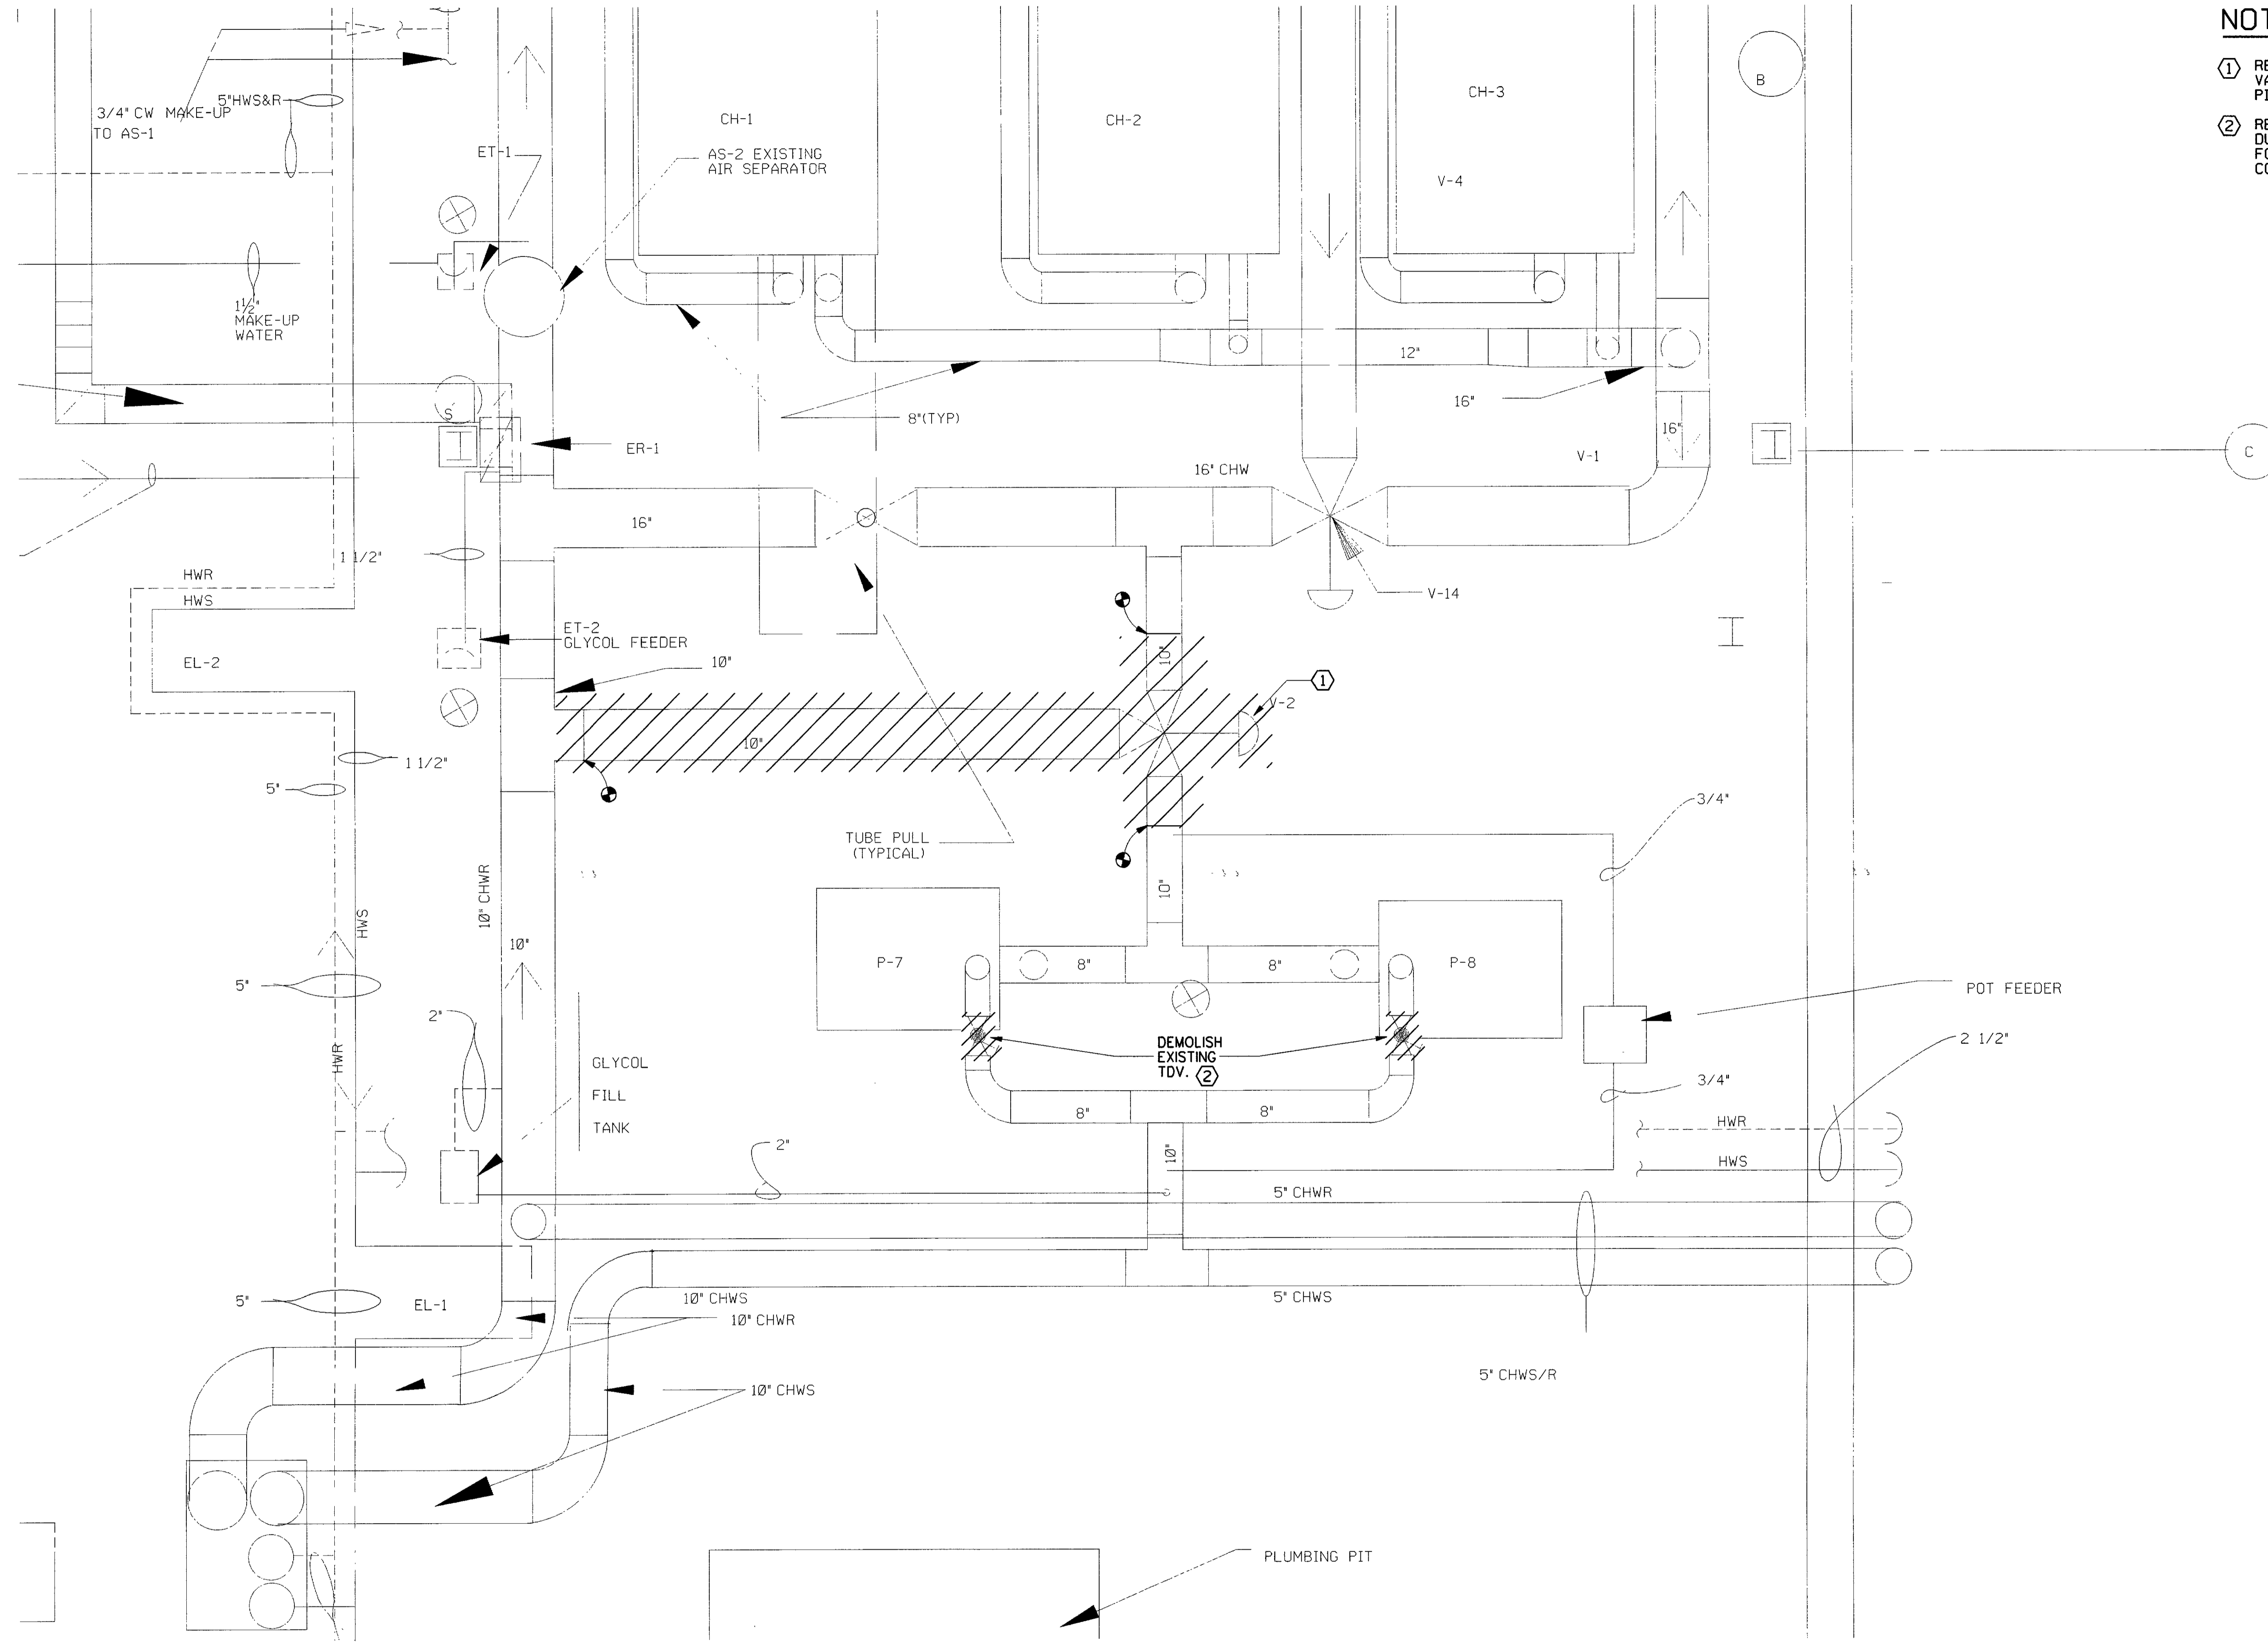

LEGEND

	DEMO
	EXISTING
	EXTENT OF DEMOLITION

PARTIAL MECHANICAL ROOM CHW DEMOLITION

0 5
1/2" = 1'-0"

Date	Appr.	Symbol	Description

Checked by: WTT
 Date: 02/27/04
 CADD File Name: 312M202.DGN
 Dwn by: ICT
 DAC487-03-D-0006
 ICT Project No. 203121
 Approved by: [Signature]
 Chief, P-1 Mgmt. Division
 Plot date: 02/27/04
 Plot scale: [Blank]

TASK ORDER #1: FRR004
 PADUCAH, KENTUCKY
 VOICE 270-442-8620

 I.C. Thomasson
 Mechanical, Inc.
 NASHVILLE, TENNESSEE
 PHONE (615) 248-3400

DEFENSE INFORMATION SCHOOL
 FT. MEADE MARYLAND
MECHANICAL ROOM CHILLED WATER DEMOLITION

Sheet reference number:
M-202

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITY STATEMENT ON COVER SHEET.

