


NOTES:

- ① RECONNECT TO EXISTING NAT. GAS HEADER.
- ② RECONNECT MAKEUP WATER AND GLYCOL FEEDER AS REQUIRED. FIELD VERIFY MAKEUP WATER SUPPLIED VIA DEDICATED DOUBLE CHECK VALVE BACKFLOW PREVENTER.
- ③ INSULATE ALL HWS&R PIPING PER SPECS. PROVIDE ALUMINUM CLAD COVERING FOR ALL INSULATED PIPING TO 5 FT ABOVE FIN. FLR. PER SPECIFICATIONS.
- ④ ALL MANUAL VALVE OPERATORS MORE THAN 10 FT ABOVE FIN. FLR. SHALL BE INSTALLED WITH CHAIN OPERATORS.
- ⑤ EXTEND NAT. GAS REGULATOR RELIEF VENT PIPING TO DISCHARGE OUTSIDE OF BUILDING.
- ⑥ PROVIDE NEW VARIABLE FREQUENCY DRIVES FOR NEW PUMPS P-9 & P-10.

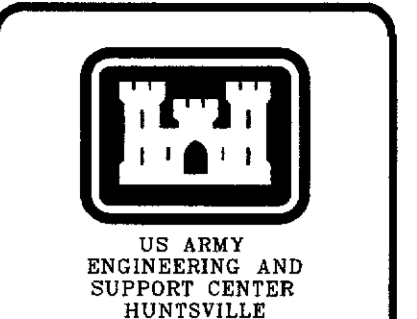


Date	Aspr.	Description


Date: 02/27/04	Checked by: WTT	TASK ORDER #: FR0004
CADD File Name: 312M301.DGN	Dwn by: ICT	PADUCAH, KENTUCKY
ICT Project No. 203121	DAC487-03-D-0006	VOICE 270-142-8620
Plot date: 02/27/04	Approved by:	PROJECT MANAGER
Plot scale:	Chief, Proj. Mgmt. Division	ICT

DEFENSE INFORMATION SCHOOL
 FT. MEADE MARYLAND
 MECHANICAL ROOM HOT WATER NEW WORK


Sheet reference number:
M-301

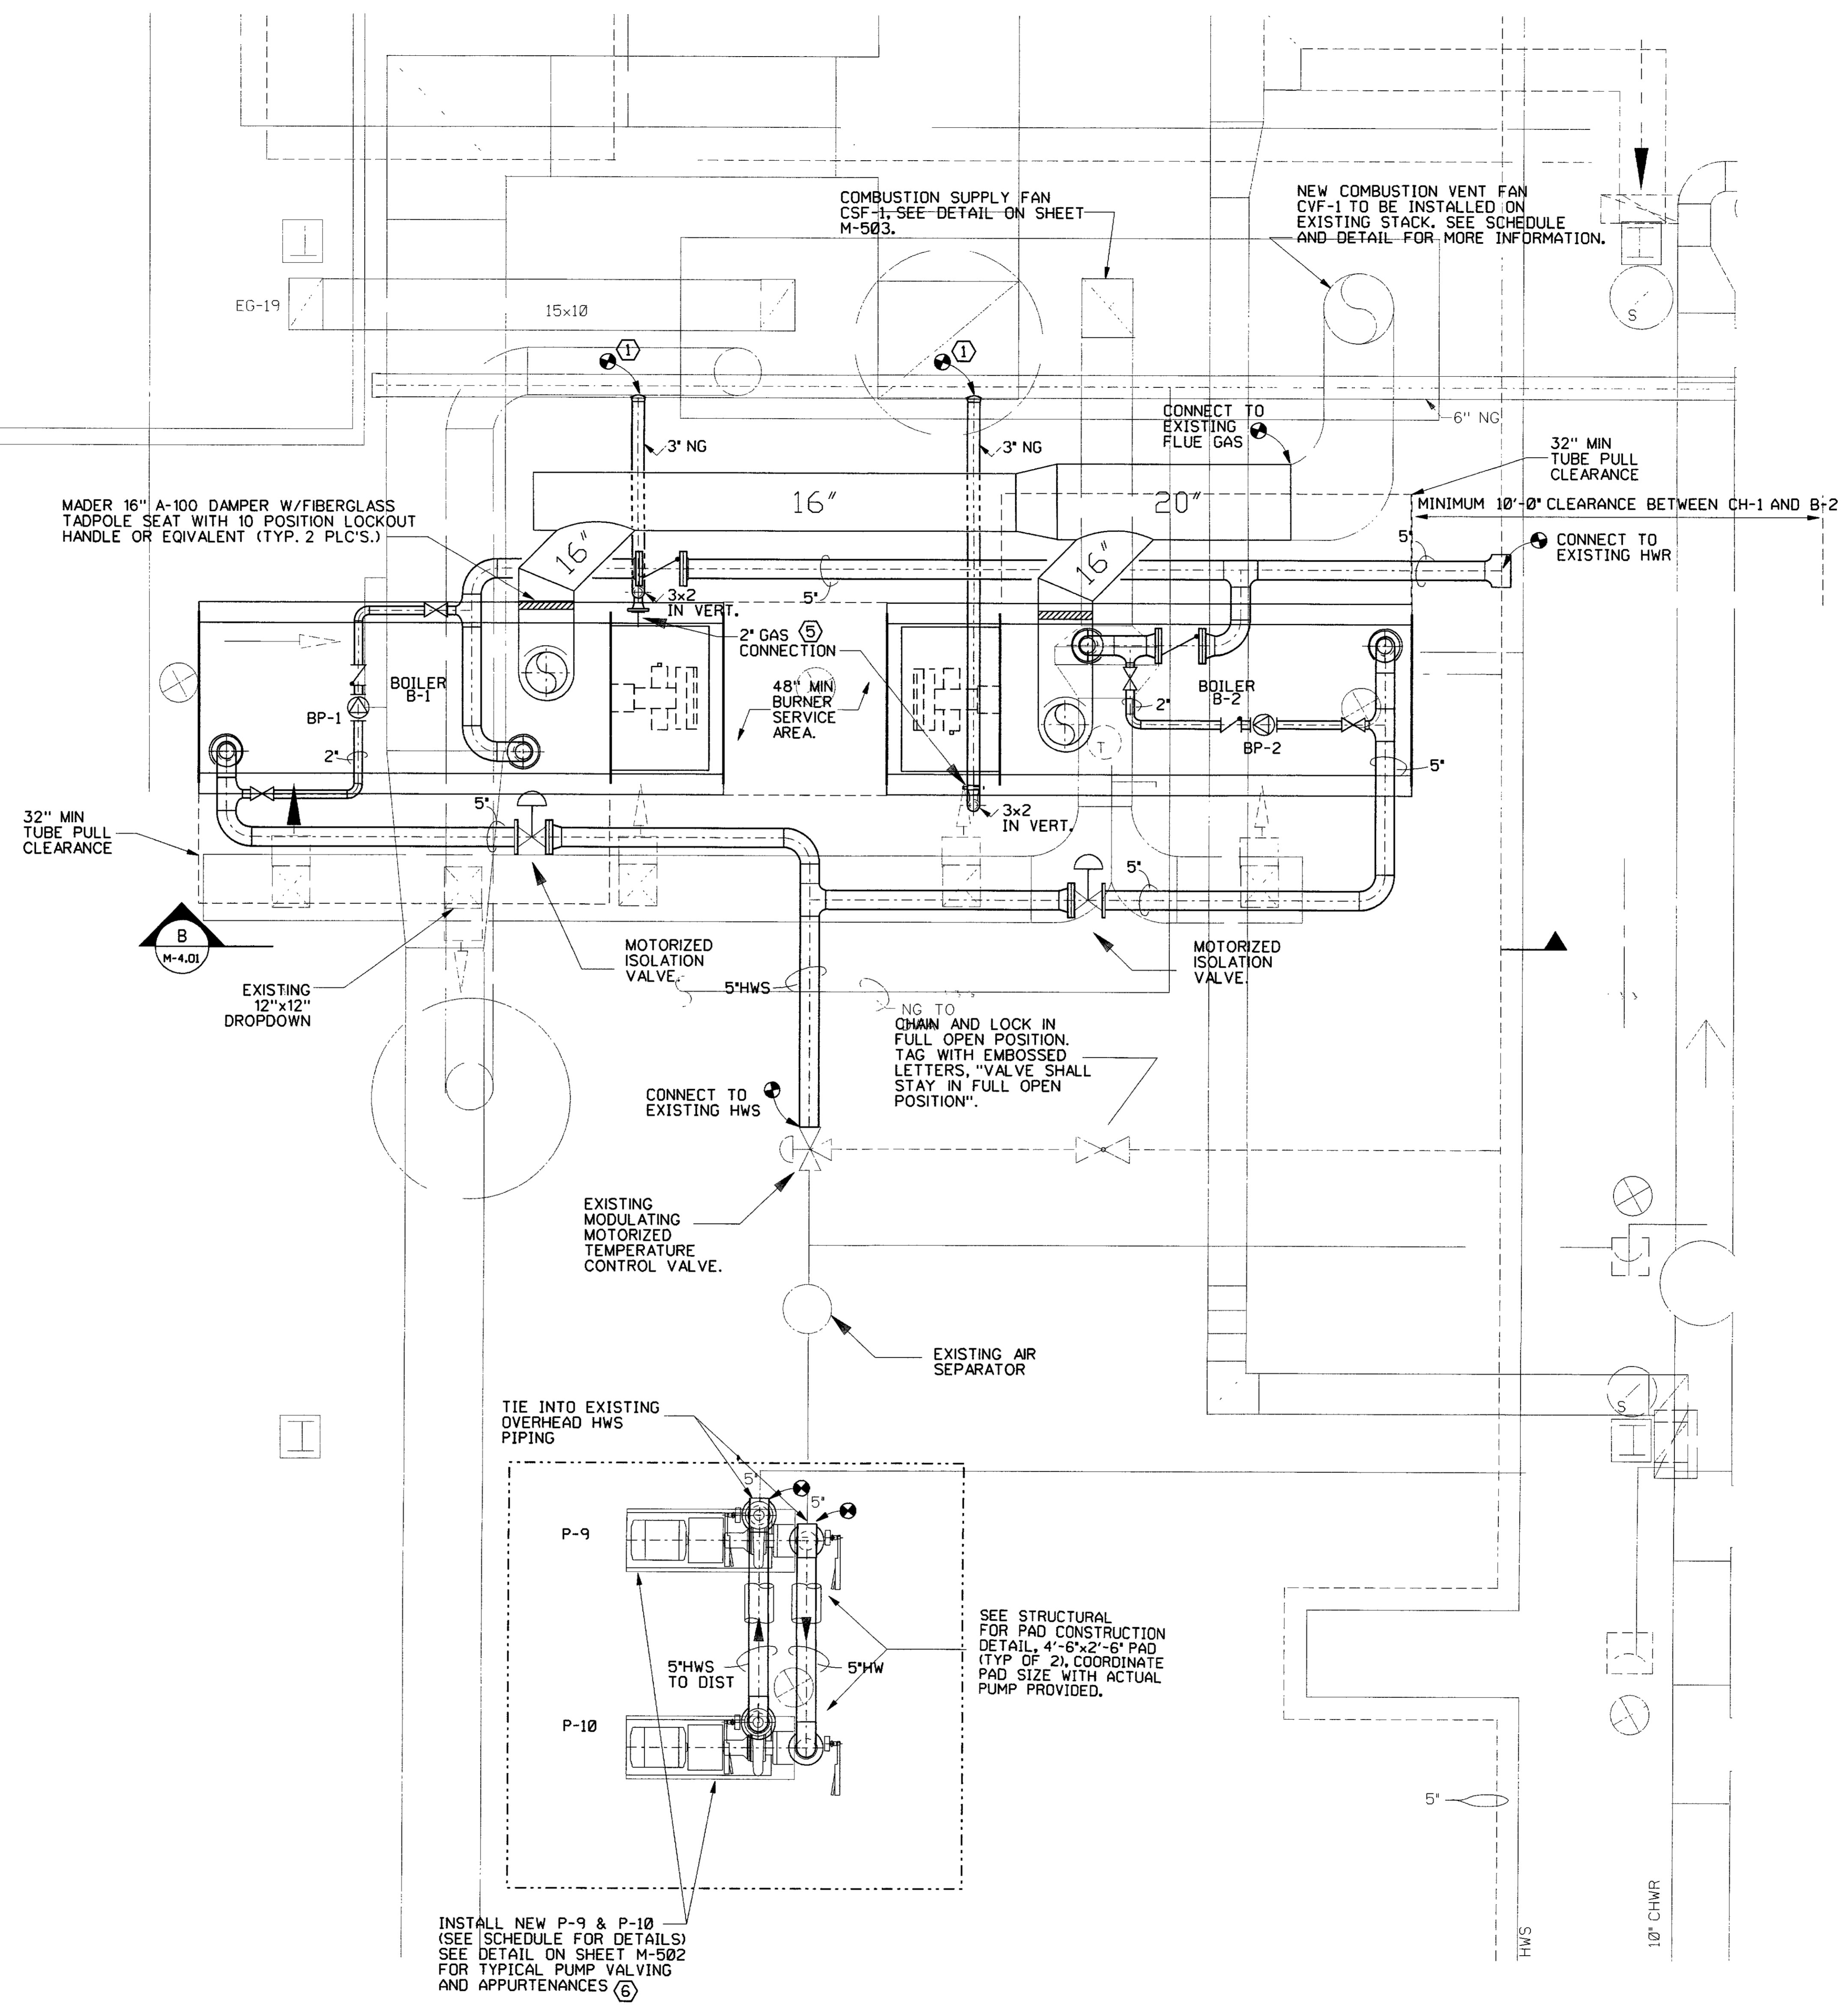

PARTIAL MECHANICAL ROOM HW NEW WORK

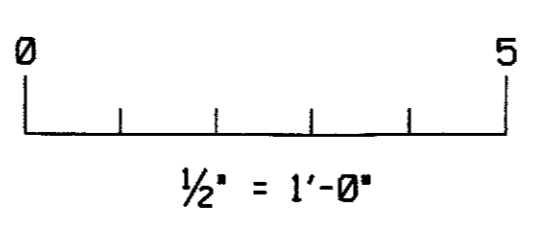

LEGEND
— NEW
— EXISTING
⊙ CONNECT TO EXISTING

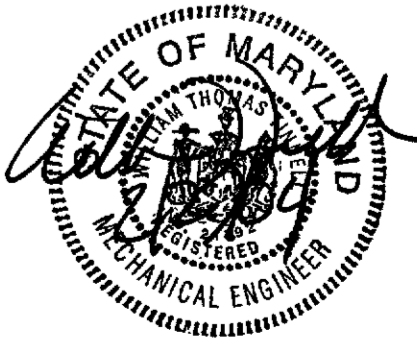

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I. C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITY STATEMENT ON COVER SHEET.