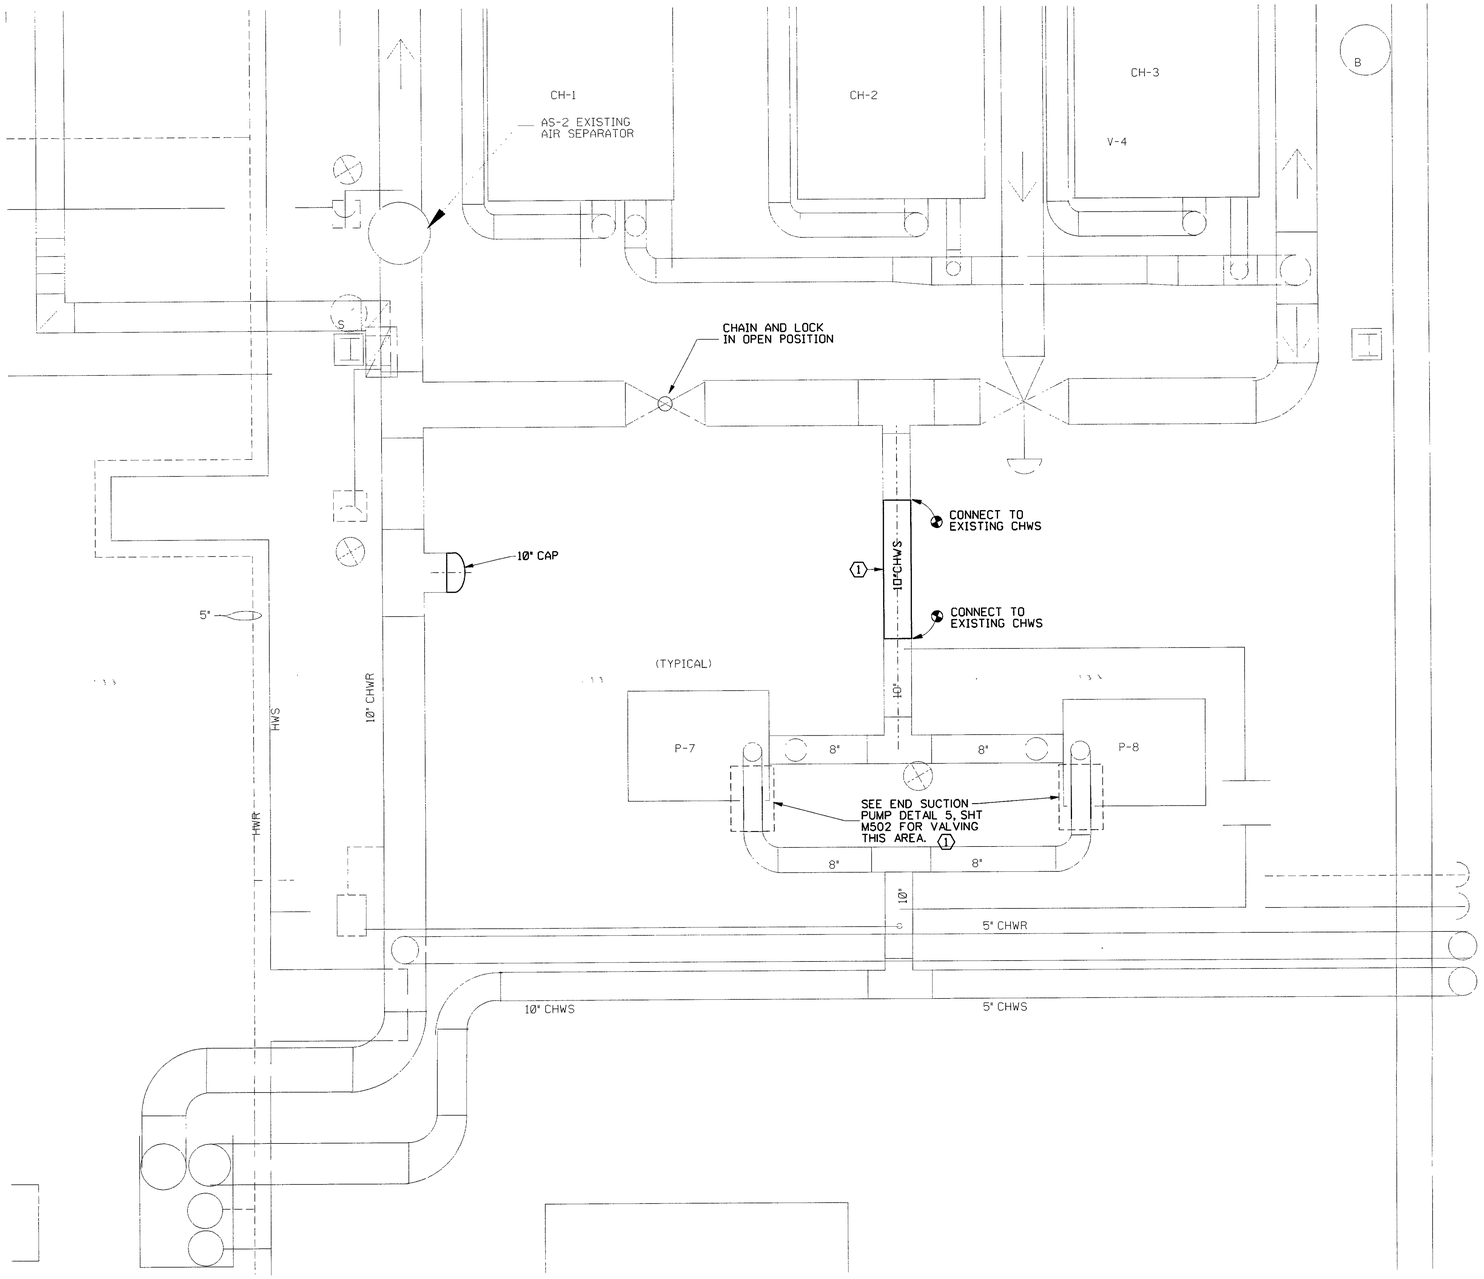

NOTES:

1. INSULATE CHWS&R PIPING PER SPECIFICATIONS. INSTALL ALUMINUM CLAD COVERING FOR ALL INSULATED PIPING TO 6 FT ABOVE FIN. FLR. PER SPECIFICATIONS.

PARTIAL MECHANICAL ROOM CHW NEW WORK

0 5

½" = 1'-0"

LEGEND
- NEW
- EXISTING
- CONNECT TO EXISTING

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIAIBILITIES STATEMENT ON COVER SHEET.

US ARMY ENGINEERING AND SUPPORT CENTER HUNTSVILLE

Symbol	Description	Date	Appr.

Symbol	Description	Date	Appr.

Date: 02/27/04
Checked by: WTT
CADD File Name: 312MA502.DGN
Dwn by: ICT
ICT Project No. 203121
DACA87-03-D-0006
Plot date: 02/27/04
Approved by:
Plot scale:
Chief, Prj. Mgmt. Division

TASK ORDER #: FRR004

ENGLAND THOMASSON

PADUCAH, KENTUCKY VOICE 270-442-8620

I.C. Thomasson Associates, Inc. NASHVILLE, TENNESSEE PHONE (615) 346-3400

ICT

DEFENSE INFORMATION SCHOOL
FT. MEADE
MARYLAND

MECHANICAL ROOM CHILLED WATER NEW WORK

STATE OF MARYLAND — MICHAEL T. WILLIAMS — No. 21435 — REGISTERED PROFESSIONAL MECHANICAL ENGINEER

Sheet reference number:
M-302