
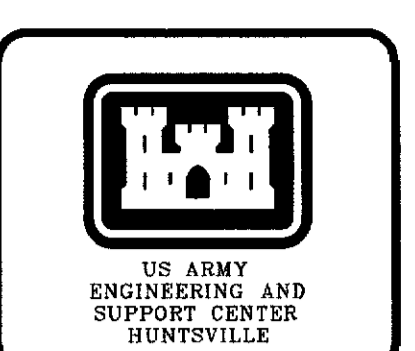
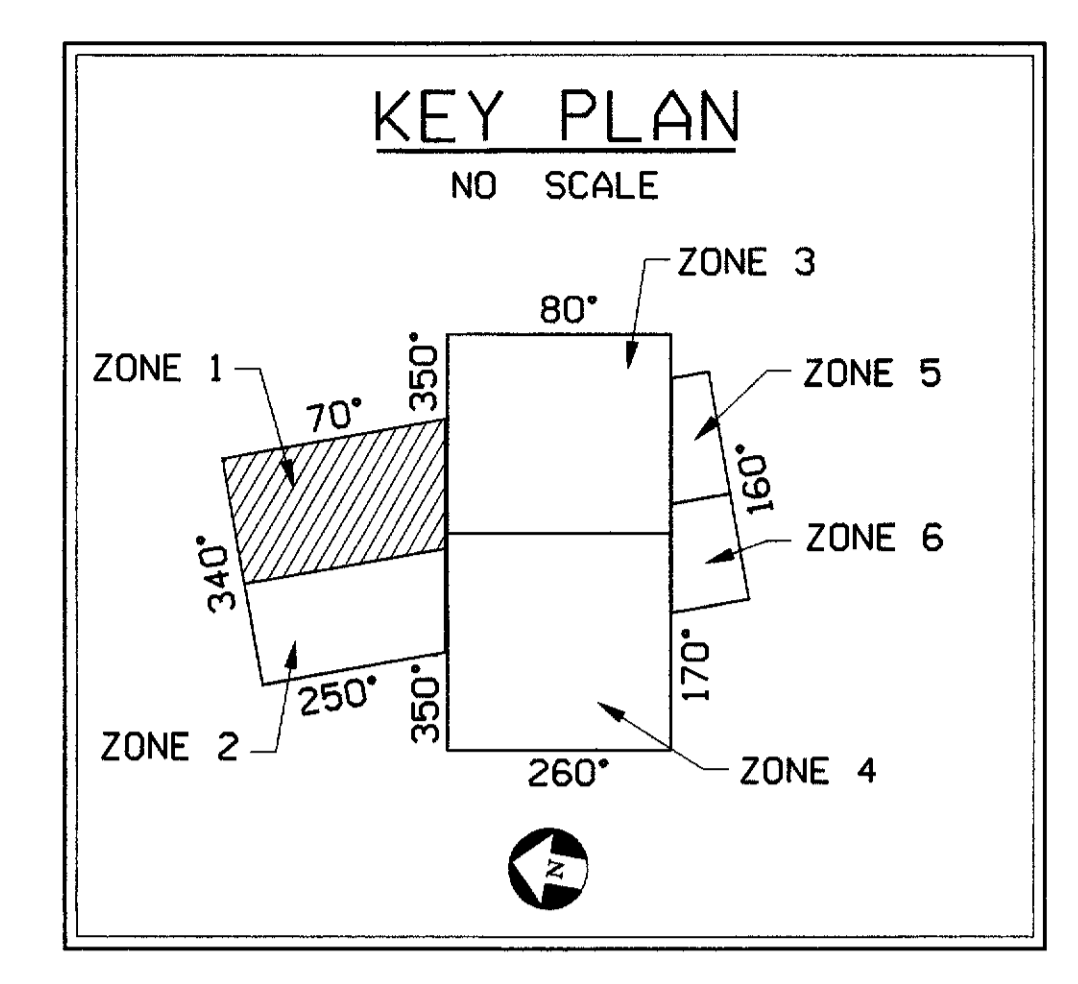


A B C D E F G H

6
5
4
3
2
1

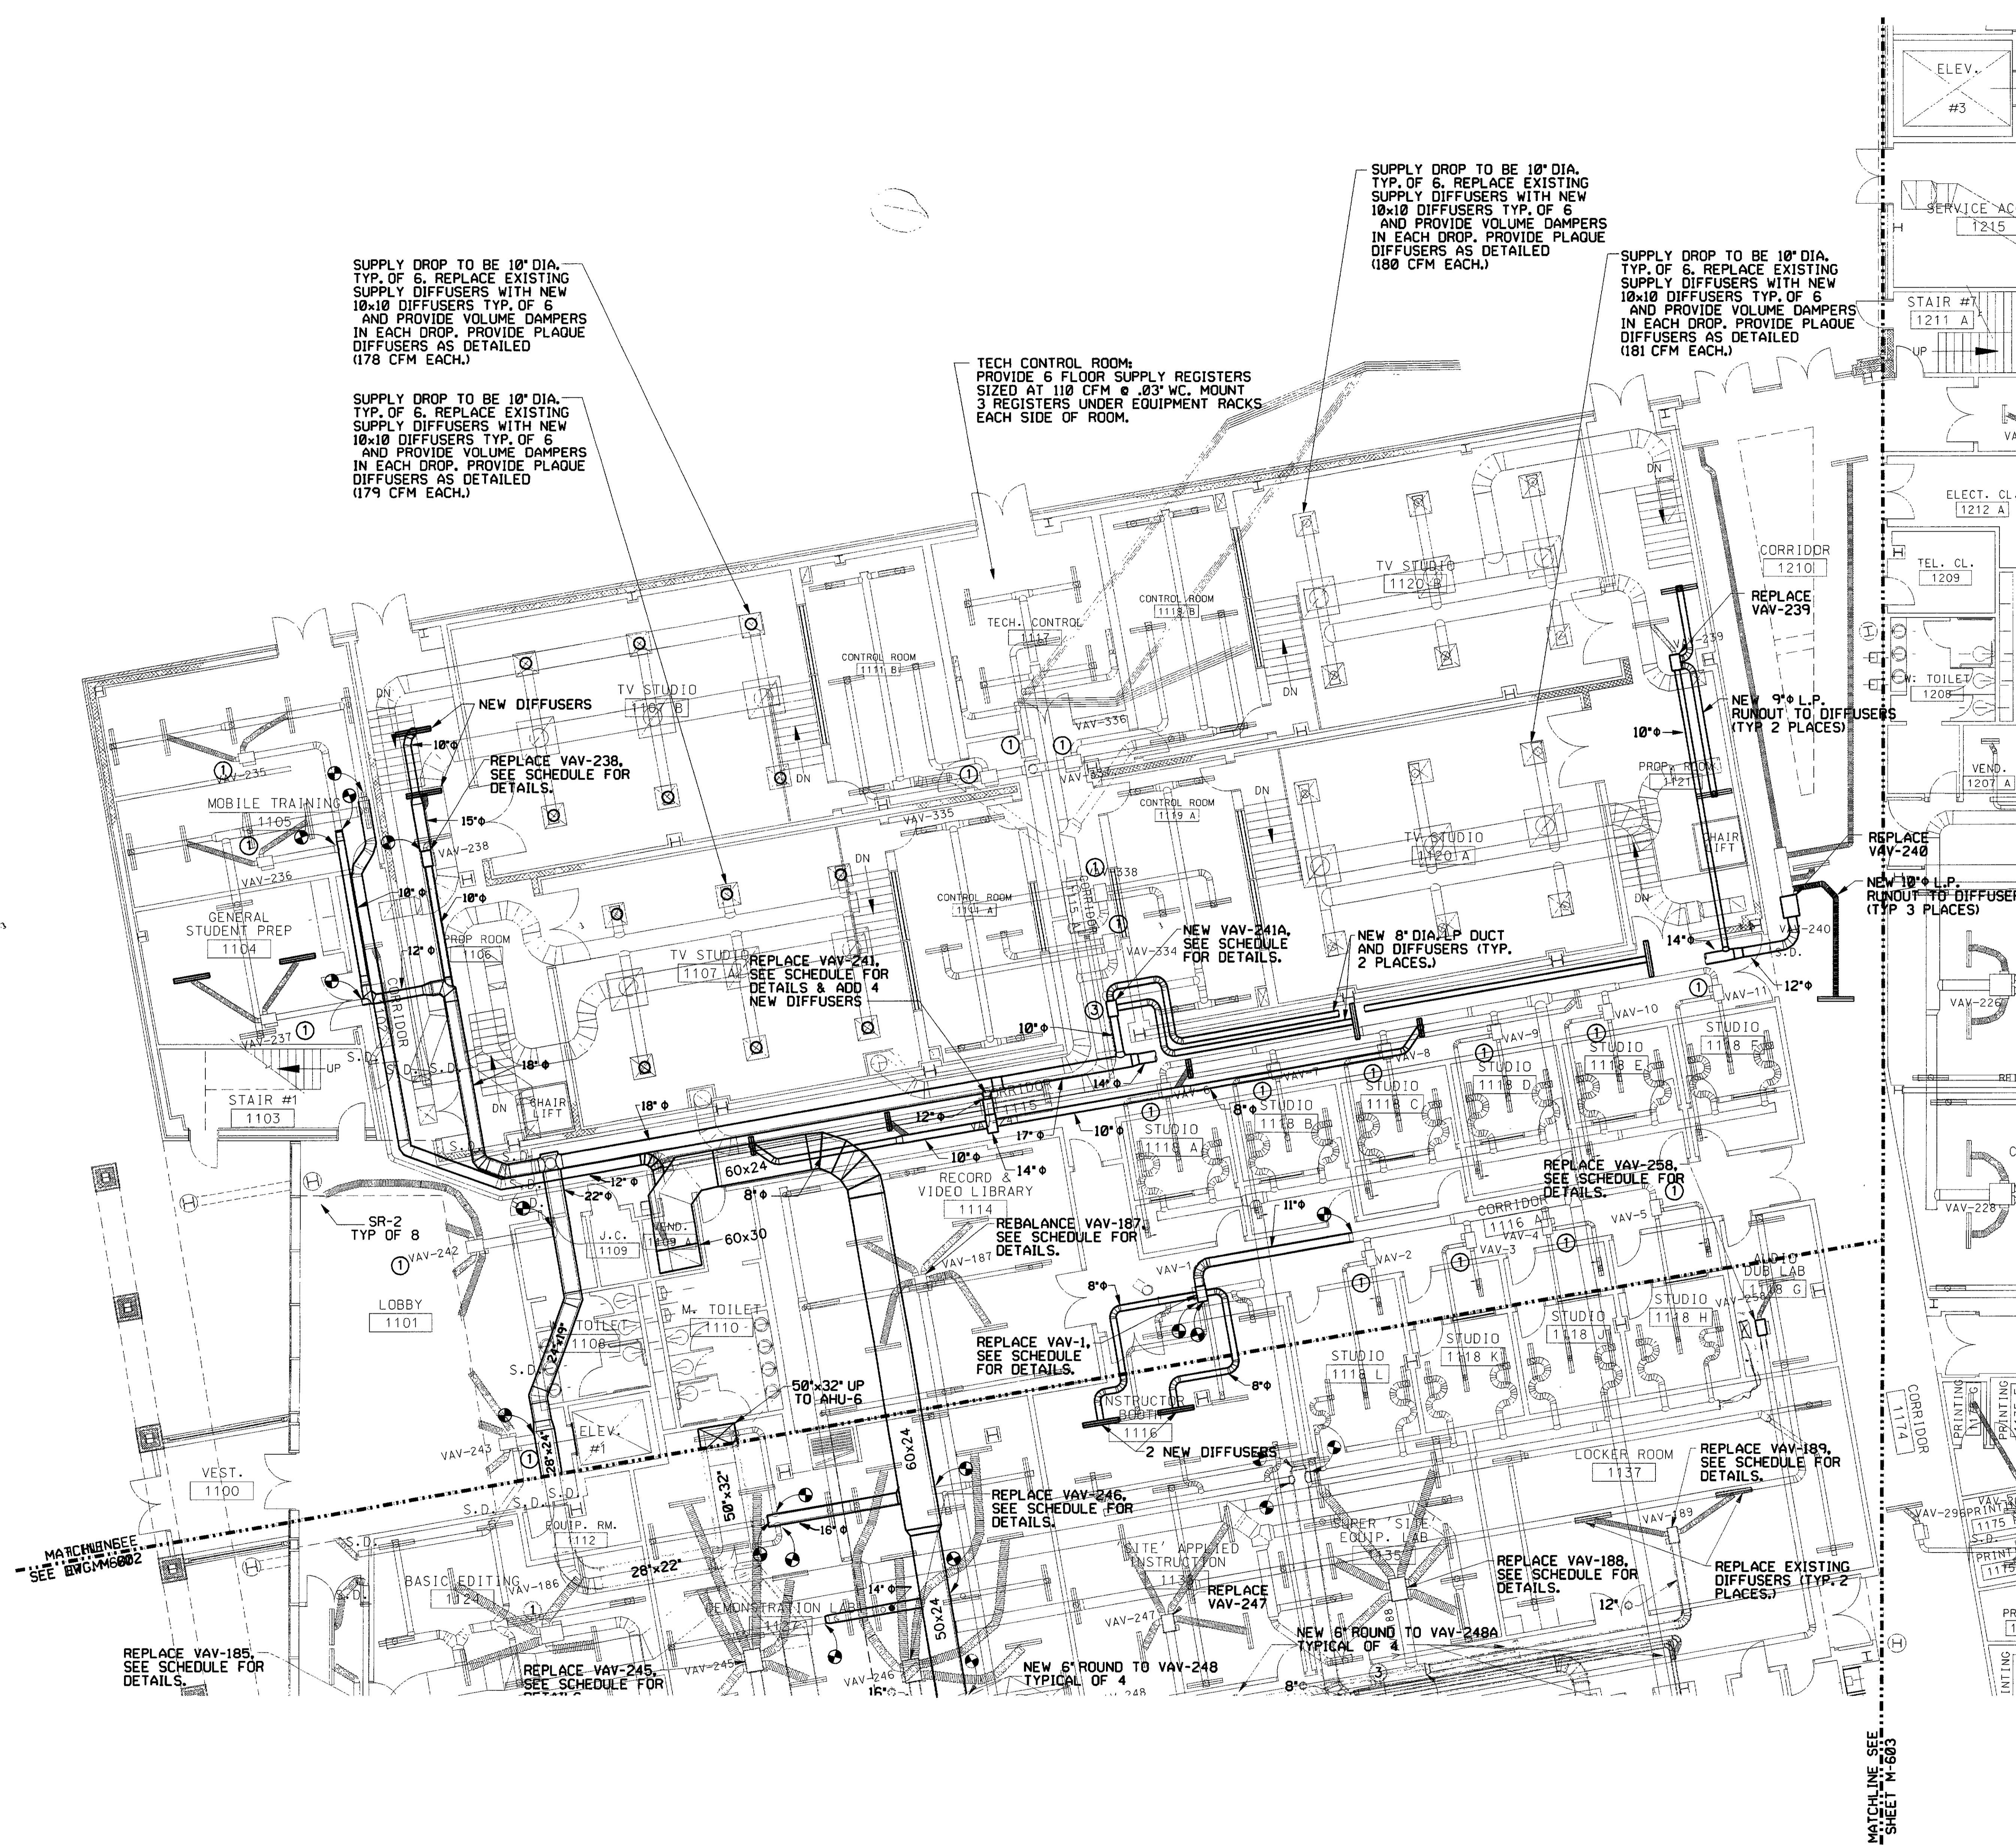


Date	Appr.	Description

Task Order #: FR0084	Checked by: WTT	Date: 02/27/04
FADUCAR, KENTUCKY	Dwn by: ICT	CADD File Name: 312M601.DGN
VOICE 270-442-8620	DAC487-03-D-0065	ICT Project No. 203121
I.C. Thomasson Associates, Inc.	Approved by:	Plot date: 02/27/04
NASHVILLE, TENNESSEE	Chief, Prj. Mgmt. Division	Plot scale:
PHONE (615) 346-3400		

LEGEND

- EXISTING _____
 - NEW _____
 - DEMO _____
- NOTE(S):**
- 1 REBALANCE VAV (AIR AND HOT WATER FLOW) PER VAV BOX SCHEDULE.
 - 2 REPLACE VAV BOX SHOWN AS NEW. SEE VAV BOX SCHEDULE FOR DETAILS.
 - 3 NEW VAV BOX. RUN NEW MP DUCT, HOTWATER PIPING ELECTRICAL WIRE AND CONDUIT TO BOX. BALANCE PER SCHEDULE.

ZONE No. 1 - 1st FLOOR HVAC

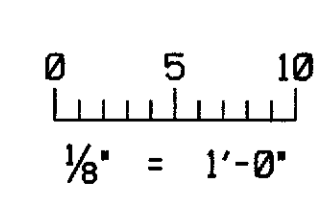

DEFENSE INFORMATION SCHOOL
 FT. MEADE MARYLAND
 ZONE 1 - 1st FLOOR HVAC

Sheet reference number:
M-601

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITY STATEMENT ON COVER SHEET.