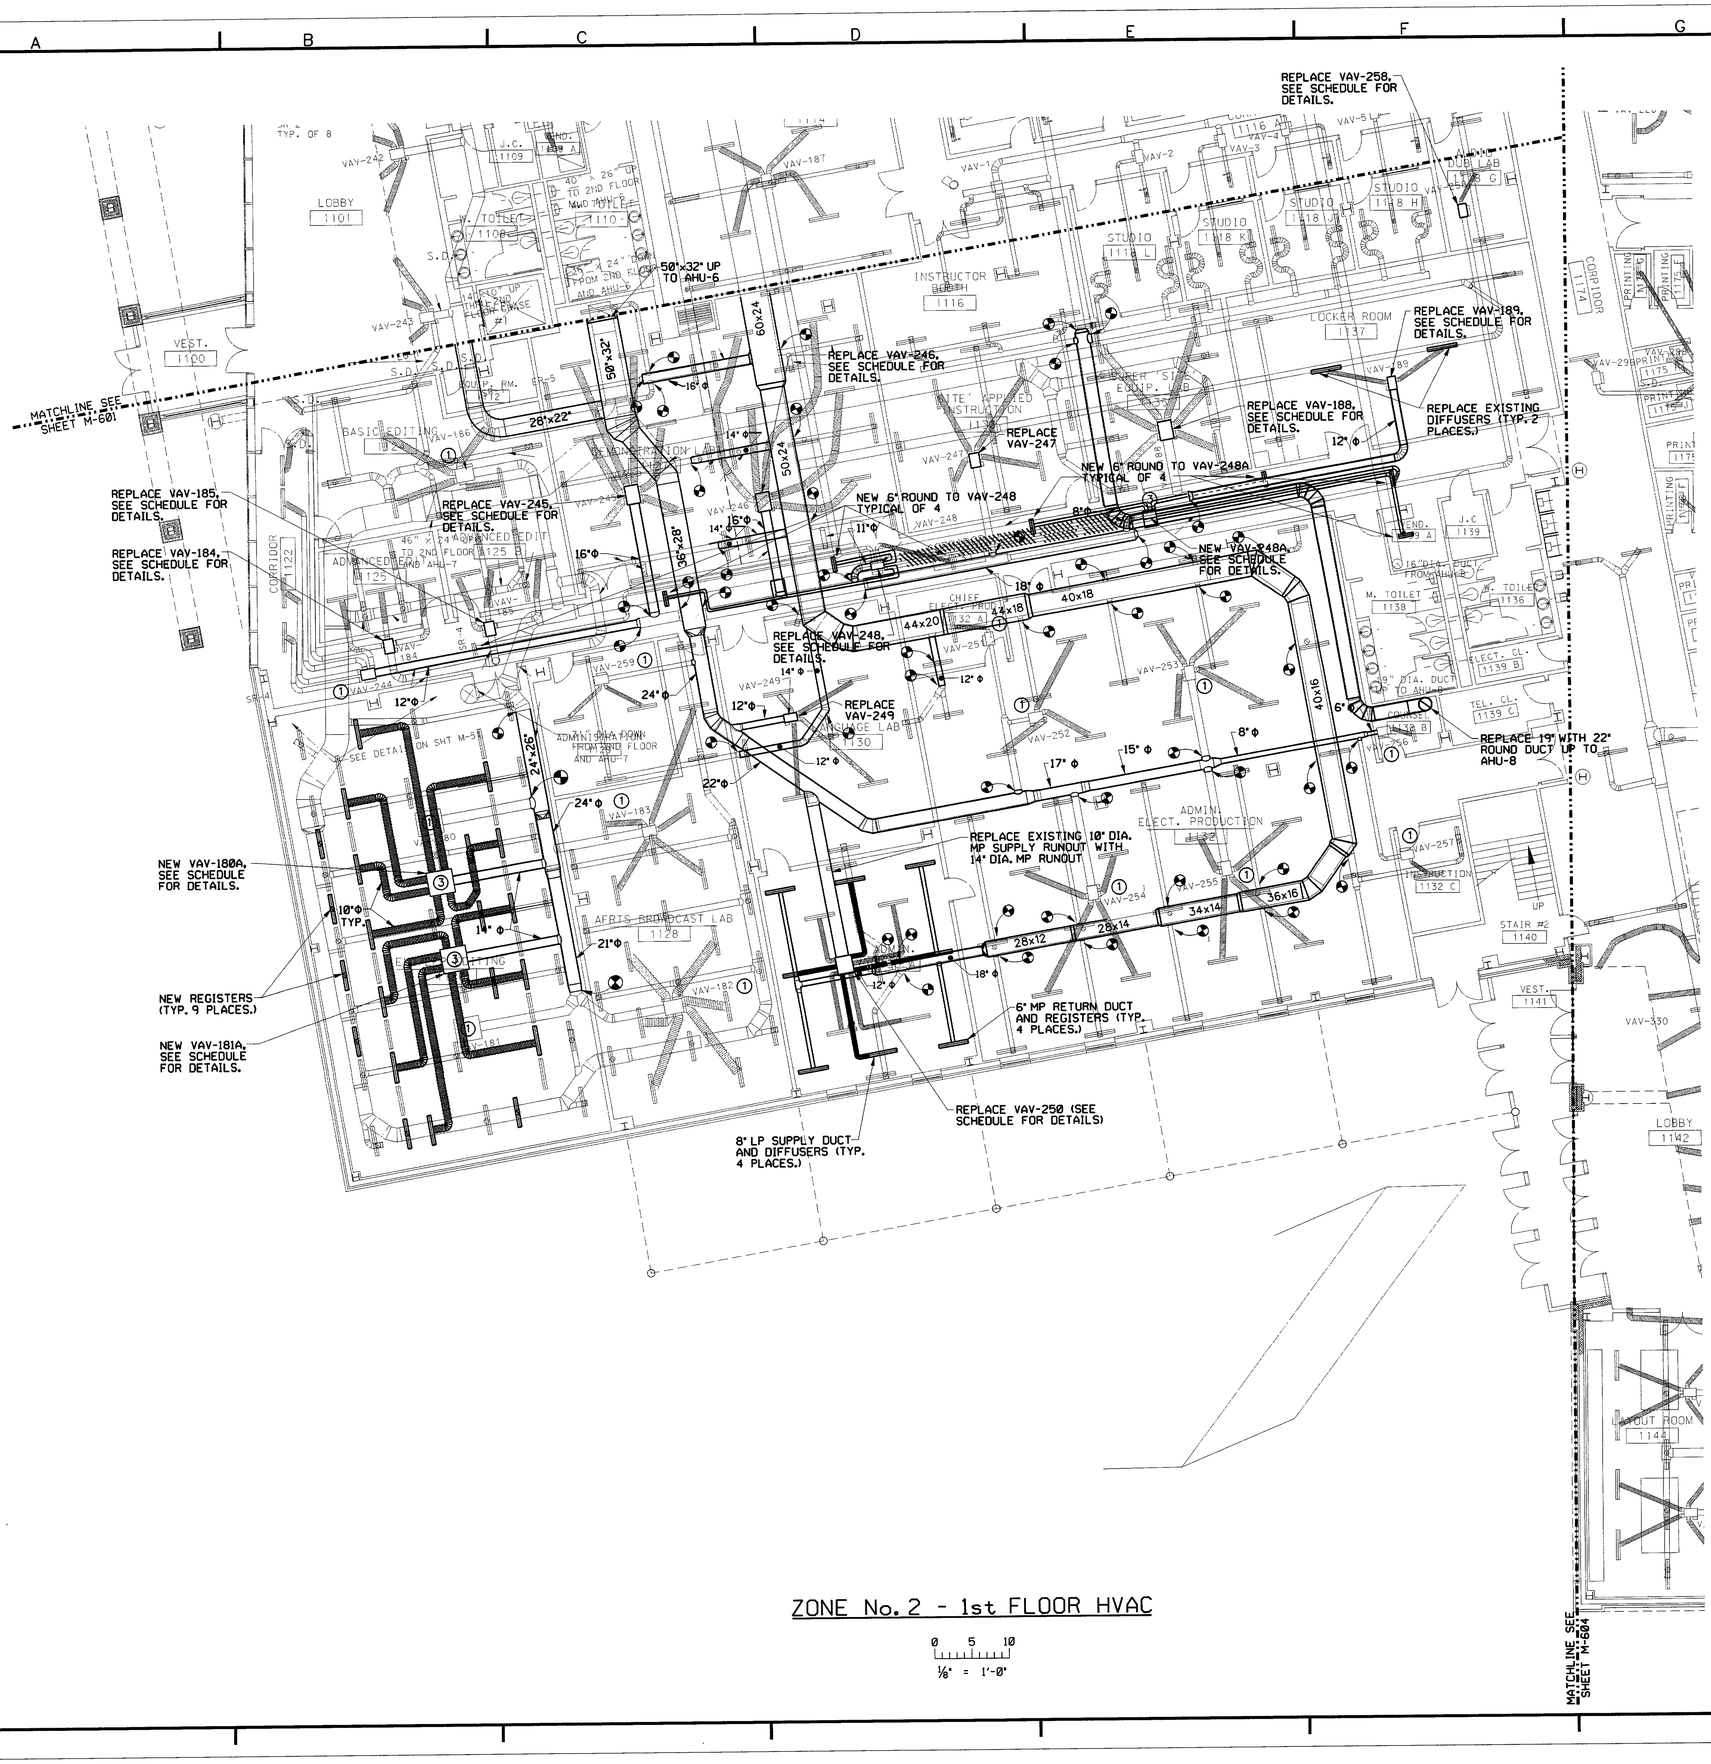

ZONE No. 2 - 1st FLOOR HVAC

0 5 10

1/8" = 1'-0"

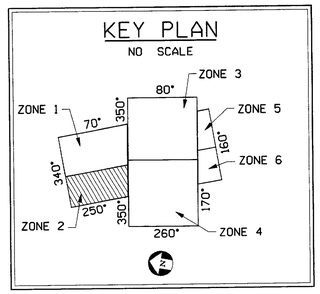

LEGEND

EXISTING

NEW

DEMO

NOTE(S):

1. REBALANCE VAV (AIR AND HOT WATER FLOW) PER VAV BOX SCHEDULE.
2. REPLACE VAV BOX SHOWN AS NEW. SEE VAV BOX SCHEDULE FOR DETAILS.
3. NEW VAV BOX. RUN NEW MP DUCT, HOTWATER PIPING ELECTRICAL WIRE AND CONDUIT TO BOX. BALANCE PER SCHEDULE.

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIAIBILITIES STATEMENT ON COVER SHEET.

US ARMY ENGINEERING AND SUPPORT CENTER HUNTSVILLE

Symbol	Description	Date	Appr.	Symbol	Description	Date	Appr.

Checked by: WTT
Date: 02/27/04
Dwn by: ICT
CADD File Name: 312IM602.DGN
DACA87-03-D-0006
ICT Project No. 203121
Approved by:
Plot date: 02/27/04
Chief, Prj. Mgmt. Division
Plot scale:

TASK ORDER #: FRR004

VANGUARD
PADUCAH, KENTUCKY
VOICE 270-442-8620

I.C. Thomasson Associates, Inc.
NASHVILLE, TENNESSEE
PHONE (615) 346-3400

ICT

DEFENSE INFORMATION SCHOOL

FT. MEADE MARYLAND

ZONE 2 - 1st FLOOR HVAC

Sheet reference number:

M-602