

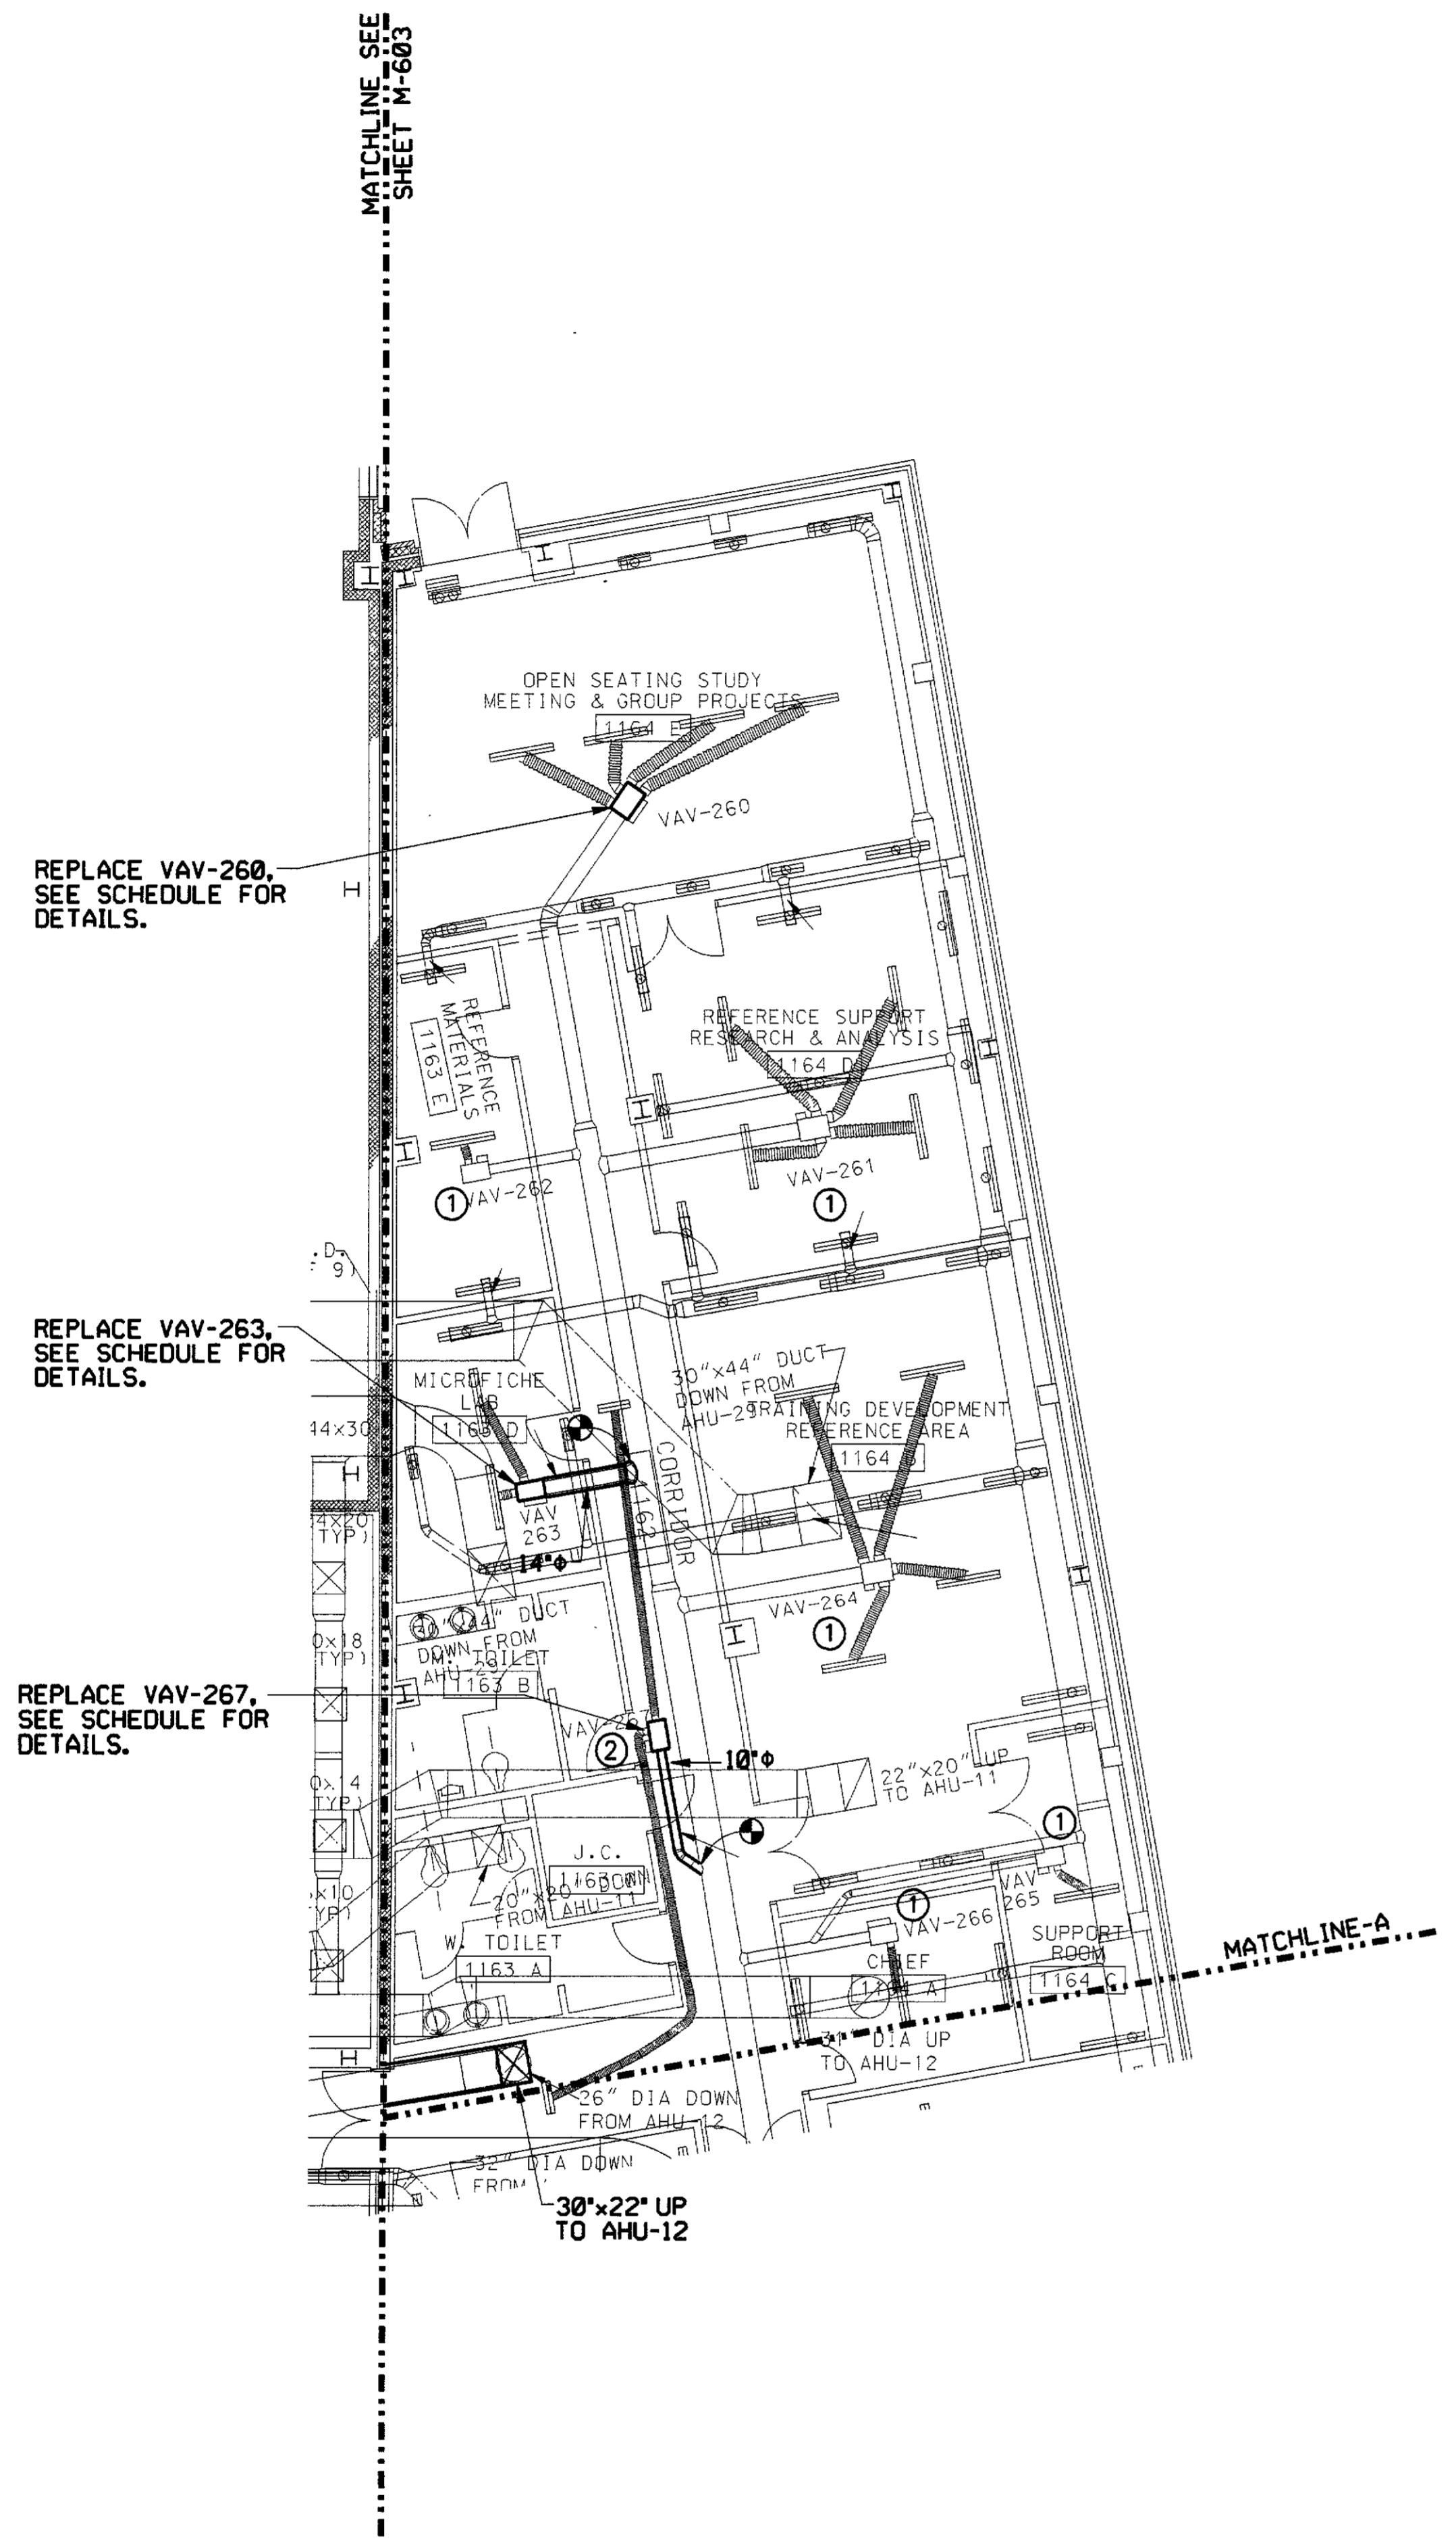


A B C D E F G H



6
5
4
3
2
1

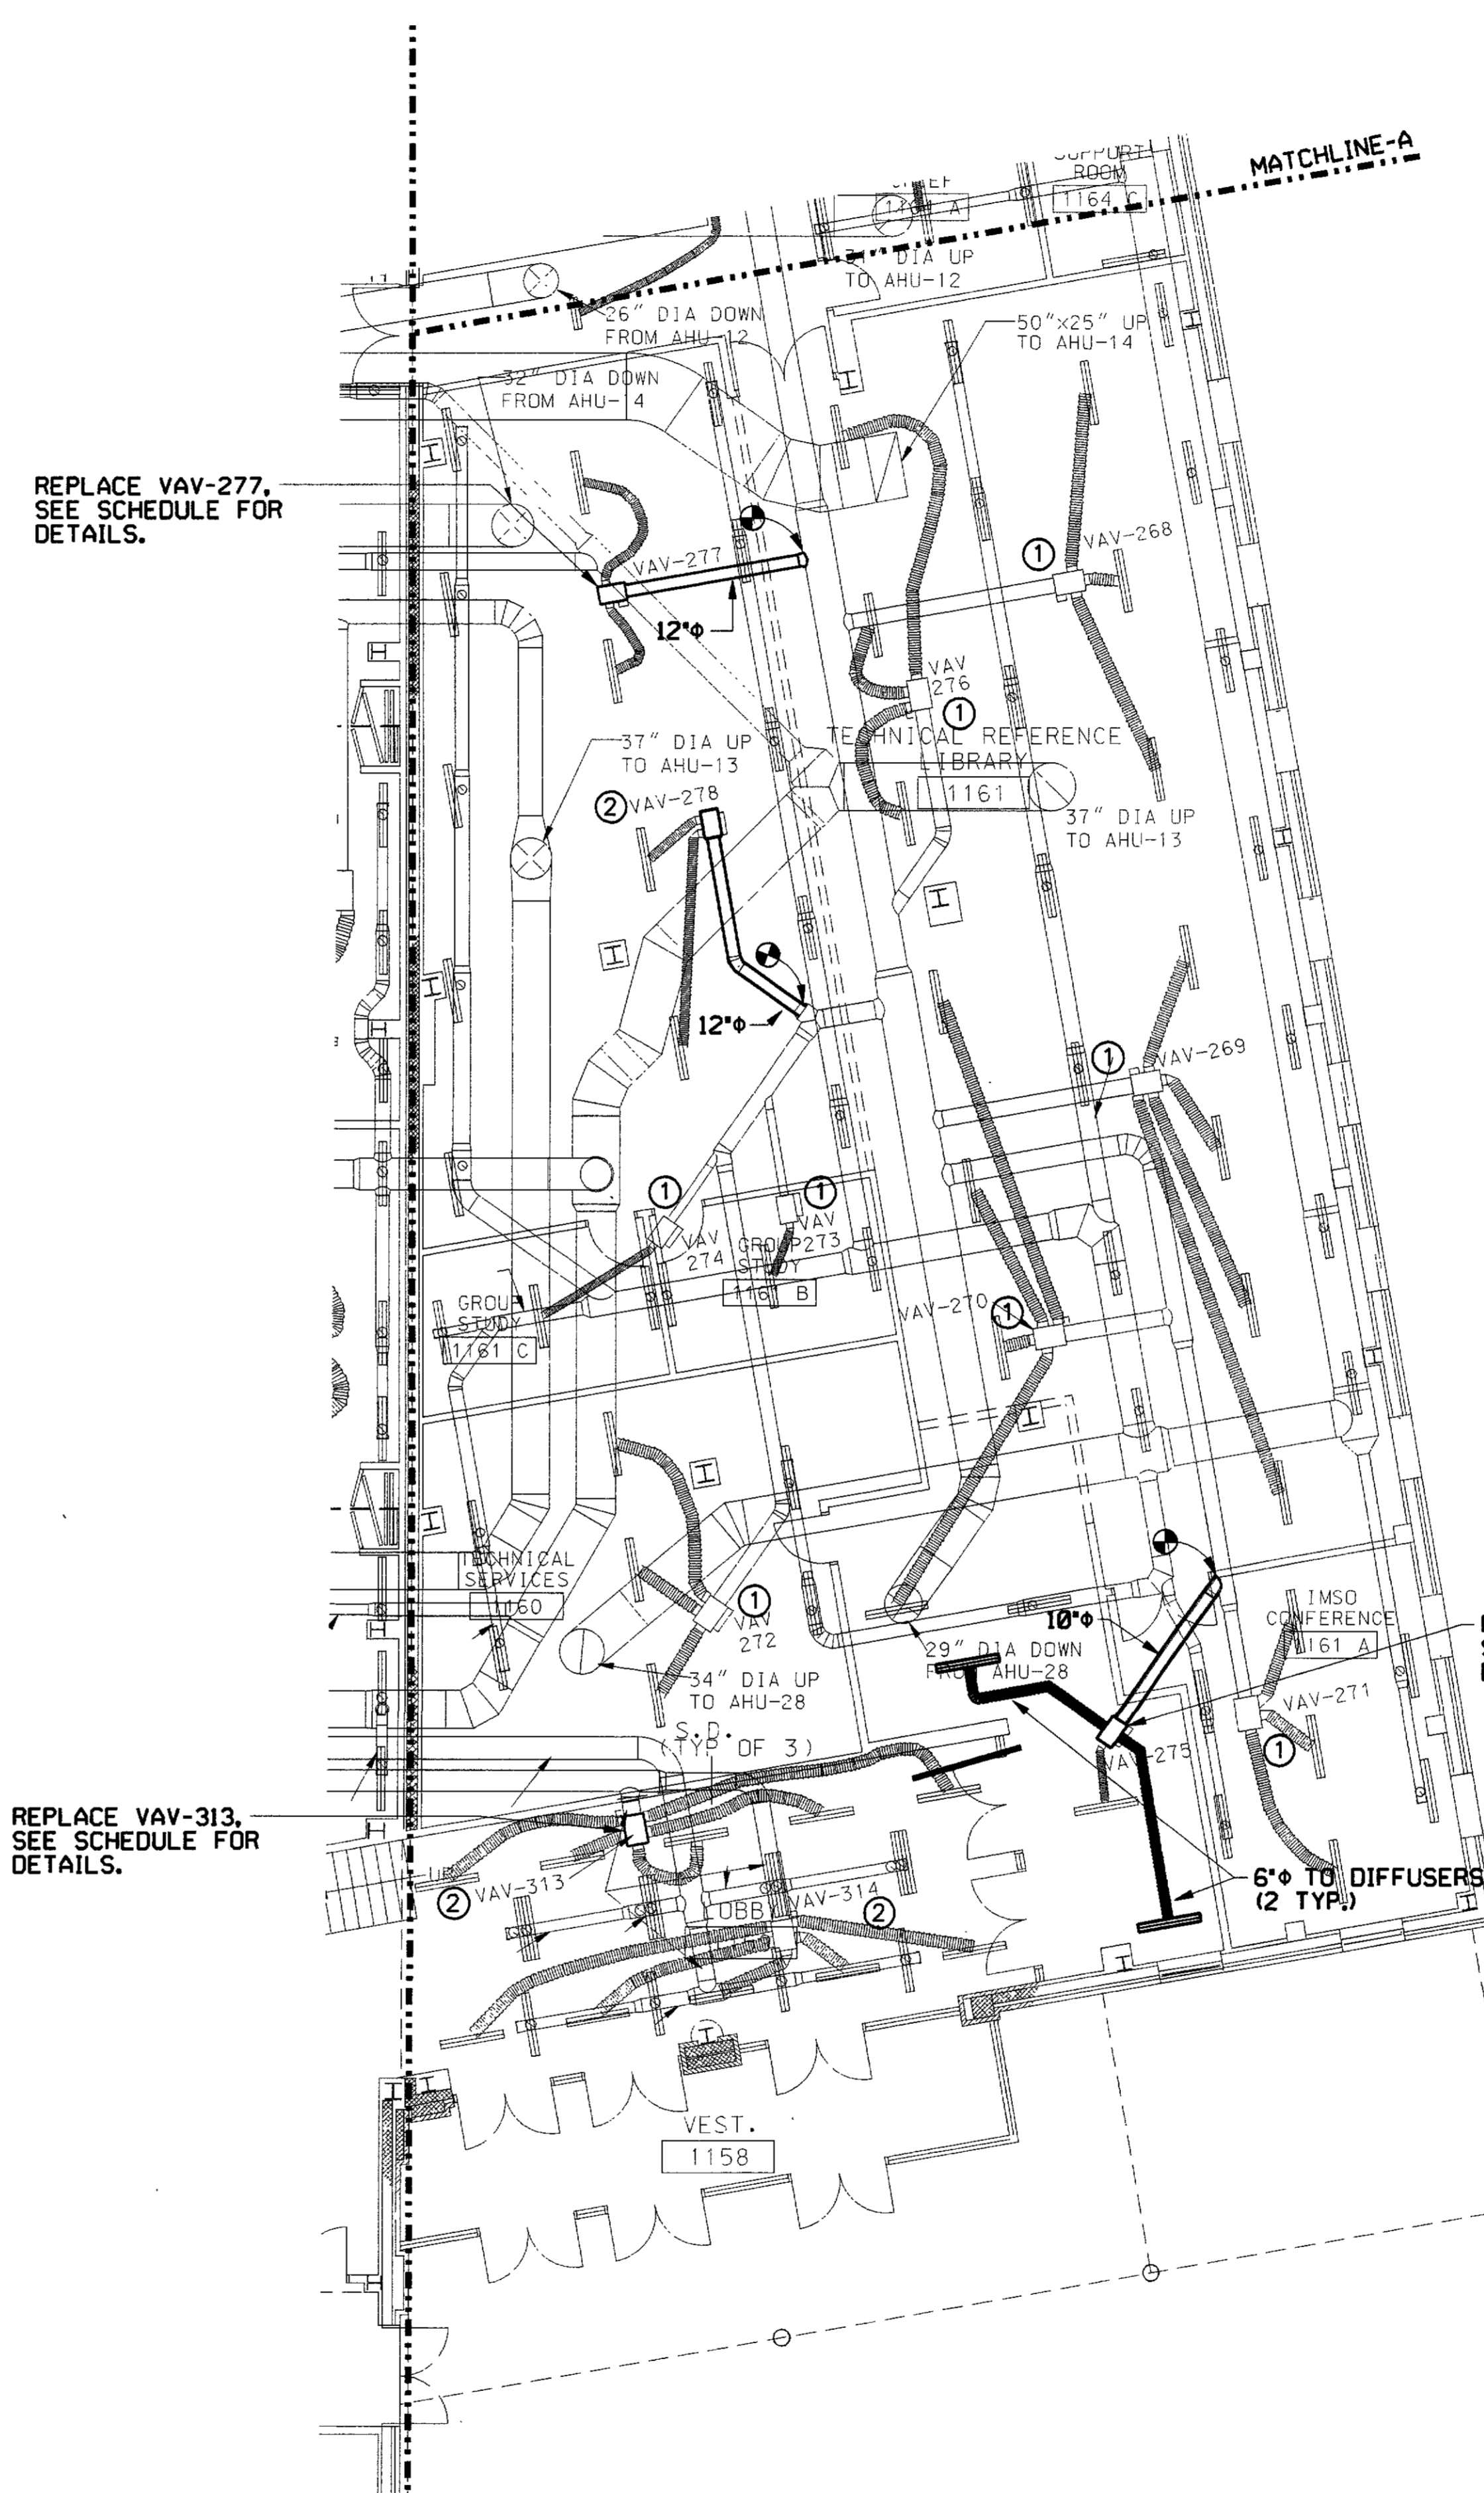

ZONE No. 5 - 1st FLOOR HVAC

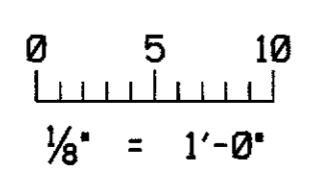

ZONE No. 6 - 1st FLOOR HVAC

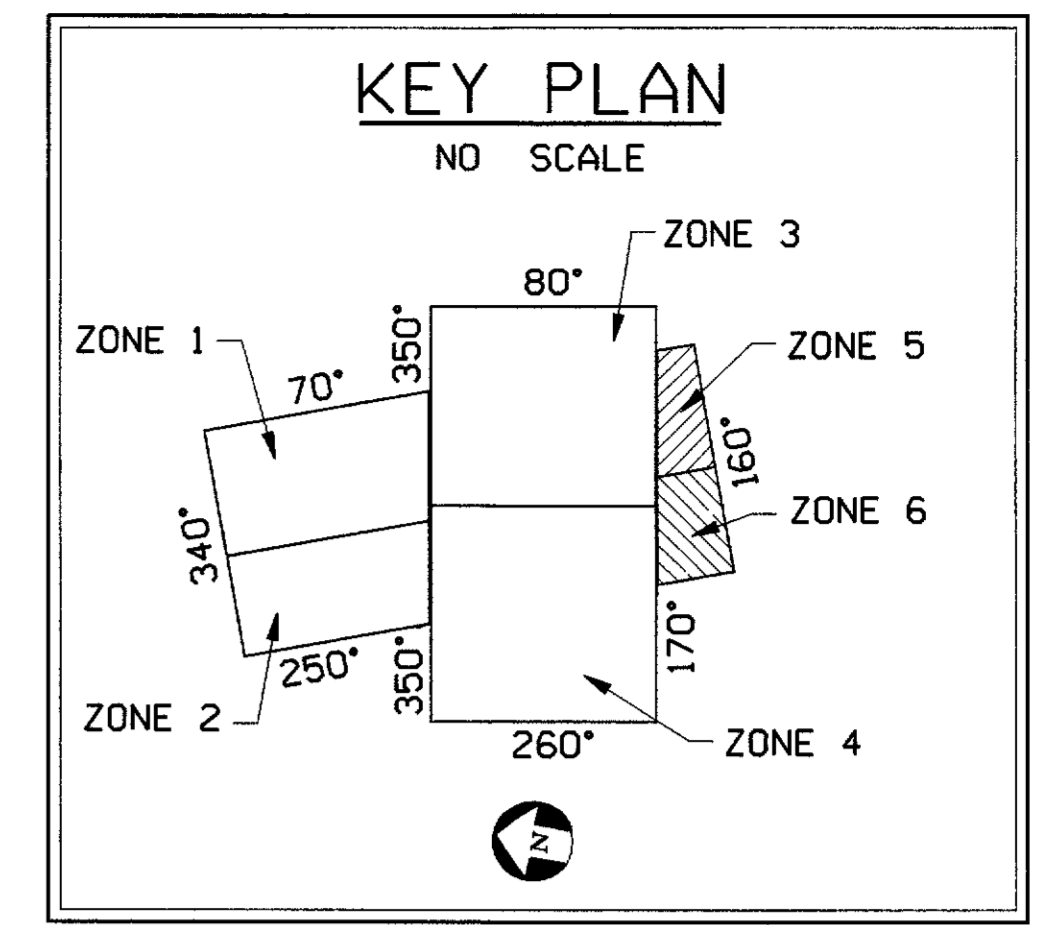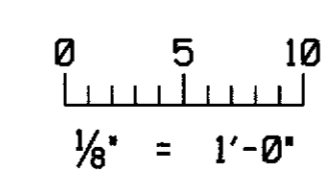

REPLACE VAV-277, SEE SCHEDULE FOR DETAILS.

REPLACE VAV-313, SEE SCHEDULE FOR DETAILS.

REPLACE VAV-275, SEE SCHEDULE FOR DETAILS.

LEGEND

- EXISTING _____
- NEW _____
- DEMO //////////////

NOTE(S):

- 1 REBALANCE VAV (AIR AND HOT WATER FLOW PER VAV BOX SCHEDULE).
- 2 REPLACE VAV BOX SHOWN AS NEW. SEE VAV BOX SCHEDULE FOR DETAILS.



Description	Date	Appr.	Symbol	Date	Appr.

Checked by: WTT	Date: 02/27/04
Drawn by: ICT	CADD File Name: 312 M605.DGN
DACAB7-03-D-0006	ICT Project No. 203121
Approved by: Chief, Proj. Mgmt. Division	Plot date: 02/27/04
TASK ORDER #: FFR004 PADUCAH, KENTUCKY VOICE 270-442-8620 J.C. Thomasson, Inc. NASHVILLE, TENNESSEE PHONE (615) 346-3400 	

DEFENSE INFORMATION SCHOOL MARYLAND
 FT. MEADE
 ZONE 5 & 6 - 1st FLOOR
 HVAC



THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. J.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITY STATEMENT ON COVER SHEET.

Sheet reference number:
M-605