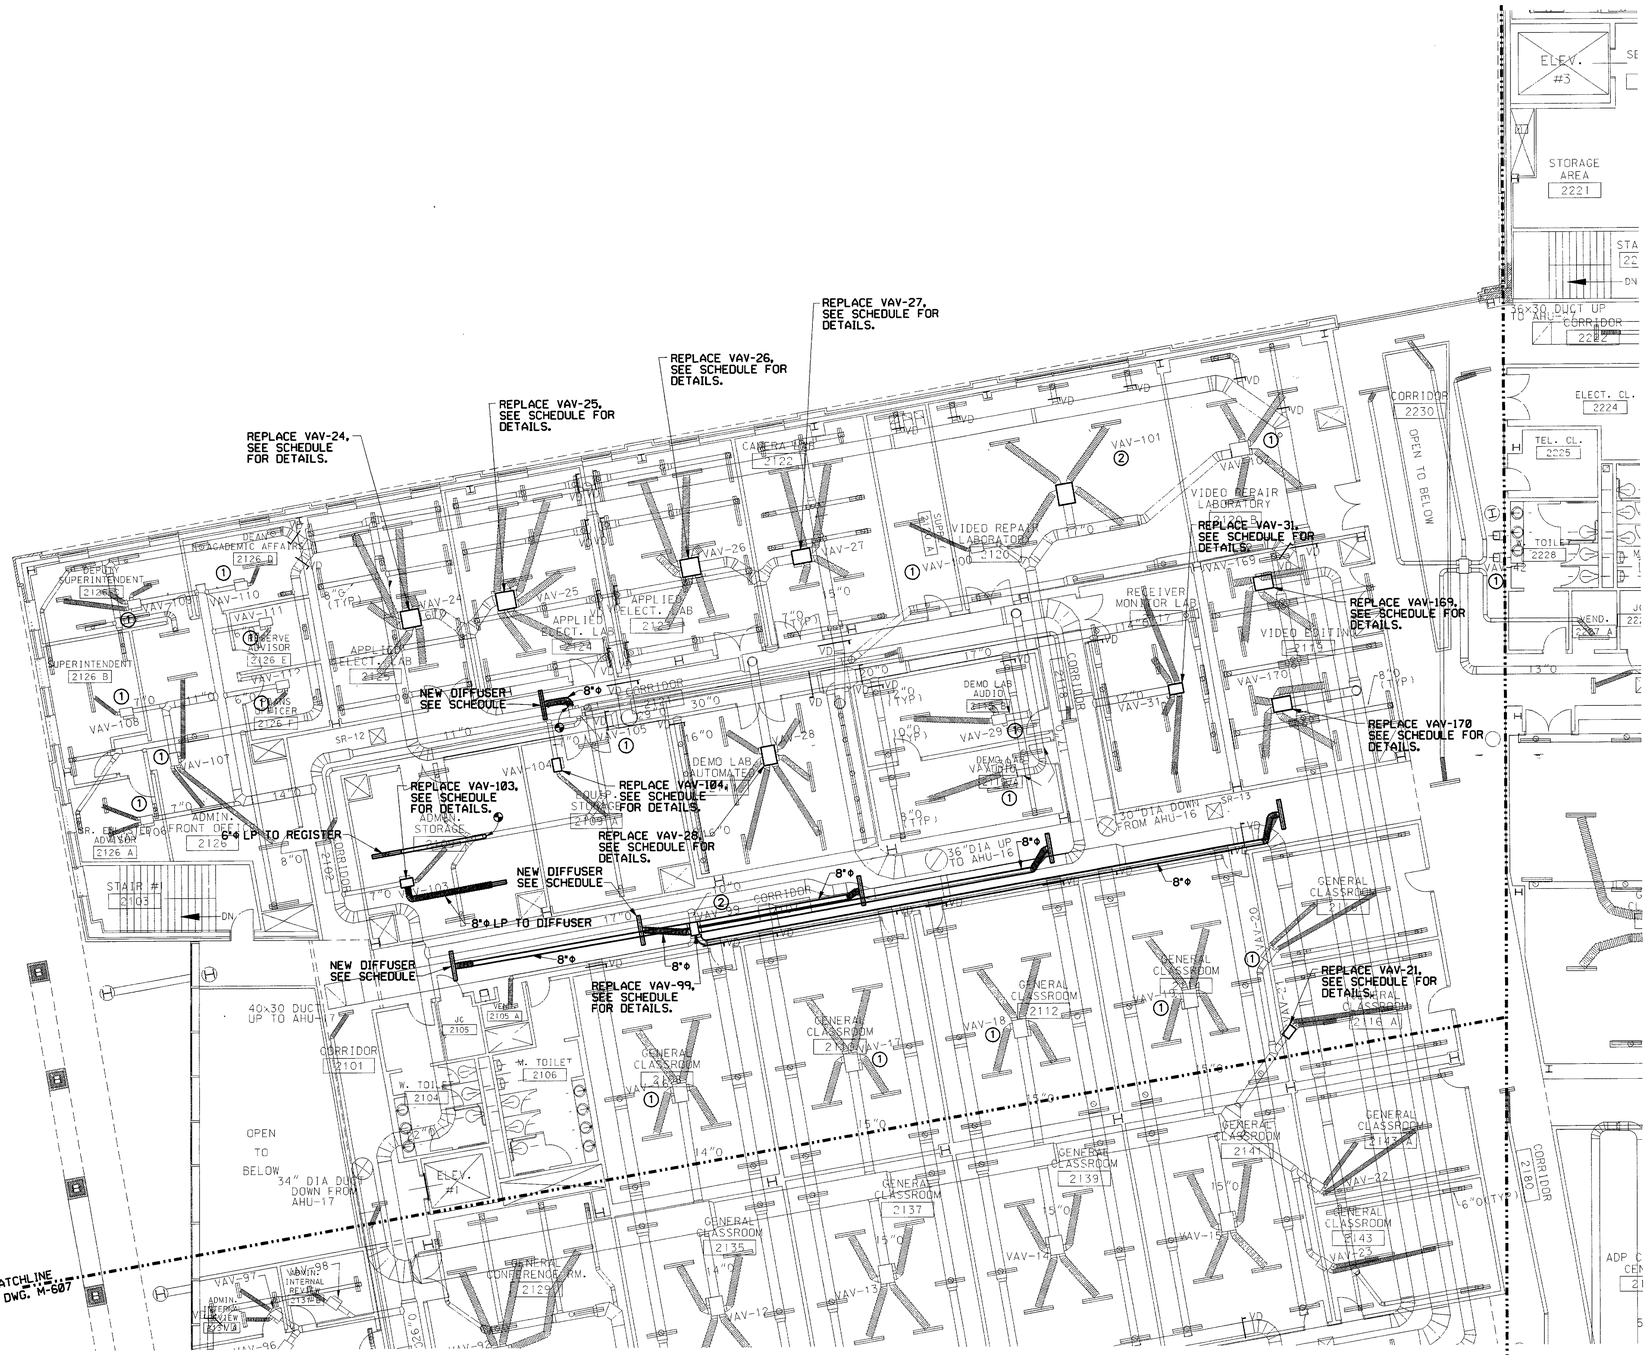

ZONE No. 1 - 2nd FLOOR HVAC

0 5 10

1/8" = 1'-0"

KEY PLAN

NO SCALE

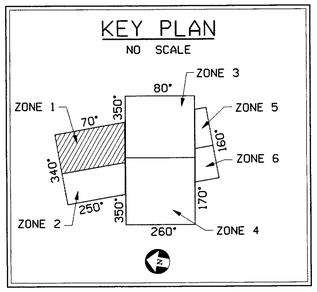

LEGEND

EXISTING

NEW

DEMO

NOTE(S):

1. REBALANCE VAV (AIR AND HOT WATER FLOW) PER VAV BOX SCHEDULE.
2. REPLACE VAV BOX SHOWN AS NEW. SEE VAV BOX SCHEDULE FOR DETAILS.

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITIES STATEMENT ON COVER SHEET.

US ARMY ENGINEERING AND SUPPORT CENTER HUNTSVILLE

Symbol	Description	Date	Appr.

TASK ORDER #: FRR004

PADUCAH, KENTUCKY VOICE 270-442-8620

I.C. THOMASSON Associates, Inc. NASHVILLE, TENNESSEE PHONE (615) 346-3400

VANGUARD ICT

Checked by: WTT | Date: 02/27/04

Dwn by: ICT | CADD File Name: 312M606.DGN

DACA87-03-D-0006 | ICT Project No. 203121

Approved by: Chief, Prj. Mgmt. Division | Plot date: 02/27/04 | Plot scale:

DEFENSE INFORMATION SCHOOL
FT. MEADE MARYLAND

ZONE 1 - 2nd FLOOR HVAC

STATE OF MARYLAND — WILLIAM T. THOMASSON — 21677 — MECHANICAL ENGINEER

Sheet reference number:

M-606