


## ZONE No. 4 - 2nd FLOOR HVAC

0 5 10
1/8" = 1'-0"

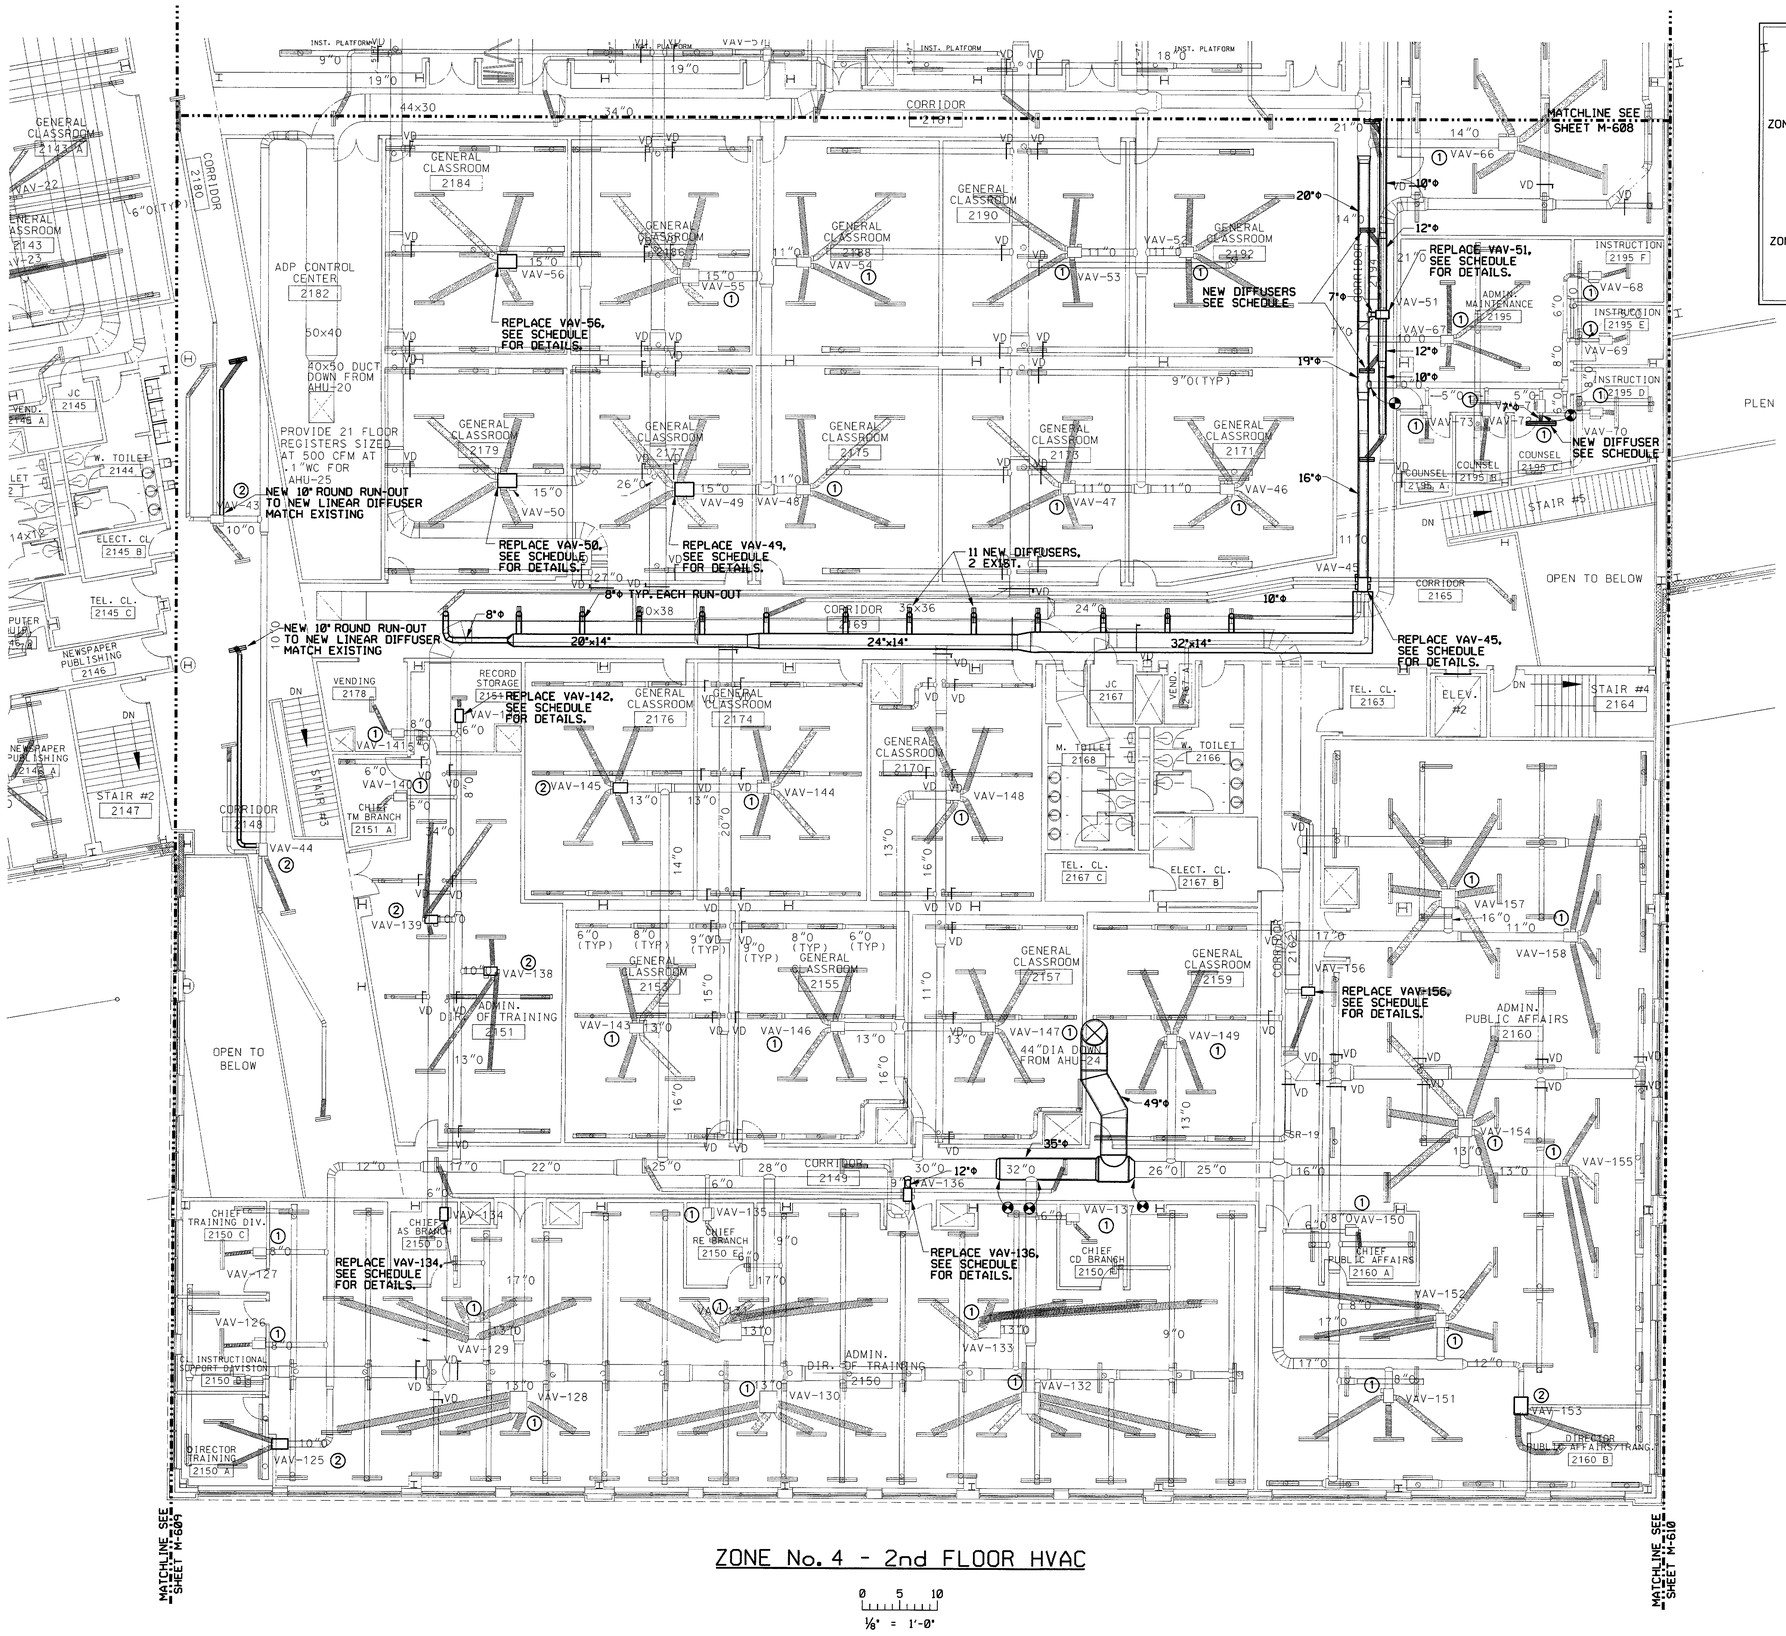


## LEGEND

EXISTING
NEW
DEMO

NOTE(S):

1. REBALANCE VAV (AIR AND HOT WATER FLOW) PER VAV BOX SCHEDULE.
2. REPLACE VAV BOX SHOWN AS NEW. SEE VAV BOX SCHEDULE FOR DETAILS.

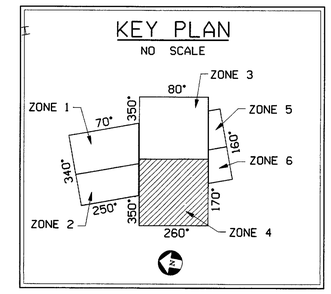THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIAIBILITIES STATEMENT ON COVER SHEET.

US ARMY ENGINEERING AND SUPPORT CENTER HUNTSVILLE

| Symbol | Description | Date | Appr. | Symbol | Description | Date | Appr. |
|---|---|---|---|---|---|---|---|

TASK ORDER #: FRR004
VANGUARD
PADUCAH, KENTUCKY
VOICE 270-442-8620
I.C. Thomasson Associates, Inc.
NASHVILLE, TENNESSEE
PHONE (615) 346-3400

Checked by: WTT
Dwn by: ICT
DACA87-03-D-0006
Approved by:
Chief, Prj. Mgmt. Division
Date: 02/27/04
CADD File Name: 312IM609.DGN
ICT Project No. 203121
Plot date: 02/27/04
Plot scale:

# DEFENSE INFORMATION SCHOOL
FT. MEADE MARYLAND

ZONE 4 - 2nd FLOOR HVAC

STATE OF MARYLAND
MECHANICAL ENGINEER

Sheet reference number:
M-609