NOTE(S):

1. REBALANCE EXISTING HOT WATER REHEAT COIL FLOW TO INDICATED REQUIREMENTS.
2. NEW HWS/R TO NEW DUCT HTG. COIL OR NEW VAV BOX. BALANCE REHEAT COIL TO INDICATED REQUIREMENTS.
3. NEW HOT WATER SUPPLY & RETURN TO NEW AHU. NEW PIPE AND ROOF PENETRATION AT EACH COIL.

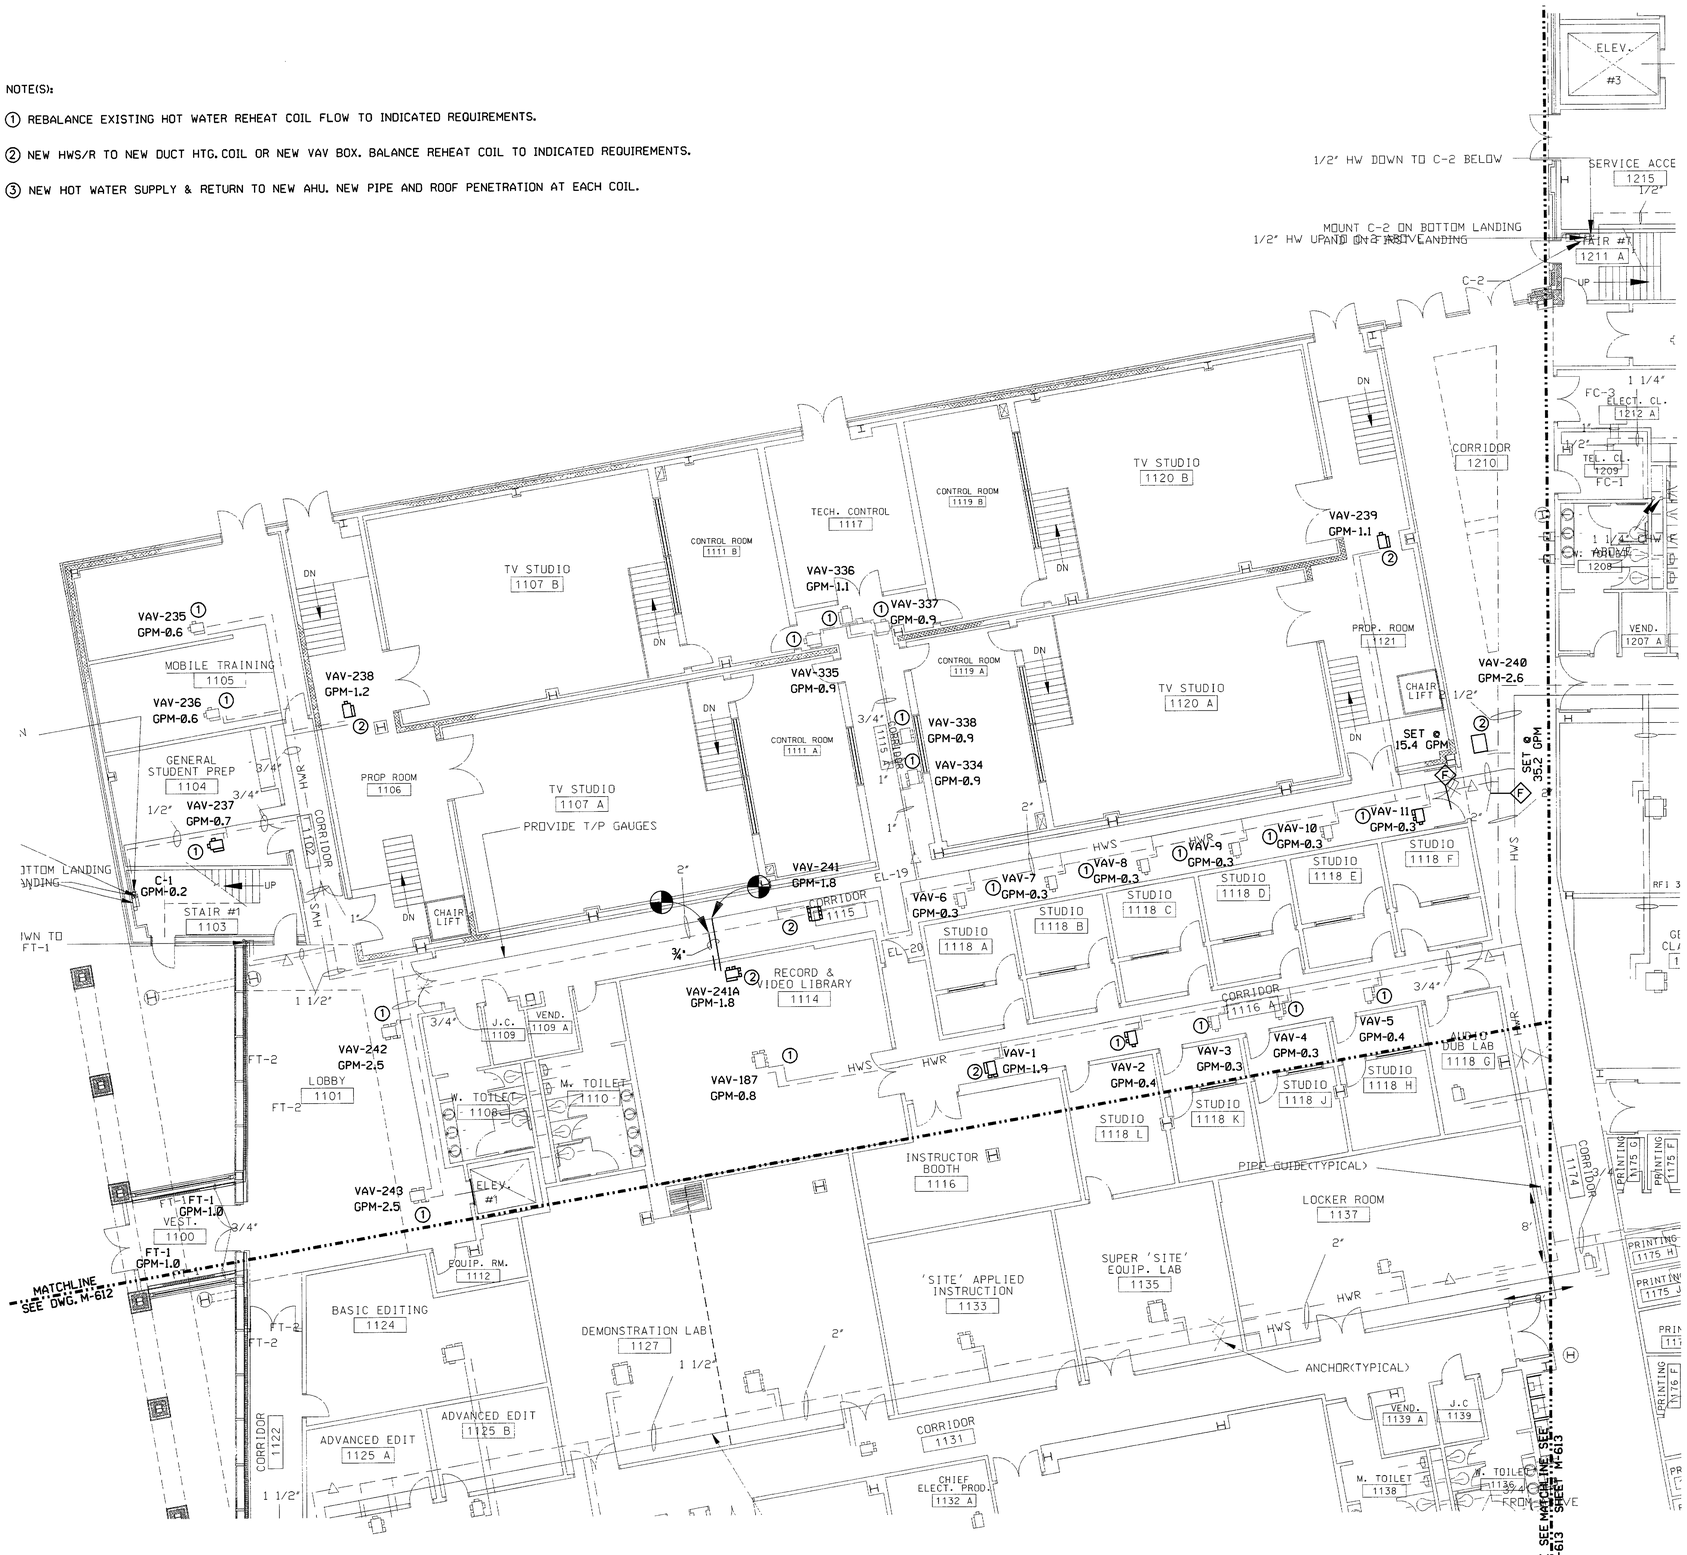

ZONE No. 1 - 1st FLOOR HVAC PIPING

0 5 10
1/8" = 1'-0"

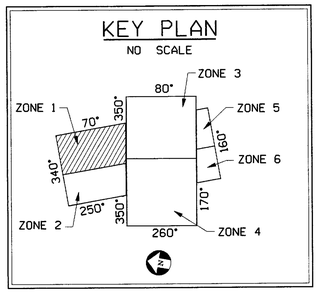

US ARMY ENGINEERING AND SUPPORT CENTER HUNTSVILLE

Symbol	Description	Date	Appr.	Symbol	Description	Date	Appr.

Date: 02/27/04
CADD File Name: 312M611DCN
ICT Project No. 203121
Plot date: 02/27/04
Plot scale:

Checked by: WTT
Dwn by: ICT
DACA87-03-D-0006
Approved by:
Chief, Prj. Mgmt. Division

TASK ORDER #: FRR004
PADUCAH, KENTUCKY
VOICE 270-442-9620
NASHVILLE, TENNESSEE
PHONE (615) 346-3400

I.C. Thomasson Associates, Inc.

DEFENSE INFORMATION SCHOOL
FT. MEADE MARYLAND

ZONE 1 - 1st FLOOR HW PIPING

STATE OF MARYLAND
MECHANICAL ENGINEER

Sheet reference number:
M-611

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIAIBILITIES STATEMENT ON COVER SHEET.