


ZONE No. 4 - 1st FLOOR HVAC PIPING

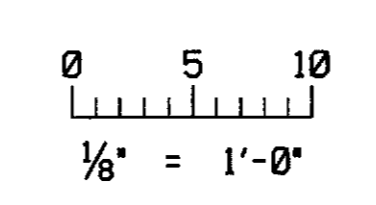

NOTE(S):

- ① REBALANCE EXISTING HOT WATER REHEAT COIL FLOW TO INDICATED REQUIREMENTS. SEE SCHEDULE.
- ② NEW HWS/R TO NEW DUCT HTG. COIL OR NEW VAV BOX. BALANCE REHEAT COIL TO INDICATED REQUIREMENTS.
- ③ NEW HOT WATER SUPPLY & RETURN TO NEW AHU. NEW PIPE AND ROOF PENETRATION AT EACH COIL.

Date	Appr.	Description

Checked by: MTT	Date: 02/27/04
Drawn by: ICT	CADD File Name: 312M614.DGN
DAC487-03-9-0006	ICT Project No. 203121
Approved by:	Plot date: 02/27/04
Chief, Proj. Mgmt. Division	Plot scale:

TASK ORDER # FFR004
 PADUCAH, KENTUCKY
 VOICE 270-442-8620
ICIT
 J.C. Thomasson
 NASHVILLE, TENNESSEE
 PHONE (615) 346-3400

DEFENSE INFORMATION SCHOOL
 FT. MEADE MARYLAND
 ZONE 4 - 1st FLOOR
 HW PIPING

Sheet reference number:
M-614

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITY STATEMENT ON COVER SHEET.

