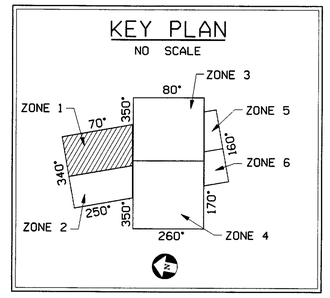


## ZONE No. 1 - 2nd FLOOR HVAC PIPING

0 5 10

1/8" = 1'-0"

NOTE(S):

① REBALANCE EXISTING HOT WATER REHEAT COIL FLOW TO INDICATED REQUIREMENTS. SEE SCHEDULE.

② NEW HWS/R TO NEW DUCT HTG. COIL OR NEW VAV BOX. BALANCE REHEAT COIL TO INDICATED REQUIREMENTS.

③ NEW HOT WATER SUPPLY & RETURN TO NEW AHU. NEW PIPE AND ROOF PENETRATION AT EACH COIL.

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIAIBILITIES STATEMENT ON COVER SHEET.

US ARMY ENGINEERING AND SUPPORT CENTER HUNTSVILLE

| Symbol | Description | Date | Appr. |
|---|---|---|---|
| | | | |

Date: 02/27/04
Checked by: WTT
CADD File Name: 312M616.DGN
Dwn by: ICT
ICT Project No. 203121
DACA87-03-D-0006
Approved by:
Plot date: 02/27/04
Plot scale:
Chief, Prj. Mgmt. Division

TASK ORDER #: FRR004

ENGINEERING

I.C. Thomasson Associates, Inc.
PADUCAH, KENTUCKY VOICE 270-442-8620
NASHVILLE, TENNESSEE PHONE (615) 346-3400

ICT

DEFENSE INFORMATION SCHOOL
FT. MEADE MARYLAND

ZONE 1 - 2nd FLOOR
HW PIPING

STATE OF MARYLAND
MECHANICAL ENGINEER

Sheet reference number:
M-616