


ZONE No. 3 - 2nd FLOOR HVAC PIPING

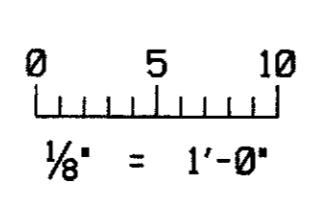

- NOTE(S):
- REBALANCE EXISTING HOT WATER REHEAT COIL FLOW TO INDICATED REQUIREMENTS.
 - NEW HWS/R TO NEW DUCT HTG. COIL OR NEW VAV BOX, BALANCE REHEAT COIL TO INDICATED REQUIREMENTS.
 - NEW HOT WATER SUPPLY & RETURN TO NEW AHU, NEW PIPE AND ROOF PENETRATION AT EACH COIL.

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITIES STATEMENT ON COVER SHEET.

Checked by: WTT	Date: 02/27/04
Drawn by: ICT	CADD File Name: 372MSB.DGN
DACAB7-03-D-0006	ICT Project No. 20321
Approved by:	Plot date: 02/27/04
Chief, Proj. Mgmt. Division	Plot scale:

DEFENSE INFORMATION SCHOOL
MARYLAND
FT. MEADE
ZONE 3 - 2nd FLOOR
HW PIPING

Sheet reference number:
M-618

Symbol	Description	Date	Appr.



2/27/04 12:56:35 PM G:\SERVICES\BANKS\10438200.dwg L:\PLOT\10438200.DWG