



- NOTE(S):
- ① REBALANCE EXISTING HOT WATER REHEAT COIL FLOW TO INDICATED REQUIREMENTS.
 - ② NEW HWS/R TO NEW DUCT HTG. COIL OR NEW VAV BOX. BALANCE REHEAT COIL TO INDICATED REQUIREMENTS.
 - ③ NEW HOT WATER SUPPLY & RETURN TO NEW AHU. NEW PIPE AND ROOF PENETRATION AT EACH COIL.

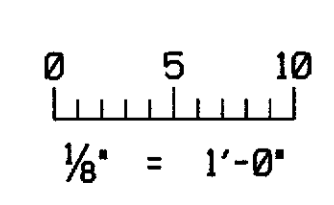

ZONE No. 4 - 2nd FLOOR HVAC PIPING

NOTE(S):
① REBALANCE HW FLOW TO VAV REHEAT COIL. SEE SCHEDULE FOR REQUIREMENTS.

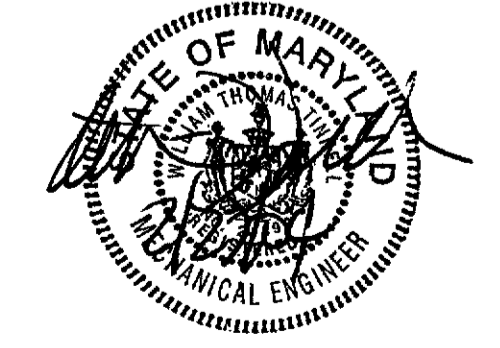

Date	Appr.	Symbol	Description

Date: 02/27/04	Checked by: MTT
CADD File Name: J21609.DGN	Drawn by: ICT
ICT Project No. 20321	DAC487-03-D-0006
Plot date: 02/27/04	Approved by: [Signature]
Plot scale:	Chief, Proj. Mgmt. Division

TASK ORDER # FFR004
PADUCAH, KENTUCKY
VOICE 270-442-8620

ICIT
I.C.T. THOMASSON
10000 WOODBRIDGE BLVD
FREDERICK, MD 21704
PHONE (410) 346-3400

DEFENSE INFORMATION SCHOOL
MARYLAND
FT. MEADE

ZONE 4 - 2nd FLOOR
HW PIPING

Sheet reference number:
M-619

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C.T. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITIES STATEMENT ON COVER SHEET.