

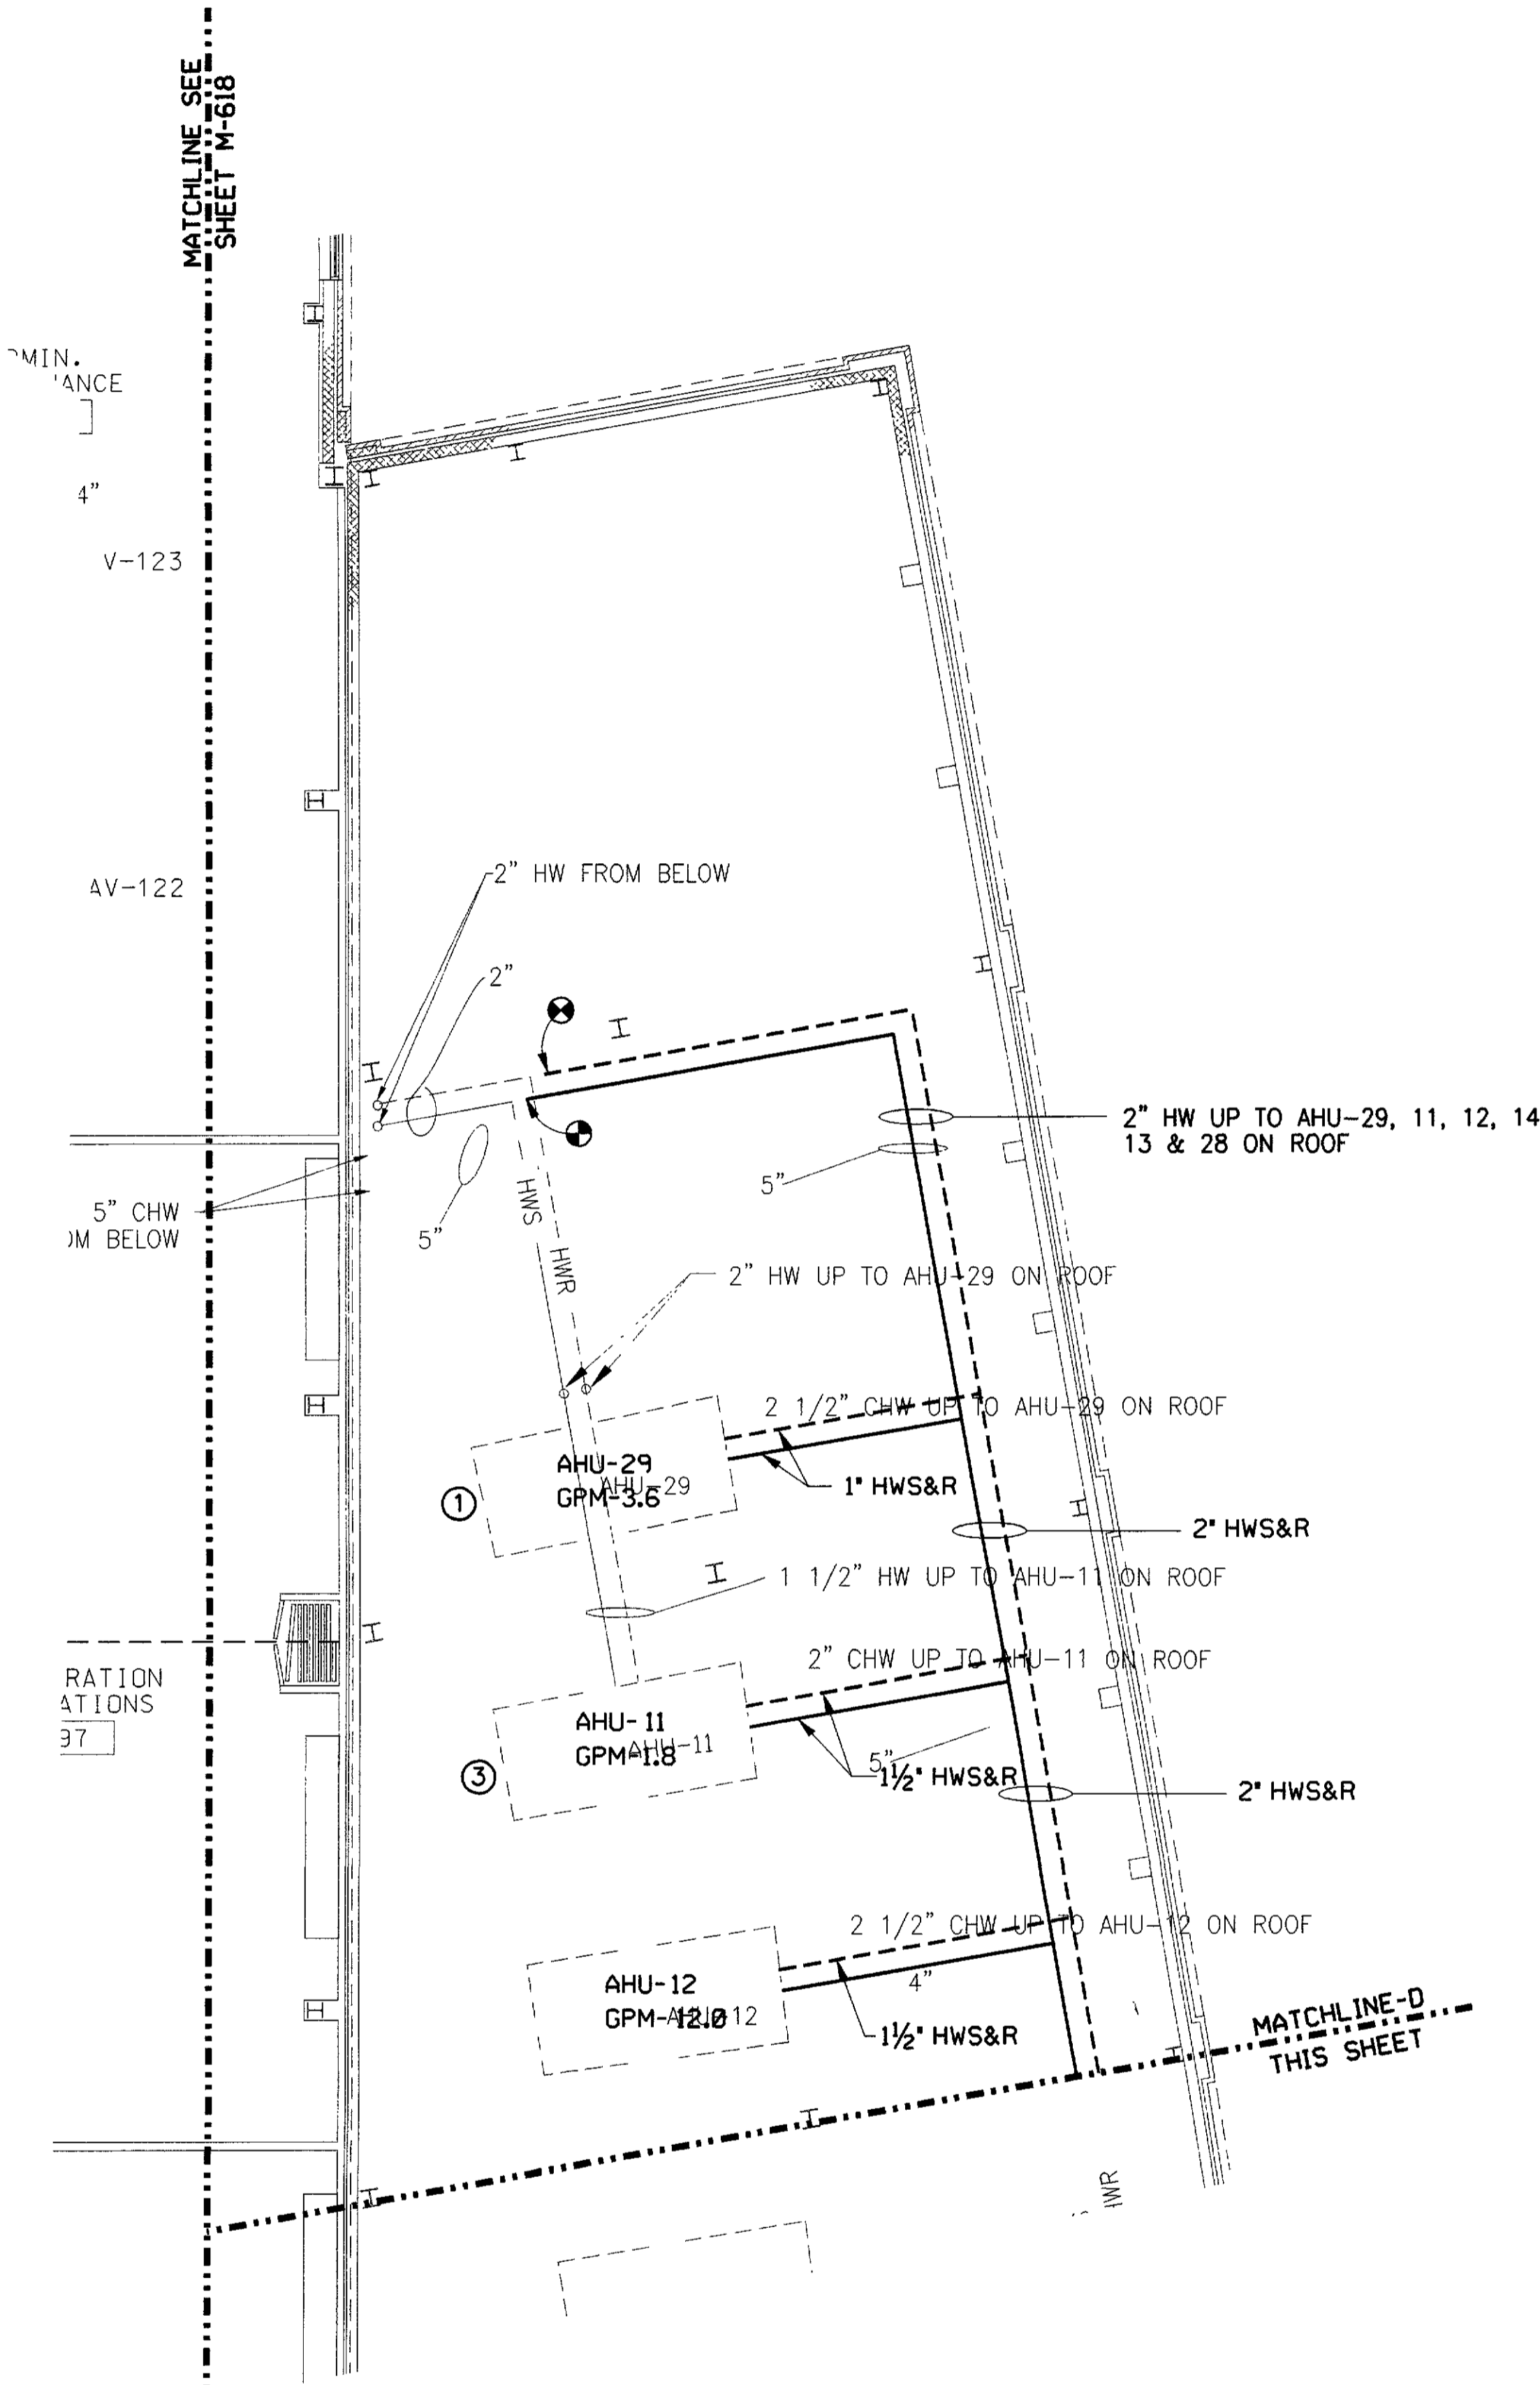
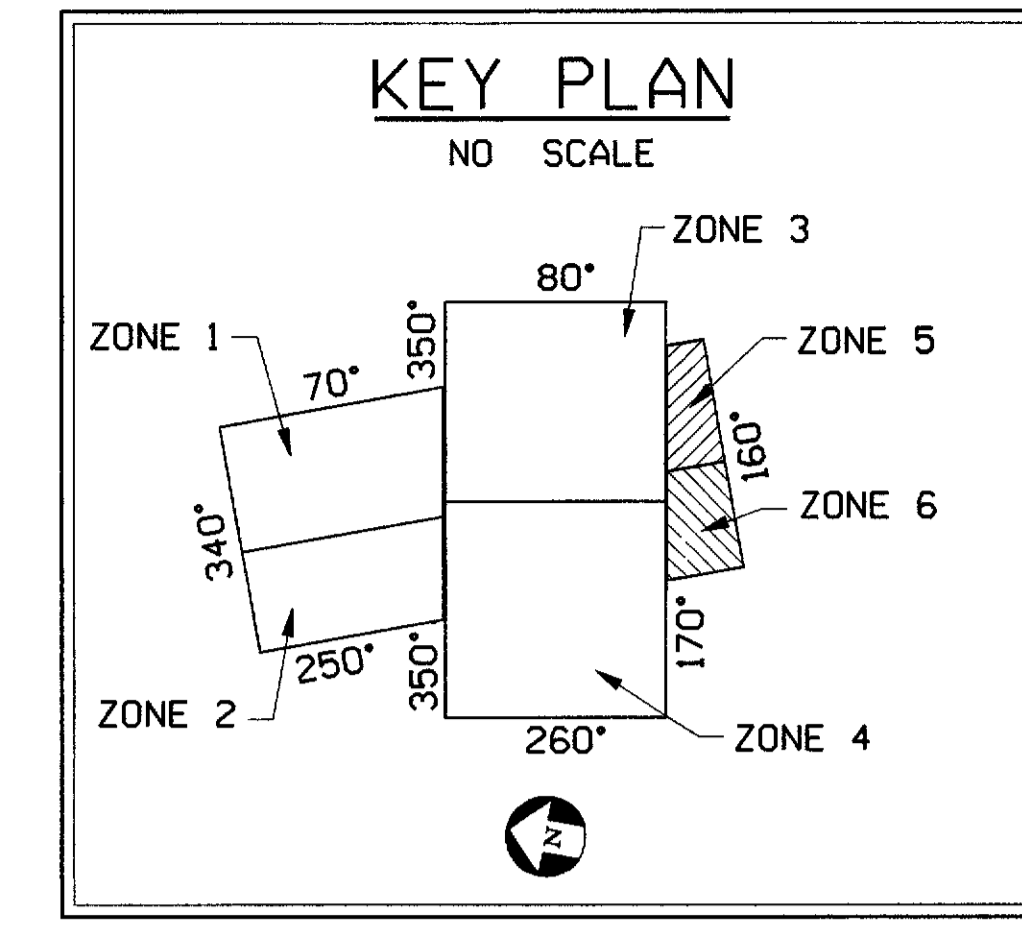


NOTE(S):



- ① REBALANCE EXISTING HOT WATER REHEAT COIL FLOW TO INDICATED REQUIREMENTS.
- ② NEW HWS/R TO NEW DUCT HTG. COIL OR NEW VAV BOX. BALANCE REHEAT COIL TO INDICATED REQUIREMENTS.
- ③ NEW HOT WATER SUPPLY & RETURN TO NEW AHU, NEW PIPE AND ROOF PENETRATION AT EACH COIL.

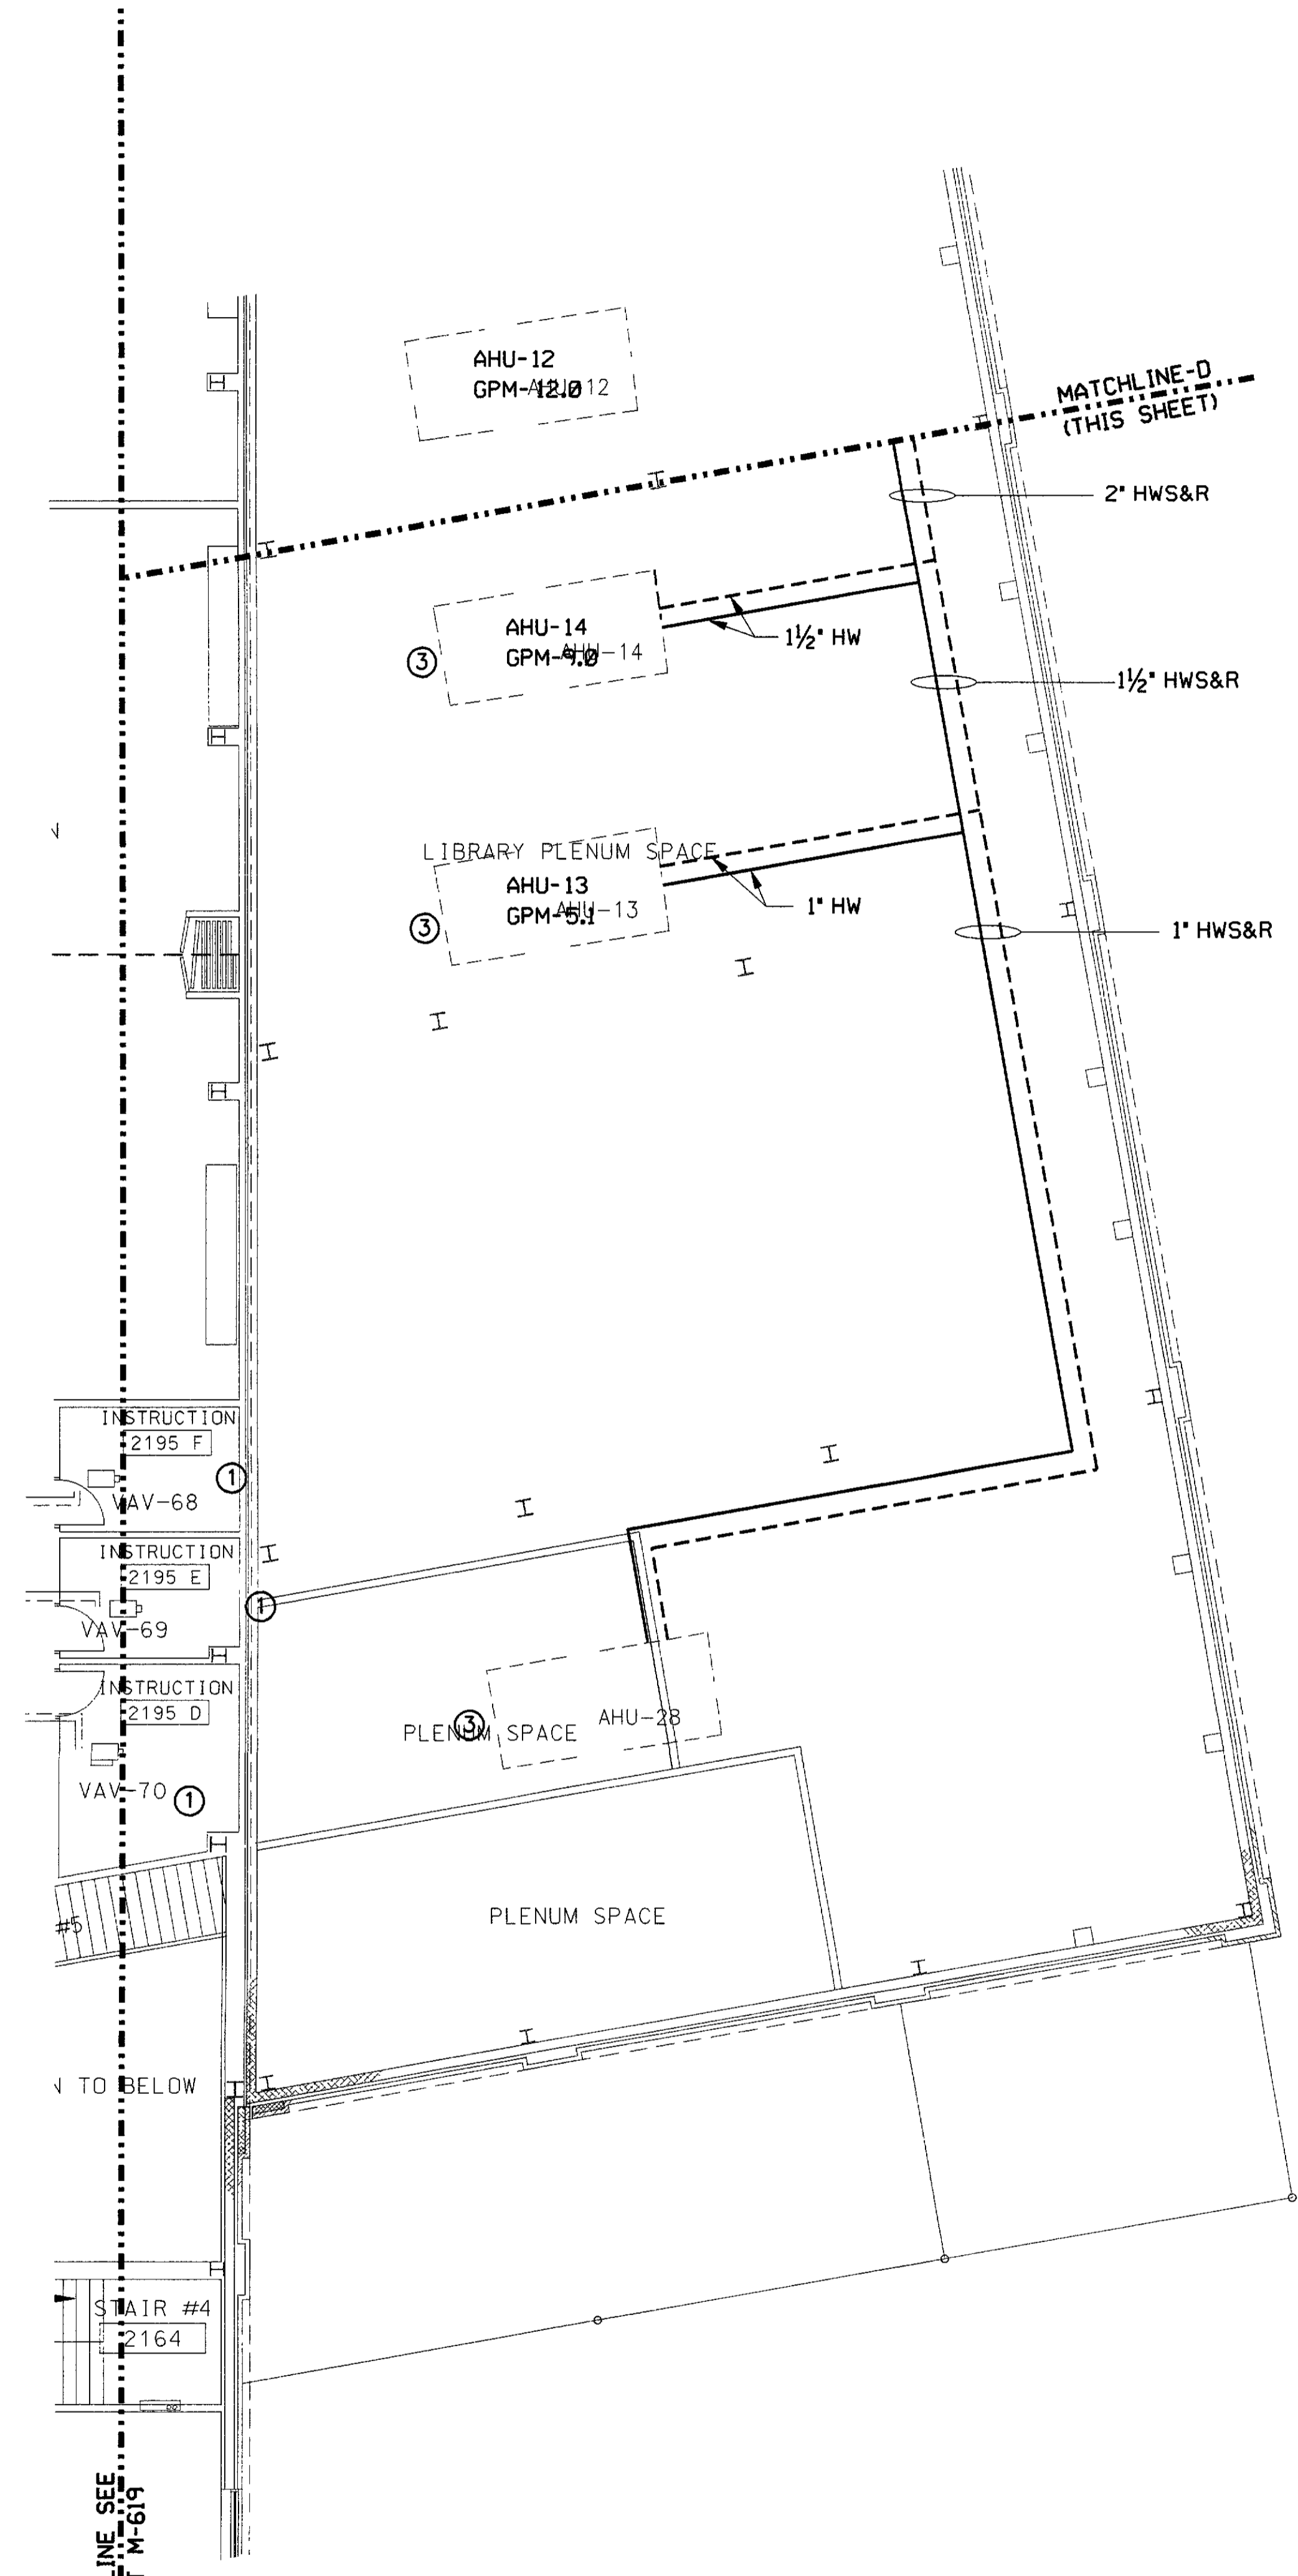

ZONE No. 5 - 2nd FLOOR HVAC PIPING

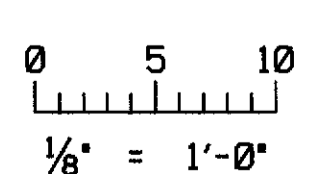


ZONE No. 6 - 2nd FLOOR HVAC PIPING

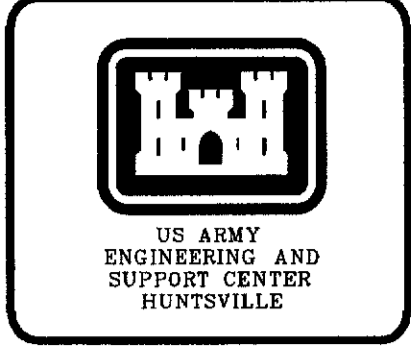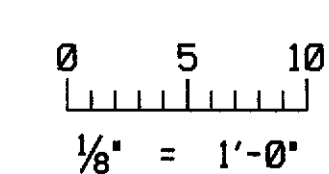

Symbol	Description	Date	Appr.

Checked by: WIT	Date: 02/27/04
Des by: ICT	CADD: JLR/M2/D/DGN
DACAB7-03-D-0006	ICT Project No. 20321
Approved by:	Plot date: 02/27/04
Chief, Prj. Mgmt. Division	Plot scale:
TASK ORDER #1 FFR004	
PADUCAH, KENTUCKY	
VOICE: 270-442-8620	
I.C. Thomasson	
Asst. Chief, Prj. Mgmt. Division	
NASHVILLE, TENNESSEE	
PHONE: (615) 346-3400	

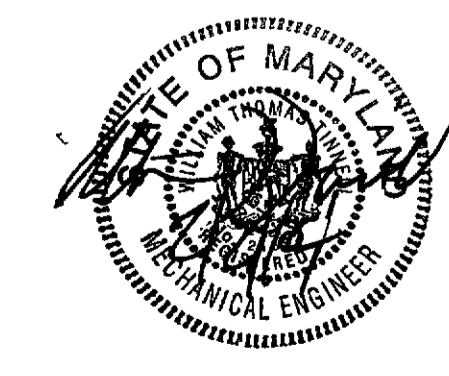

DEFENSE INFORMATION SCHOOL MARYLAND
FT. MEADE
ZONE 5 & 6 - 2nd FLOOR
HW PIPING

Sheet reference number:
M-620

THESE DOCUMENTS HAVE BEEN PREPARED PRIMARILY BASED ON INFORMATION PROVIDED BY OTHERS. I.C. THOMASSON HAS NOT VERIFIED THE ACCURACY OF ALL INFORMATION PROVIDED BY OTHERS. SEE LIMIT OF LIABILITY STATEMENT ON COVER SHEET.