
GENERAL NOTES:

1. COORDINATE EXACT LOCATION OF DEVICES WITH ARCHITECTURAL ELEVATIONS. GENERALLY WHERE AN ARCHITECTURAL ELEVATION IS AVAILABLE, DEVICE MOUNTING HEIGHTS ARE OMITTED FROM THIS DRAWING.
2. ALL TRADES ARE TO BE INDEPENDENTLY SUPPORTED. PER ALL TRADE STANDARDS AND NFPA. NOTHING CAN TOUCH THE SPRINKLER PIPING OR SUPPORT/HANGERS. SYSTEMS CANNOT BE SUPPORTED FROM OTHER PARTS OF A SYSTEM. EACH PIPE SHOULD SHOULD BE SUPPORTED INDEPENDENTLY OF EACH OTHER.
3. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LOCATION OF LIGHTING FIXTURES.
5. ALL DEVICES INSTALLED ABOVE THE CEILNG SHALL BE PROVIDED WITH LABELS INDICATING THE DEVICE OR EQUIPMENT INSTALLED ABOVE. ALL DEVICES INSTALLED ABOVE A "HARD" CEILING SHALL BE PROVIDED WITH AN ACCESS PANEL OF SUFFICENT SIZE FOR DEVICE MAINTENANCE AND EVENTUAL REMOVAL.
6 ALL CONDUIT INSTALLED ON THE EXTERIOR OF THE BUILDING SHALL BE RIGID GALVANIZED STEEL CONDUIT.
7 ALL DISCONNECT SWITCHES INSTALLED ON THE EXTEIOR SHALL BE NEMA 4X ENLOSURES.
8. ALL CORRIDORS SHALL BE CONNECTED TO A SINGLE LIGHTING CONTROL MODULE SERVING THIS AREA AND LEVEL. PROVIDE WITH KEY OPERATED OVERRIDE SWITCHES FOR EACH CORRIDOR.
9 ALL FIRE ALARM DEVICES INDICATED ON THE EXTERIOR OF THE BUILDING SHALL BE WEATHERPROOF. ALL PENETRATIONS SHALL BE SEALED WEATHERTIGHT
10 ALL RECEPTACLES INSTALLED ON THE BUILDING EXTERIOR SHALL BE GFCI TYPE IN WEATHERPROOF LOCK-IN USE ENCLOSURES.
11 ALL RECEPTACLES INSTALLED IN THE FACILITY SHALL BE TAMPER RESISTANT TYPE.


Keynotes

NO.	DESCRIPTION
7.06	RECEPTACLE FOR FUTURE DRYER FAN.

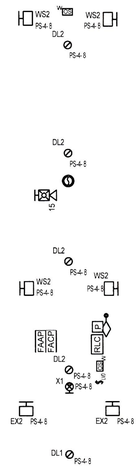


1 Typ Corridor - Lighting

E404 1/4" = 1'-0"

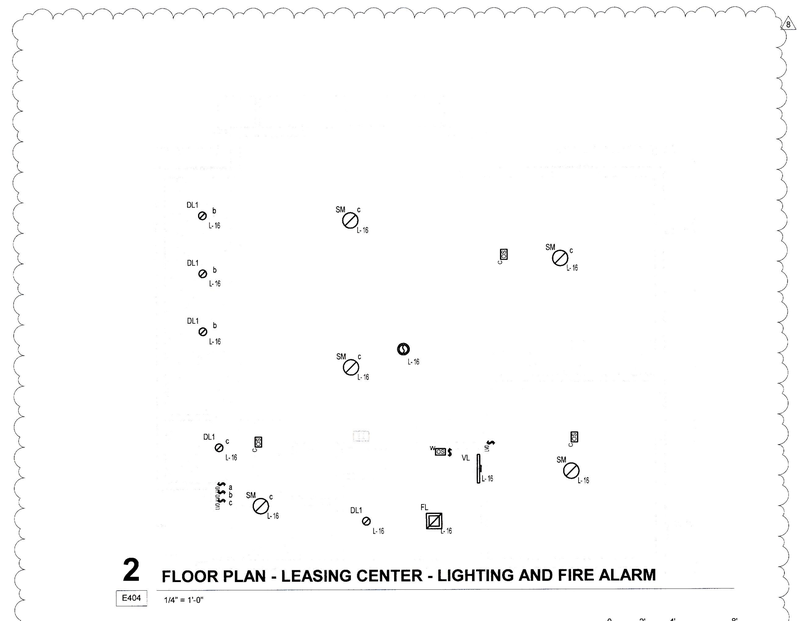


2 FLOOR PLAN - LEASING CENTER - LIGHTING AND FIRE ALARM

E404 1/4" = 1'-0"



3 Typ Corridor - Power

E404 1/4" = 1'-0"

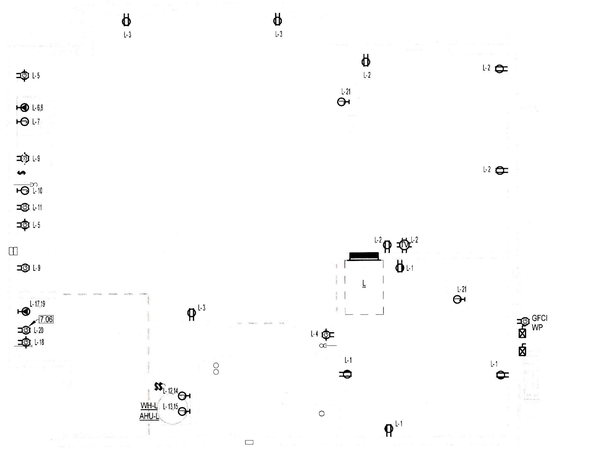

4 FLOOR PLAN - LEASING CENTER - POWER

E404 1/4" = 1'-0"

0 2' 4' 8'

PROJECT PROJ. NO.: 22-15

Millington Senior Village

Residential Buildings

172 Sassafras Street
Millington, MD 21651

PRESENT PRES COMPANY

PROJECT DIRECTORY

DEVELOPER
Home Partnership of Cecil County, Inc
626 TOWNE CENTER DRIVE, SUITE 102
JOPPA, MD 21085
TEL 410.679.3200

CIVIL ENGINEER
Atwell, LLC
4692 MILLENNIUM DRIVE, SUITE 305
BELCAMP, MD, 21017
TEL 302.369.2900

ARCHITECT
Present Company
2209 MARYLAND AVE
BALTIMORE, MD 21218
TEL 410.696.3321

STRUCTURAL ENGINEER
Skarda and Associates
2439 N CHARLES STREET
BALTIMORE, MD 21218
TEL 410.366.9384

MEP ENGINEER
Bowley Jones
1107 BURKHARDT LANE
SEVERN, MARYLAND, 21144
TEL 410.777.9493

ENERGY CONSULTANT
Lorax Partnerships, LLC
808 ST. PAUL STREET
BALTIMORE, MD 21202
TEL 443.449.6319

GENERAL CONTRACTOR
Willow Construction
8649 COMMERCE DRIVE
EASTON, MD 21601
TEL 410.822.6000

© 2024 PRESENT COMPANY; ALL RIGHTS RESERVED

PROFESSIONAL CERTIFICATION

Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 51059, Expiration Date: 06-07-2027.

REVISIONS

DATE	NO.	ISSUE
6/22/2026	8	Permit Set Revisions

SUBMISSION

100% Construction Documents
PERMIT SET REISSUE
June 22, 2026

DRAWING NAME / NO. SCALE: 1/4" = 1'-0"

ENLARGED VIEWS - ELECTRICAL

E404

6/25/2026 11:06:11 AM